

**BEELLE**  
*ENGINEERING*

---



**PRODUCT OVERVIEW  
CABLE AND PIPE  
SEALING SYSTEMS  
BUILDING INDUSTRY**

# CONTENTS

page I	Introduction to BEELE Engineering
pages 2-5	Product overview
pages 6-9	CSD® embedded conduit pipe inlet system
pages 10-21	SLIPSIL® sealing plugs for pipe and cable penetrations
pages 22-24	SLIPSIL® type MPP watertight multi-sealing system
pages 25-27	CET-A-SIL plugs and modules for multi-gland systems
pages 28-31	DYNATITE® sealing plugs for high pressure ratings
pages 32-40	RISWAT® watertight cable/pipe transit sealing system for new and existing leaking conduits
pages 41-44	AQUASTOP® watertight cable/pipe transit sealing system for existing leaking conduits
pages 45-50	NOFIRNO® (multi-) pipe transit sealing system
pages 51-52	NOFIRNO® structural gap sealing system
pages 53-55	RISE®/NOFIRNO® multi-cable transit sealing system
pages 56-61	RISE®/ULTRA fire safe (multi-) plastic pipe crusher system
pages 62-65	NOFIRNO® multi-all-mix® fire safe cable/pipe sealing system
pages 66-68	ACTIFOAM® fire safe multi-cable and cable way transit sealing system
pages 69-72	FIRSTO®/ACTIFOAM® fire safe multi-cable and cable way transit sealing system
pages 73-75	ACTIFOAM®/NOFIRNO®-BRD fire safe multi-cable and cable way transit sealing system
page 76	NOFIRNO®, RISE®, RISE®/ULTRA and RISWAT® calculation software
pagina 77	ACTIFOAM®/ULTRA fire safe gap seals


**Copyright** : BEELE Engineering BV/CSD International BV, Aalten, the Netherlands.  
Proprietary rights on all drawings and technical data released in this brochure.  
© 1997-2013

**Edition** : March 2013

**Note** : No part of this publication may be reproduced without explicit written approval of BEELE Engineering BV.

**Research & Development** : BEELE Engineering BV, Aalten, the Netherlands.

**Note** : The manufacturer reserves the right to make dimensional and design modifications without prior notification.

® : ACTIFIRE, ACTIFOAM, AQUASTOP, BEEBLOCK, BEEBOND, BEELE, BEESEAL, CONDUCTON, CRUSHER, CSD, CSD THE SIMPLE SEAL SYSTEM, DRIFIL, DYNATITE, FIRSTO, FIWA, LEAXEAL, MULTI-ALL-MIX, NOFIRNO, profiles NOFIRNO gaskets, RAPID TRANSIT SYSTEM, RIACNOF, RISE, RISWAT, , SLIPSIL, flanges SLIPSIL plugs, ULEPSI and YFESTOS are registered trade marks.

**brochure code** : product overview/en/con

## BEELE ENGINEERING - SAFETY, RELIABILITY, INVOLVEMENT

Every moment of the day, in every business and every situation, the threat of fire or flood is present. For over three decades, BEELE Engineering has specialized in passive fire safety and leakage prevention in the form of systems which prevent the spread of fire, smoke, water and gases via cable and pipe penetrations. With our superior sealing technologies, we have become the undisputed Number One in this particular field.

It is BEELE Engineering's philosophy that R&D exists to respond to market demands. Only then can research and development activities be classed as functional. Only then are innovative solutions generated for problems that have current or near-term relevance. Our policy is one of continuous active response to customers' demands, or to modified or new functional requirements. We listen, we observe and we interpret, and so we arrive at new product developments and bold innovations.

BEELE Engineering has built up an enormous body of specialized expertise and knowledge. Our company is the world market leader in sealing systems for state-of-the-art shipbuilding applications as well as civil and industrial applications. We do not follow trends, we set them.

Development of new products and technologies, as well as pioneering know-how, are present in every fibre of our organization. We are driven by passion for our specialization, and our customer involvement drives us to exceed the boundaries of what is technically feasible.


BEELE Engineering operates world-wide. From our agencies in virtually every industrialized country, our support and services are always somewhere nearby. We are there for you – also for on-site advice or in-house demonstrations, instructions and support at your location.



*Our development, test and production facilities are among the most advanced in the world. The factory is equipped with state of the art machines, which are tailor made to the requirements of our company. We work to a high-level ISO system, with unmatched involvement. Continuous investment in design technologies, combined with highest quality polymers, is our guarantee for the safety of lives and equipment. That is why BEELE Engineering is internationally recognized by all relevant certification institutes and classification societies.*




## BEELE PRODUCT OVERVIEW APPLICATIONS IN THE BUILDING INDUSTRY

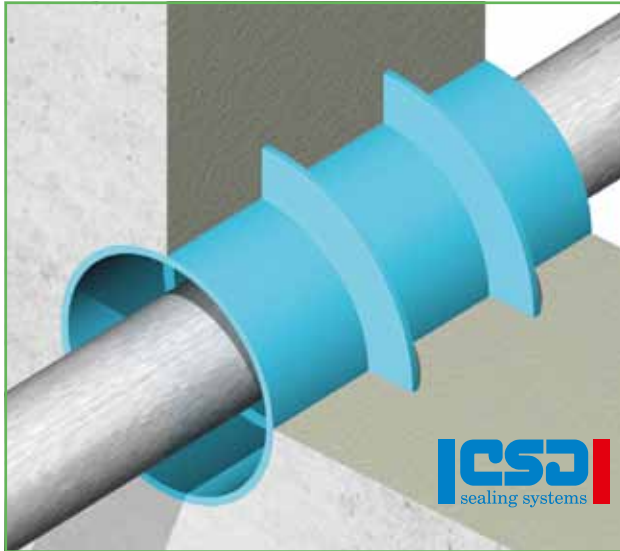


### CSD®

- Embedded pipe sets for casting into concrete.
- Made of impact resistant plastic.
- Consisting of conduit inlets, adjusting pipes (length), pipe connectors (extreme length) and fixations to the casing.
- Flanges on the conduit inlets act as a water barrier and fixation of the inlet in concrete.
- Conduit inlets manufactured to exact dimensions of the SLIPSIL® plugs and rounded off to avoid any damage to the plugs during insertion.
- Smooth inner surface and shoulder at the back for optimum insertion of the SLIPSIL® plugs.
- **Breakthrough - watertight, modular system**
- Loosen embedded pipes a thing of the past.

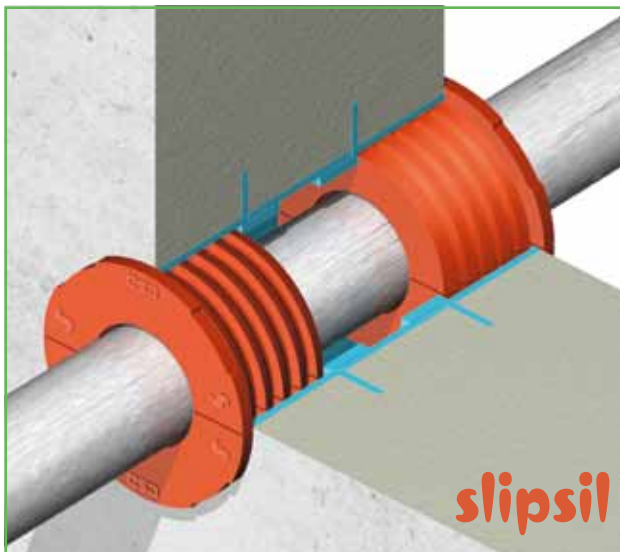

### SLIPSIL®

- Designed to provide fire safe, gas and watertight seals for pipe/cable penetrations.
- For transits carrying single or multiple metal pipes with the same diameter.
- Installs in a couple of minutes. Lubricate and push - that's it!
- No bolting or other mechanical devices required.
- Absorbs mechanical stresses, vibration and prevents galvanic corrosion problems.
- Wide temperature range: -50 °C up to +180 °C.
- **Proven - simple installation, high performance**
- The system of choice for underground ducting in the building industry worldwide for almost 4 decades!

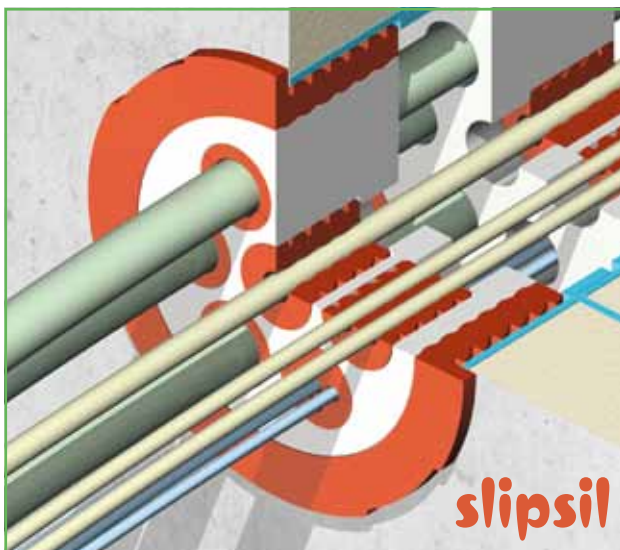

### SLIPSIL® - MPP


- Designed to provide a simple solution for both cable and pipe multi-penetrations.
- For transits carrying a variety of pipes/cables with different diameters.
- Installs in a couple of minutes. Lubricate and push - that is it!
- Easy access for later extensions.
- No bolting or other mechanical devices required.
- Modules with various hole configurations, made of a special plastic grade for watertight penetrations, guaranteeing a long service life.
- **Breakthrough - most easy access for extensions**
- The system of choice for underground ducting in concrete pits and foundations!



## BEELE PRODUCT OVERVIEW APPLICATIONS IN THE BUILDING INDUSTRY

### DYNATITE®

- For applications where a high degree of (instantaneous) tightness is required.
- Dynamic sealing when a disaster occurs.
- Plugs are compressible and will return to their original shape after shock pressure.
- Easily withstands shock pressure loads up to 15 bar (220 psi).
- Ideal solution for cable and pipe transits in subsea and explosion proof installations.
- **Breakthrough - dynamic compression**
- Based on high-tech rubber grade and engineered profiling, the DYNATITE® plugs can be substantially compressed and get tighter with excessive pressure.

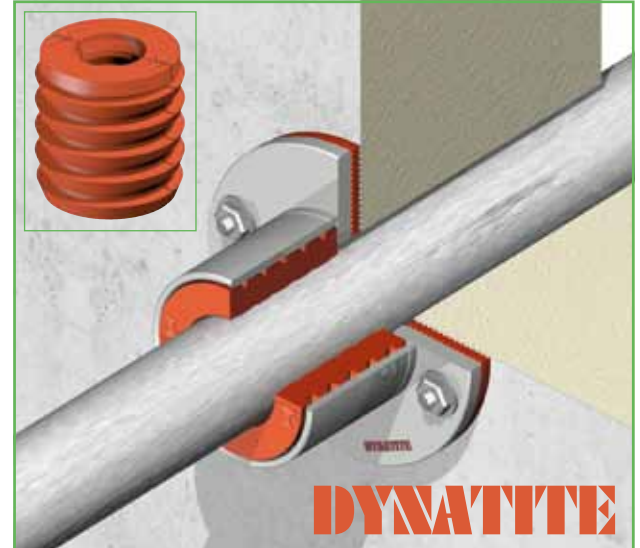


### CSD®

- High quality stainless steel conduit sleeves.
- Made of stainless steel 1.4571.
- Newest capacitor discharge welding technology.
- Corrosion prevention by an unique passivation process. Tested according to DIN EN 60068-2-52.
- Ceramic or PTFE (Teflon) coating inside the flanged conduit sleeves.
- Flanged conduit inlets milled to exact dimensions of the SLIPSIL® and DYNATITE® plugs and rounded off to avoid any damage to the plugs during insertion.
- **Breakthrough - corrosion protection, even in sea-water conditions, guaranteed for many years**
- For cases where durability of the installation counts.



### RISWAT®

- The system of choice worldwide to replace leaking conduits in a most efficient way.
- The system is suitable for existing cable and pipe penetrations.
- DRIFIL® sealant has a high bonding strength.
- Can be applied in concrete or brick walls.
- No conduit frames or sleeves necessary.
- CSD® split modular frames for leaking conduits.
- Limited amount of structural components: RISWAT® insert and filler sleeves and DRIFIL® sealant.
- **Proven - thousands of leaking conduits sealed with RISWAT® all over the world**
- Identical system technology as NOFIRNO®.

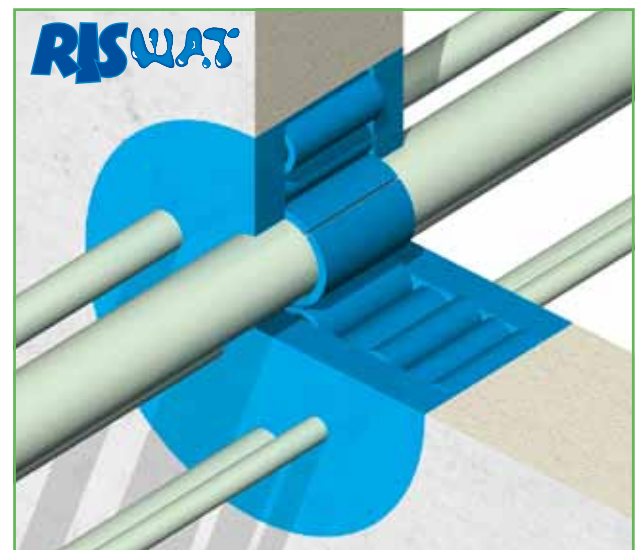


## BEELE PRODUCT OVERVIEW APPLICATIONS IN THE BUILDING INDUSTRY




### NOFIRNO®

- Approved for harshest fire ratings (EN, A, H and Jet Fire class) in the building industry.
- NOFIRNO® rubber sleeves and sealant will remain stable and not be consumed by fire.
- Allows substantial movement of the ducted pipe within the conduit.
- High pressure ratings - designed for gas and/or watertight penetrations.
- Prevents corrosion inside the penetration.
- Longest service life and best Total Cost of Ownership on the market.
- **Breakthrough - MULTI-ALL-MIX® system**
- Approved for any combination of cable and/or metallic, GRP or plastic pipes!

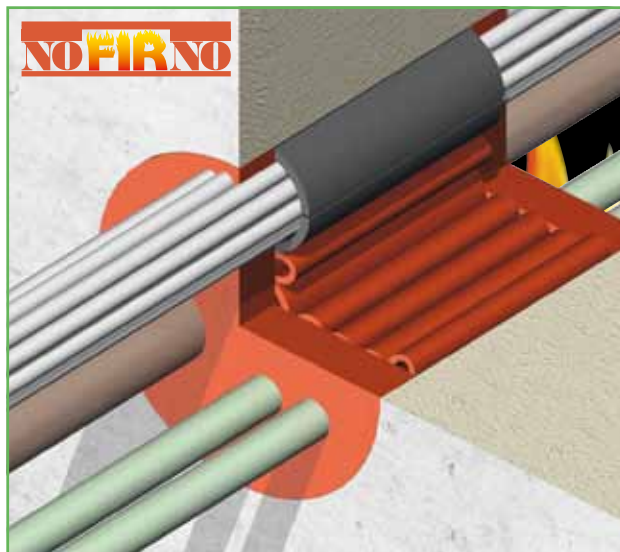

### NOFIRNO®

- For fire, gas, smoke and watertight sealing of multi-cable penetrations.
- Compact system. No precise fitting parts.
- No metal parts, no corrosion.
- Most effective way of installation.
- No pre-engineering or special conduit frames.
- No restrictions on cable types and sizes, no insulation in front of the penetration needed.
- Re-entry for cable modifications is simple.
- Approved for harshest fire ratings for multi-cable penetrations (EN, A, H and Jet Fire class).
- **Breakthrough - bundled cable sets approved**
- The system of choice for highest fire ratings and harshest environment!

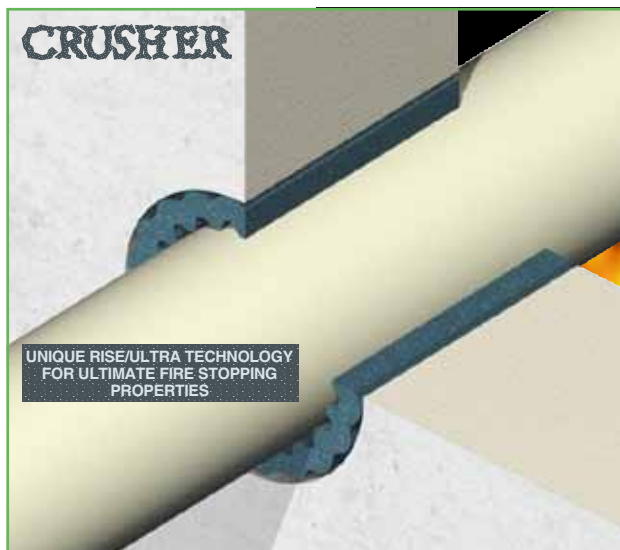


### CRUSHER®

- Most simple and effective system for all fire safe plastic pipe penetrations.
- RISE®/ULTRA C-FIT crushers squeeze down and seal opening during a fire.
- RISE®/ULTRA wraps to be used for oversized conduit sleeves.
- **Breakthrough - adhesion under fire load**
- RISE®/ULTRA compound forms an adhesive mass during fire exposure!
- Approved for a multiple mixture of all kinds of plastic and metallic pipes.
- NOFIRNO® sleeves for filling larger spaces.
- NOFIRNO® sealant adheres well to plastics: high degree of water tightness feasible.

## BEELE PRODUCT OVERVIEW APPLICATIONS IN THE BUILDING INDUSTRY


### ACTIFOAM®

- Designed to provide a simple solution for both new and existing cable penetrations.
- Cellular rubber with closed cell structure to prevent moisture absorption.
- Rubber is activated and expanding when exposed to flames or extensive heat.
- Self-correcting fire stop system.
- EN certified for a two hour fire rating.
- Adding or removing cables an easy matter.
- Front of the sealing system can be covered with FIWA® or NOFIRNO® sealant for outdoor use.
- **Proven - simple installation (sheets and slit sheets)**
- The system of choice for upgrading existing cable penetrations.

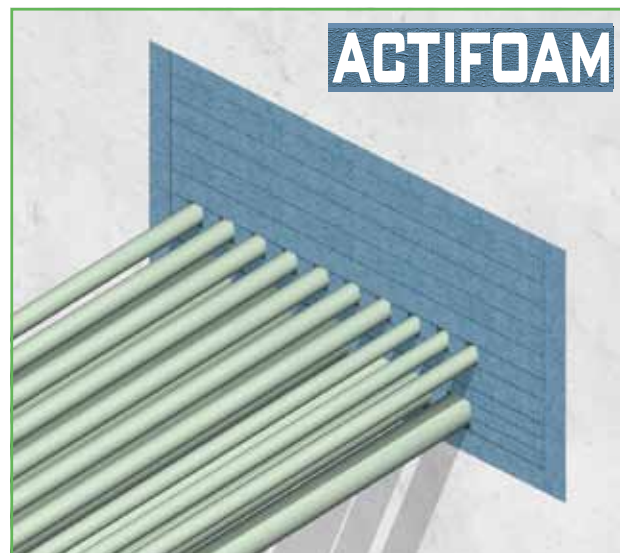


### FIRSTO®

- Designed to provide a simple solution for both new and existing cable penetrations.
- Cellular rubber with closed cell structure to prevent moisture absorption.
- Rubber is activated and expanding when exposed to flames or extensive heat.
- Self-correcting fire stop system.
- EN certified for a two hour fire rating.
- Adding or removing cables an easy matter.
- Front of the sealing system can be covered with FIWA® or NOFIRNO® sealant for outdoor use.
- **Proven - modular casings to fit to cable ways.**
- The system of choice for installations with continuous changes of the cable set.

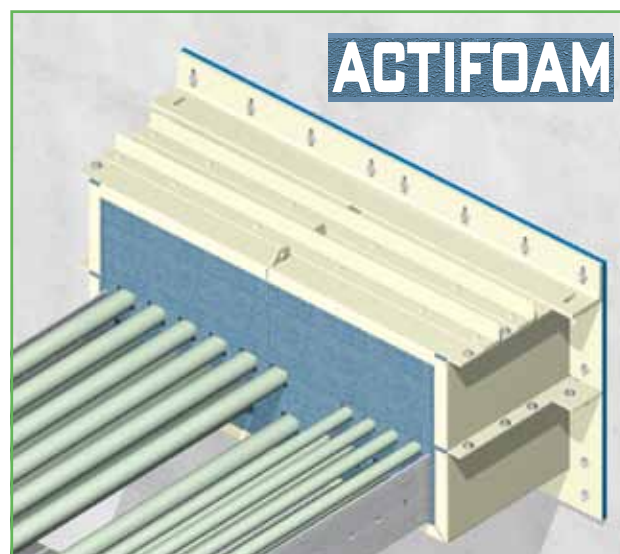


### NOFIRNO®-BRD

- Designed to provide a fire safe sealing solution for upgrading existing installations.
- Combination of ACTIFOAM® rubber and NOFIRNO® boards, especially for oversized penetrations.
- Cellular rubber with closed cell structure to prevent moisture absorption.
- Rubber is activated and expanding when exposed to flames or extensive heat.
- NOFIRNO® coating prevents shrinking of mineral wool board. Not moisture sensitive.
- **Breakthrough - coating which forms a ceramic shield when exposed to fire, preventing shrinkage**
- The system of choice for replacing intumescent sealing systems.

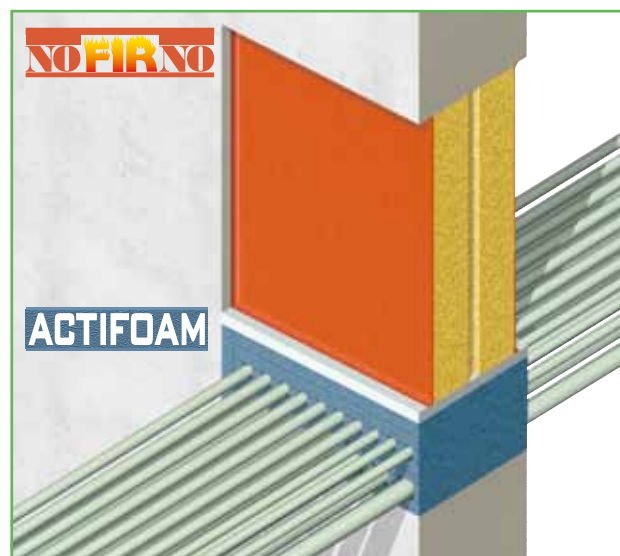



## SLIPSIL® EMBEDDED CONDUIT INLET SYSTEM FOR SLIPSIL® SEALING PLUGS

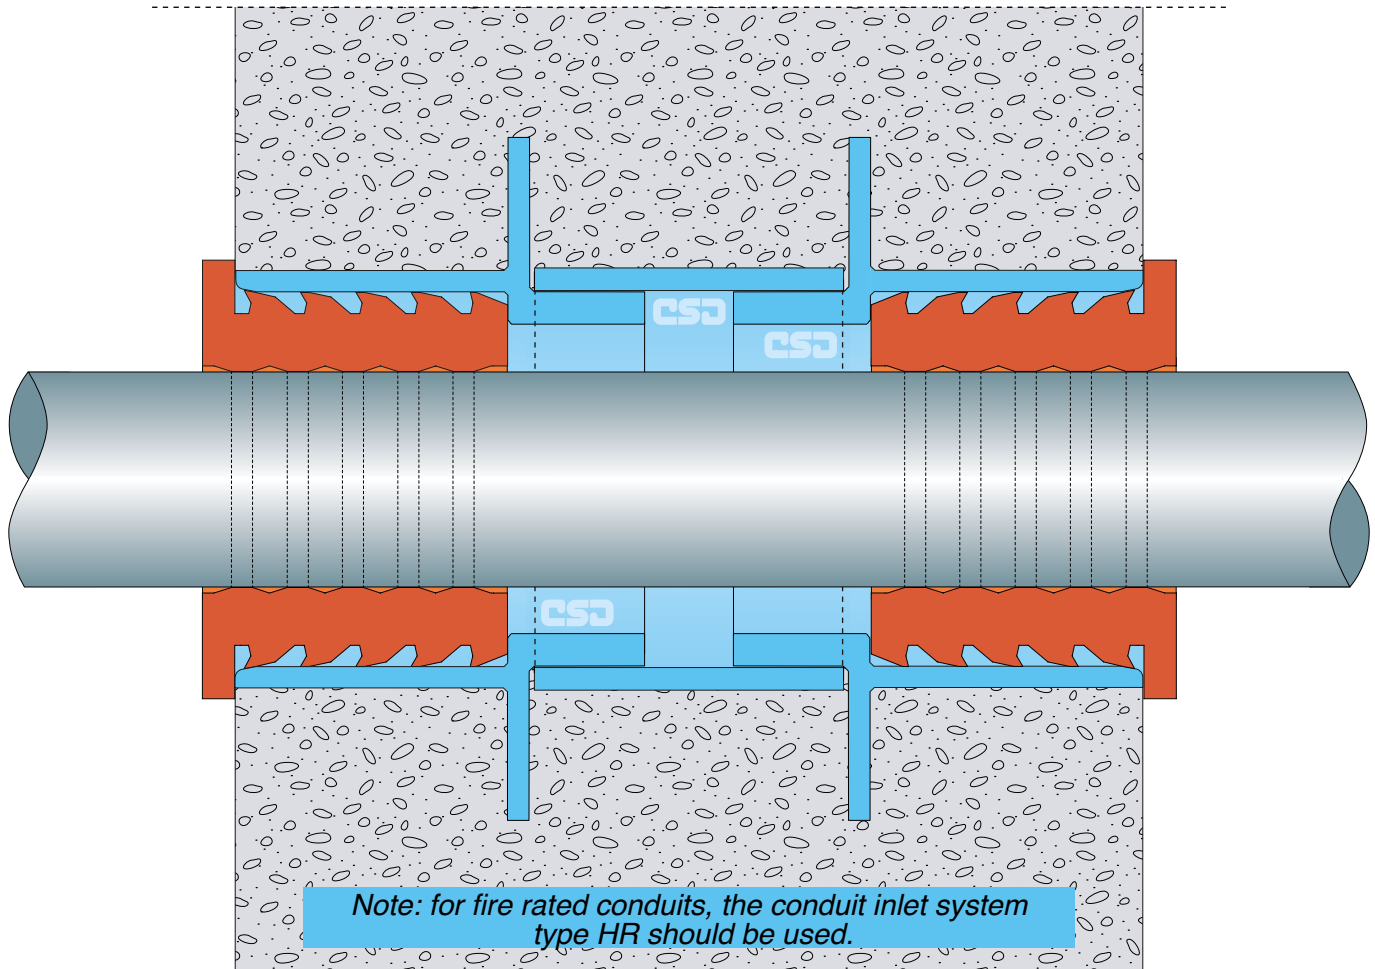


Optimized gas and water tightness is obtained by applying the SLIPSIL® sealing plugs in the CSD® embedded conduit inlet system or in the CSD® flanged conduit sleeves.

These offer optimum ease of installation, prevent any damage to the plugs during insertion and prevent the plugs from being inserted too deep into the conduit opening. The sealing plugs also can be used in holes bored with diamond-tipped drills. The tolerances of the drilled hole should be within the tolerances of the plug series.

For fire resistant seals, the sealing plugs must be installed always at each side of the conduit. For conduits which are required to be gas and water tight only, it is possible for a sealing plug to be installed at just one side of the conduit. However, for optimum sealing performance it is advisable always to install plugs at each side of the conduit. Care should be taken that the ducted cable/pipe is not passed through the conduit opening at an angle. For horizontal ducts, it is extremely important to support the pipes properly at both sides of the conduit.


The picture shows the settling of the profiling after insertion and the rounded off inlet opening of the CSD® conduit inlets. Optimum tightness guaranteed. The leveled outer profiles show that the contact surface with the conduit pipe could be further increased when smaller inner diameters should be used. The drawback however is less ease of installation. CSD® conduit inlets are made to nominal sizes.

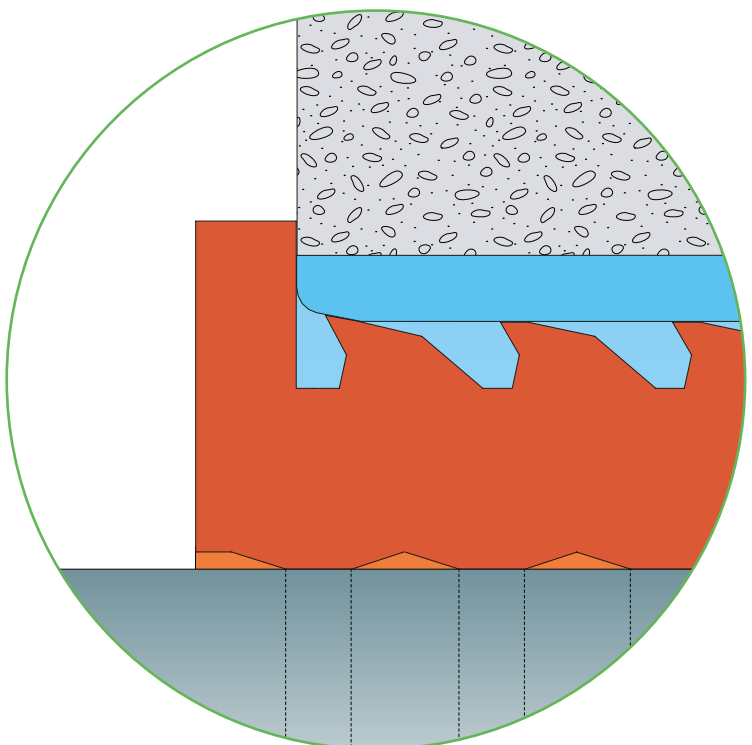




## SLIPSIL® EMBEDDED CONDUIT INLET SYSTEM FOR SLIPSIL® SEALING PLUGS

conduit inlet

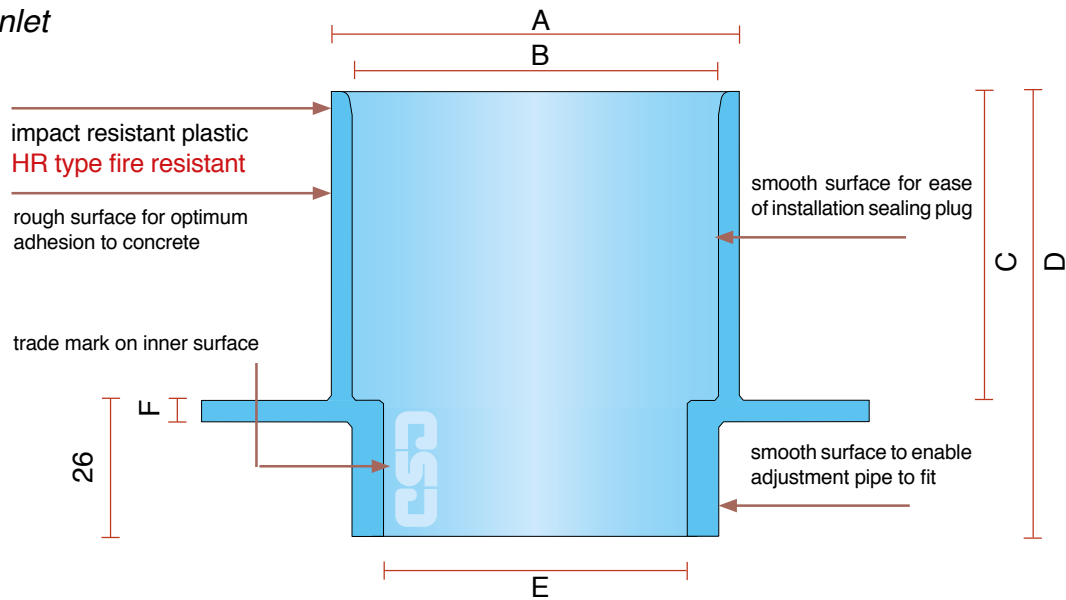

flange acts as a  
water barrier/fixation  
in concrete

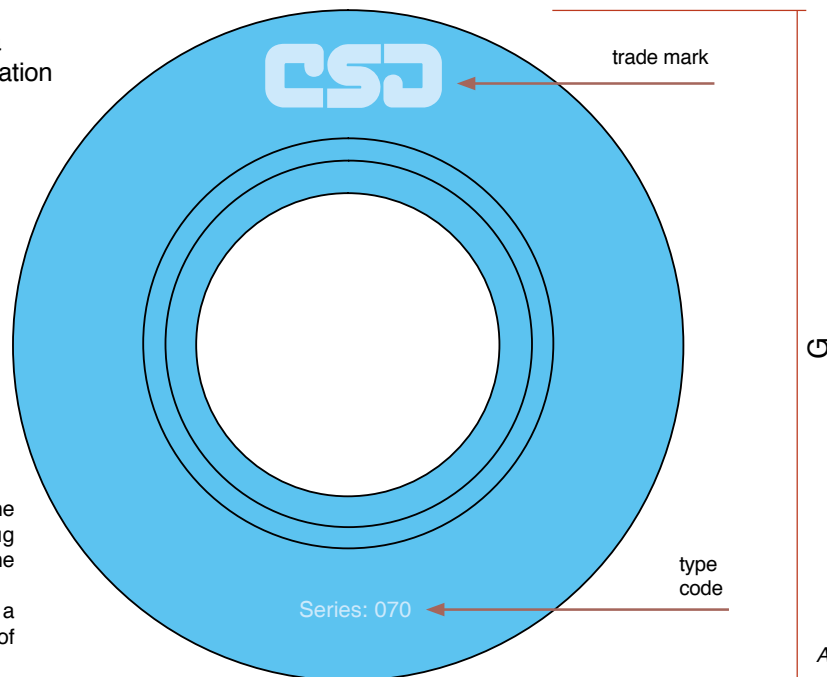

CSD® conduit inlet selected for the application of the SLIPSIL® plug series on the basis of the OD of the pipe/cable to be ducted. The back side of the inlet has a smooth surface fitting to the ID of the adjustment pipe.

FIRE CLASSIFICATION E 120/EI 120 ACCORDING TO THE  
NEWEST STANDARDS EN 13501-2:2007 + A1:2009 AND  
EN 15882-3:2009 AND TEST PROCEDURE EN 1366-3:2009


All dimensions in mm

type	A	B	C	D	E	F	G	plug-series	cable/ pipe OD	art. no.	art. no. HR
CSD 40 CI	48	40	47	73	28	4	88	40	5-22	60.9102	60.9202
CSD 50 CI	58	50	59	85	38	4	108	50	6-32	60.9103	60.9203
CSD 60 CI	68	60	59	85	48	4	118	60	14-40	60.9104	60.9204
CSD 70 CI	78	70	59	85	58	4	128	70	22-50	60.9105	60.9205
CSD 80 CI	88	80	59	85	68	4	138	80	28-60	60.9106	60.9206
CSD 100 CI	110	100	59	85	88	4	170	100	40-75	60.9107	60.9207
CSD 125 CI	135	125	59	85	113	4	195	125	60-92	60.9108	60.9208
CSD 160 CI	170	160	71	97	148	4	230	160	88-125	60.9109	60.9209
CSD 200 CI	210	200	71	97	188	4	290	200	110-160	60.9110	60.9210


## SLIPSIL® EMBEDDED CONDUIT INLET SYSTEM FOR SLIPSIL® SEALING PLUGS

type	A	B	C	art. no.	art. no. HR
CSD 40 AP	48	40	200	60.9122	60.9222
CSD 50 AP	58	50	200	60.9123	60.9223
CSD 60 AP	68	60	200	60.9124	60.9224
CSD 70 AP	78	70	200	60.9125	60.9225
CSD 80 AP	88	80	200	60.9126	60.9226
CSD 100 AP	110	100	200	60.9127	60.9227
CSD 125 AP	135	125	200	60.9128	60.9228
CSD 160 AP	170	160	200	60.9129	60.9229
CSD 200 AP	210	200	150	60.9130	60.9230



CSD® adjustment pipe cut to size to adjust the complete inlet set to the thickness of the form to cast the concrete.  
The CSD® adjustment pipe has a smooth inner surface fitting to the conduit inlets.

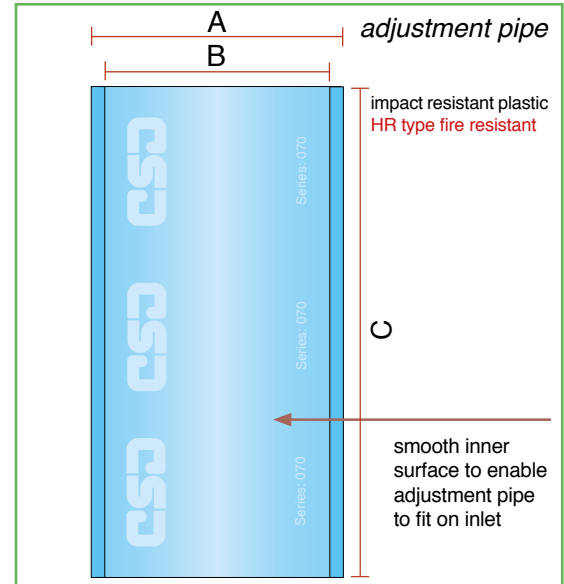

type	A	B	C	D	E	art. no.	art. no. HR
CSD 40 CP	48	40	48	28	4	60.9142	60.9242
CSD 50 CP	58	50	48	38	4	60.9143	60.9243
CSD 60 CP	68	60	48	48	4	60.9144	60.9244
CSD 70 CP	78	70	48	58	4	60.9145	60.9245
CSD 80 CP	88	80	48	68	4	60.9146	60.9246
CSD 100 CP	110	100	48	88	4	60.9147	60.9247
CSD 125 CP	135	125	48	113	4	60.9148	60.9248
CSD 160 CP	170	160	48	148	4	60.9149	60.9249
CSD 200 CP	210	200	48	188	4	60.9150	60.9250

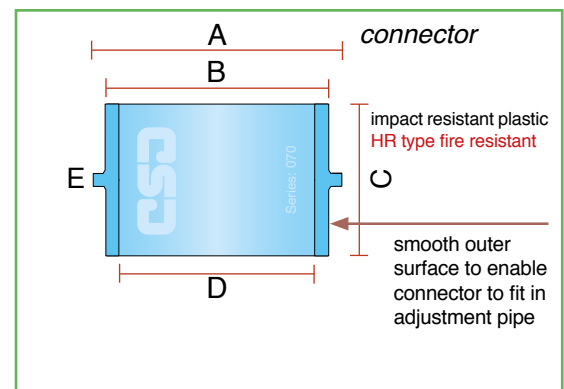


type	A	B	C	D	E	art. no.
CSD 40 FP	40	32	20	-	-	60.9162
CSD 50 FP	50	42	20	30	4	60.9163
CSD 60 FP	60	52	20	30	4	60.9164
CSD 70 FP	70	62	20	40	4	60.9165
CSD 80 FP	80	72	20	40	4	60.9166
CSD 100 FP	100	92	20	50	4	60.9167
CSD 125 FP	125	117	20	60	4	60.9168
CSD 160 FP	160	152	20	80	4	60.9169
CSD 200 FP	200	192	30	120	6	60.9170

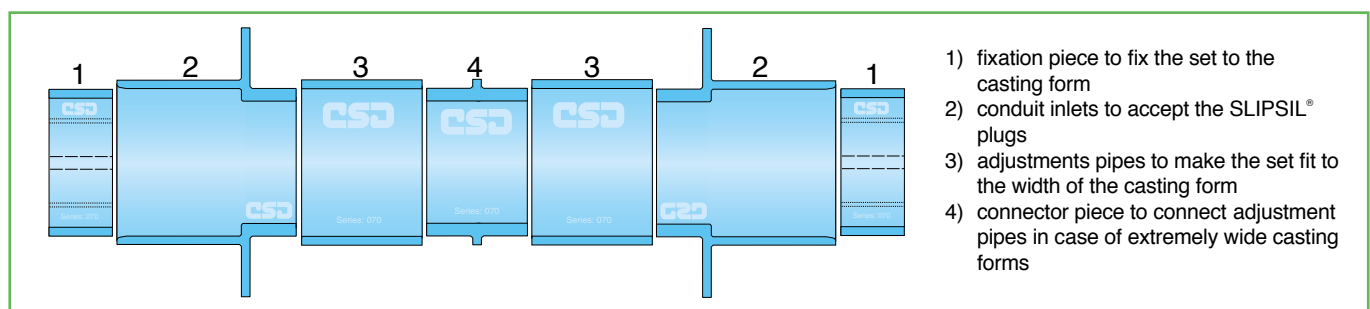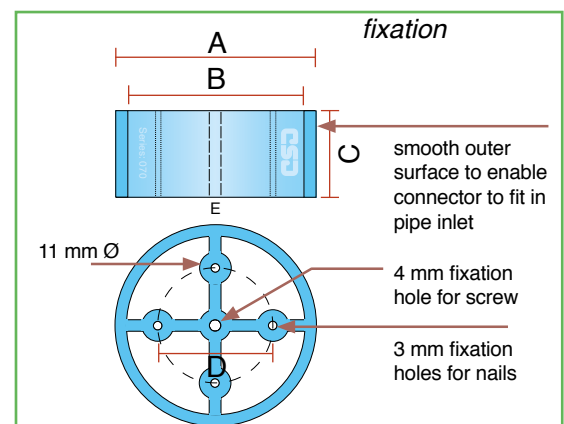







## SLIPSIL® EMBEDDED CONDUIT INLET SYSTEM FOR SLIPSIL® SEALING PLUGS

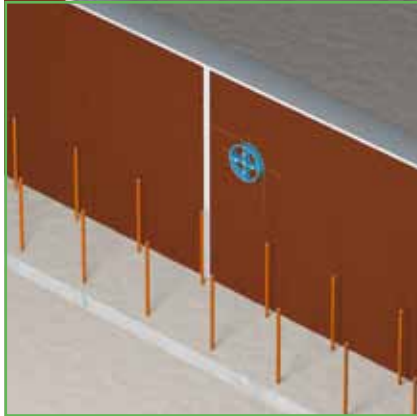

1) After marking off on the formwork, CSD® fixation pieces suitable for CSD® conduit inlets are fastened by means of nails or screws.

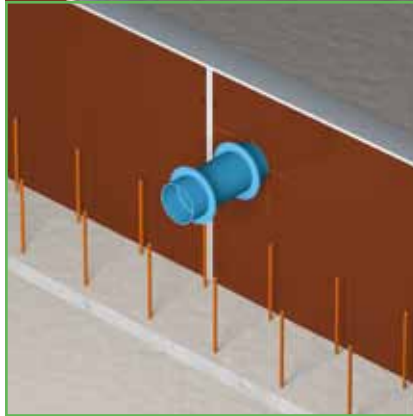


2) Adapt the CSD® embedded conduit inlet system to the width of the formwork by sawing the CSD® adjustment pipe to length in situ. Press the CSD® conduit inlets and adjustment pipe over the installed fixation piece.

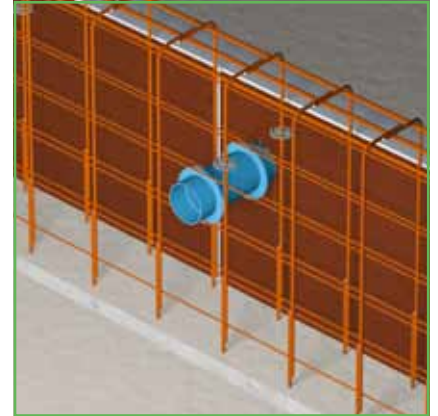


3) For very wide formwork, two or more CSD® adjustment pipes are used. The adjustment pipes are linked with the aid of CSD® connectors.




4) The CSD® embedded conduit inlet system must also be affixed to the formwork element on the other side using a fixation piece in order to obtain sufficient stability during the pouring of the concrete.

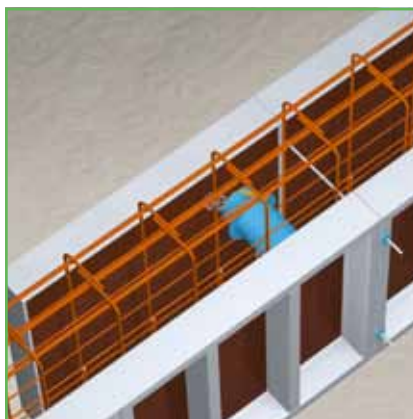

5) The formwork element is provisionally positioned so that the position of the CSD® fixation piece to be fitted can be marked off.

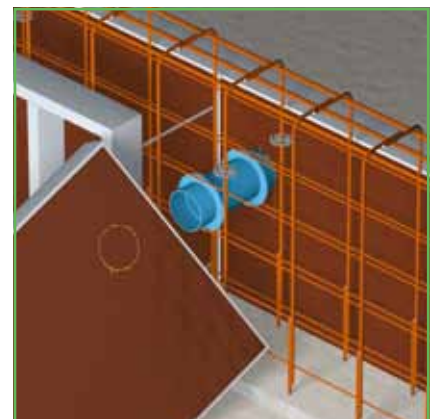

6) The formwork element is then removed so that the CSD® fixation piece can be affixed.

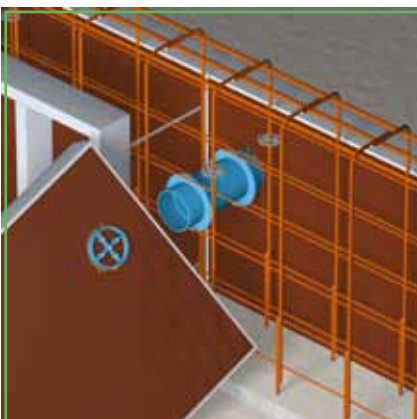

7) The CSD® fixation pieces are made to be a clamping fit for fixation in the CSD® conduit inlets for reasons of stability but also to prevent concrete running into the conduit inlets.




8) The flanges of the CSD® conduit inlets serve for fixation into the concrete and also act as a water barrier. The CSD® embedded conduit inlet system is made of impact-resistant plastic.




9) The CSD® fixation pieces that are affixed to the formwork can be re-used for subsequent projects.


## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

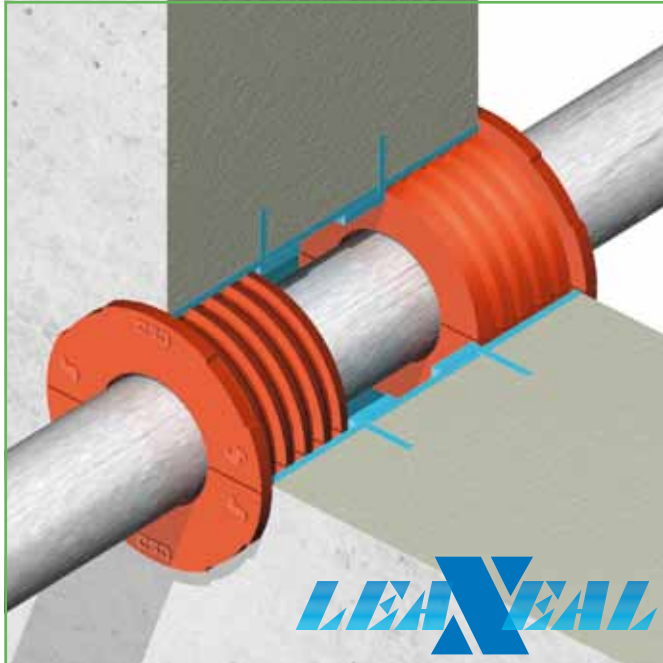


Several options are possible with the CSD® embedded conduit pipe system. Conduit inlets at both sides with an adjustment pipe in between the inlets to enable application of the SLIPSIL® plugs at both sides of the wall/floor.

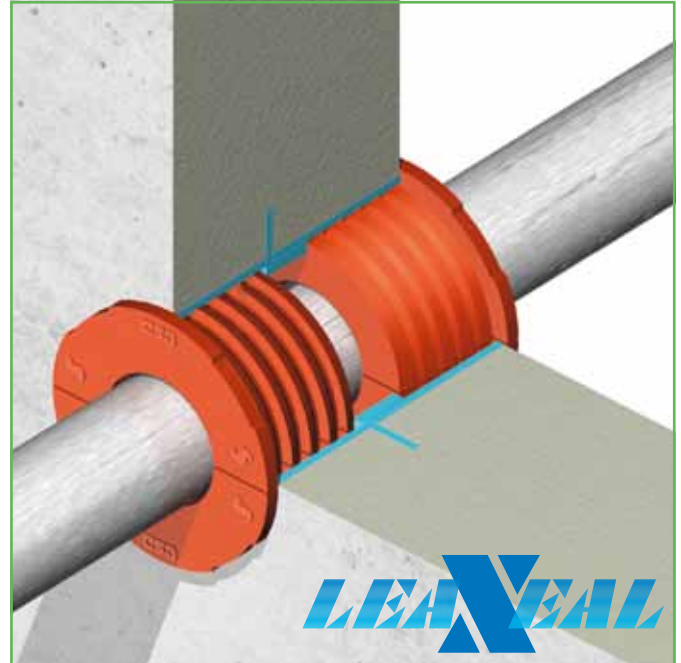

In cases of limited wall/floor thickness, a conduit inlet at the exposed side with a length of the adjustment pipe to be cast in. In this option the SLIPSIL® plugs can also be installed at both sides.

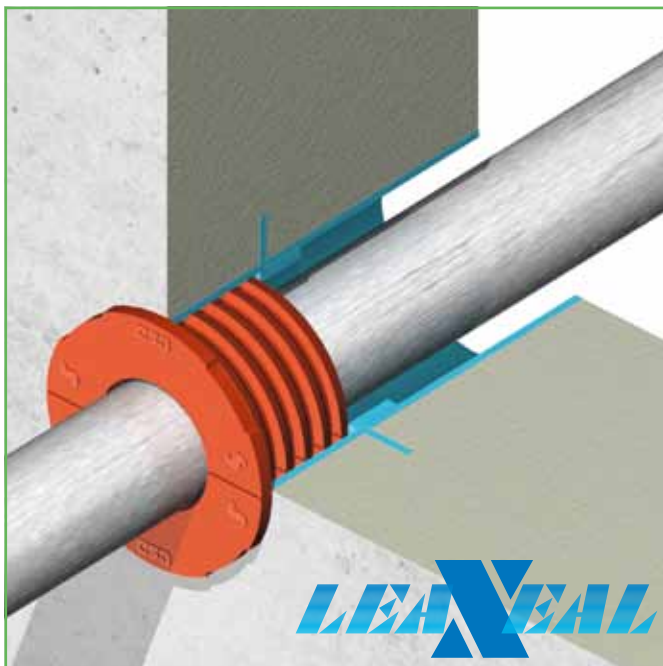

In cases where the required tightness is not excessive, a SLIPSIL® sealing plug can be installed at one side of the conduit. Only applicable in combination with CSD® embedded conduit pipe system. It is however advisable to apply the plugs always at both sides of the penetration.

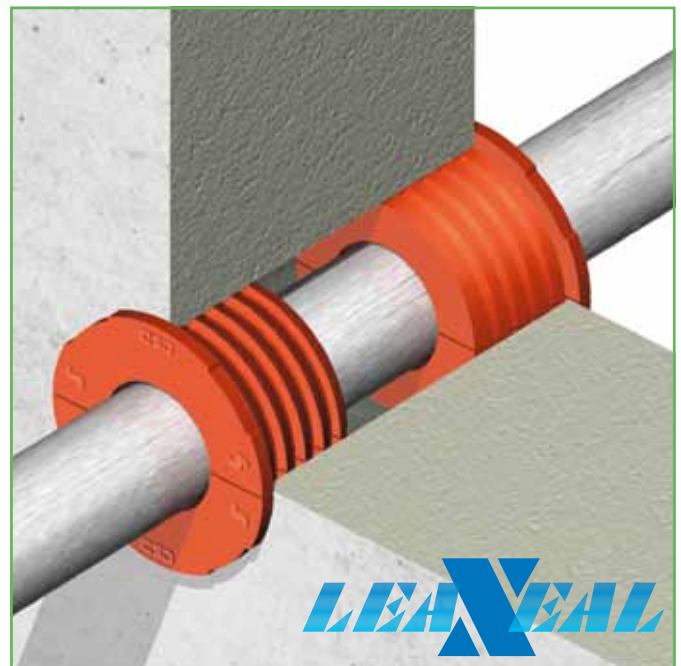

For fire rated penetrations, the CSD® embedded conduit pipe system cannot be used. In these cases steel conduit sleeves or drilled holes have to be utilized. For fire rated penetrations, the SLIPSIL® sealing plugs always have to be inserted in both ends of the conduit.



## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT



PLUG SERIES	CONDUIT SLEEVE	PLUG LENGTH	PIPE DIAMETER
25	24.5 - 25.6	54 -----	5 - 12
27	26.5 - 27.6	54	5 - 15
28	27.5 - 28.5	54	5 - 15
30	29.5 - 30.5	54	5 - 16
32	31.5 - 32.5	54	5 - 16
34	33.5 - 34.5	54	5 - 18
35	34.5 - 35.7	54	5 - 20
37	36.5 - 37.7	54	5 - 20
40	39.5 - 40.7	54	5 - 22
41	40.5 - 41.7	54	5 - 25
43	42.5 - 43.7	54	5 - 28
50	49.5 - 50.7	66	6 - 32
53	52.0 - 53.7	66	6 - 34
55	54.0 - 55.7	66	6 - 34
57	56.0 - 57.7	66	14 - 40
60	59.0 - 60.7	66	14 - 40
62	61.0 - 62.7	66	14 - 40
67	66.0 - 67.7	66	22 - 50
68	67.0 - 68.7	66	20 - 50
70	69.0 - 70.7	66	22 - 50
75	74.0 - 75.7	66	22 - 50
78	77.0 - 78.7	66	22 - 50
80	79.0 - 80.7	66	28 - 60
82	81.0 - 82.7	66	28 - 60
90	89.0 - 90.7	66	40 - 64
94	93.0 - 94.7	66	40 - 64
97	96.0 - 97.7	66	40 - 64
100	99.0 - 100.7	66	40 - 75
102	101.0 - 102.7	66	40 - 75
103	102.0 - 103.7	66	26 - 75
105	104.0 - 105.7	66	40 - 75
107	106.0 - 107.7	66	40 - 76
110	109.0 - 110.7	66	48 - 80
118	117.5 - 119.2	66	60 - 90
122	121.0 - 122.7	66	60 - 92
125	124.0 - 125.7	66	60 - 92
128	127.0 - 128.7	66	60 - 92
131	130.5 - 132.2	66	60 - 92
146	145.0 - 146.7	79 -----	88 - 120
150	149.0 - 150.7	79	88 - 125
152	151.0 - 152.7	79	88 - 125
154	153.0 - 154.7	79	88 - 125
156	155.0 - 156.7	79	88 - 125
160	159.0 - 160.7	79	88 - 125
190	189.0 - 190.7	79	110-160
200	199.0 - 200.7	79	110-160
203	202.0 - 203.7	79	110-168
207	206.0 - 207.7	79	110-168
250	249.0 - 250.7	91	160-200
260	259.0 - 260.7	91	160-219
300	299.0 - 300.7	91	160-250
339	338.5 - 340.2	91 -----	200-273

To select the right type of sealing plug, look for the plug series to be used on the basis of the outer diameter of the service pipe. Then make a choice for the plug type in the table of the selected plug series and the conduit inlet.

For instance: a copper pipe of 42 mm OD has to be ducted. Select the plug series on the basis of the ID of the conduit sleeve to be used and the OD of the ducted pipe (67 up to 107 can be your choice). When a CSD® conduit pipe inlet series 80 (ID = 80 mm) will be used a sealing plug 80/42-44 is the right choice. If a 54 mm OD copper pipe has to be ducted through a steel sleeve with an ID of 107.1 mm, plug type 107/54-56 has to be selected. See the tables of the series 80 and 107 on pages 13 and 14.

Note: the sealing plugs with a thin wall (like for instance 53/34) are not easy to install in undersized conduit openings. It is advisable to select a larger plug series (for instance 60/34-36).



## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
blind	25/0	40.0100	blind	34/0	40.0600	18-20	40/18-20	40.0915
5-6	25/5-6	40.0105	5-6	34/5-6	40.0605	20-21	40/20-21	40.0916
6-7	25/6-7	40.0106	6-7	34/6-7	40.0606	21-22	40/21-22	40.0917
7-8	25/7-8	40.0107	7-8	34/7-8	40.0607	22	40/22	40.0918
8-9	25/8-9	40.0108	8-9	34/8-9	40.0608	<i>40 multi is max. 2x10, 3x7, 5x7</i>		
9-10	25/9-10	40.0109	9-10	34/9-10	40.0609	blind	41/0	40.1000
10-11	25/10-11	40.0110	10-11	34/10-11	40.0610	5-6	41/5-6	40.1005
11-12	25/11-12	40.0111	11-12	34/11-12	40.0611	6-7	41/6-7	40.1006
12	25/12	40.0112	12-13	34/12-13	40.0612	7-8	41/7-8	40.1007
blind	27/0	40.0200	13-14	34/13-14	40.0613	8-9	41/8-9	40.1008
5-6	27/5-6	40.0205	14-15	34/14-15	40.0614	9-10	41/9-10	40.1009
6-7	27/6-7	40.0206	15-16	34/15-16	40.0615	10-11	41/10-11	40.1010
7-8	27/7-8	40.0207	16-17	34/16-17	40.0616	11-12	41/11-12	40.1011
8-9	27/8-9	40.0208	17-18	34/17-18	40.0617	12-14	41/12-14	40.1012
9-10	27/9-10	40.0209	18	34/18	40.0618	14-16	41/14-16	40.1013
10-11	27/10-11	40.0210	blind	35/0	40.0700	16-18	41/16-18	40.1014
11-12	27/11-12	40.0211	5-6	35/5-6	40.0705	18-20	41/18-20	40.1015
12-13	27/12-13	40.0212	6-7	35/6-7	40.0706	20-22	41/20-22	40.1016
13-14	27/13-14	40.0213	7-8	35/7-8	40.0707	22-23	41/22-23	40.1017
14-15	27/14-15	40.0214	8-9	35/8-9	40.0708	23-24	41/23-24	40.1018
15	27/15	40.0215	9-10	35/9-10	40.0709	24-25	41/24-25	40.1019
blind	28/0	40.0300	10-11	35/10-11	40.0710	25	41/25	40.1020
5-6	28/5-6	40.0305	11-12	35/11-12	40.0711	<i>41 multi is max. 2x10, 3x7, 5x7</i>		
6-7	28/6-7	40.0306	12-13	35/12-13	40.0712	blind	43/0	40.1100
7-8	28/7-8	40.0307	13-14	35/13-14	40.0713	5-6	43/5-6	40.1105
8-9	28/8-9	40.0308	14-15	35/14-15	40.0714	6-7	43/6-7	40.1106
9-10	28/9-10	40.0309	15-16	35/15-16	40.0715	7-8	43/7-8	40.1107
10-11	28/10-11	40.0310	16-17	35/16-17	40.0716	8-9	43/8-9	40.1108
11-12	28/11-12	40.0311	17-18	35/17-18	40.0717	9-10	43/9-10	40.1109
12-13	28/12-13	40.0312	18-19	35/18-19	40.0718	10-12	43/10-12	40.1110
13-14	28/13-14	40.0313	19-20	35/19-20	40.0719	12-14	43/12-14	40.1111
14-15	28/14-15	40.0314	20	35/20	40.0720	14-16	43/14-16	40.1112
15	28/15	40.0315	blind	37/0	40.0800	16-18	43/16-18	40.1113
blind	30/0	40.0400	5-6	37/5-6	40.0805	18-20	43/18-20	40.1114
5-6	30/5-6	40.0405	6-7	37/6-7	40.0806	20-22	43/20-22	40.1115
6-7	30/6-7	40.0406	7-8	37/7-8	40.0807	22-24	43/22-24	40.1116
7-8	30/7-8	40.0407	8-9	37/8-9	40.0808	24-25	43/24-25	40.1117
8-9	30/8-9	40.0408	9-10	37/9-10	40.0809	25-26	43/25-26	40.1118
9-10	30/9-10	40.0409	10-11	37/10-11	40.0810	26-27	43/26-27	40.1119
10-11	30/10-11	40.0410	11-12	37/11-12	40.0811	27-28	43/27-28	40.1120
11-12	30/11-12	40.0411	12-13	37/12-13	40.0812	28	43/28	40.1121
12-13	30/12-13	40.0412	13-14	37/13-14	40.0813	<i>43 multi is max. 2x10, 3x7, 5x7</i>		
13-14	30/13-14	40.0413	14-15	37/14-15	40.0814	blind	50/0	40.1200
14-15	30/14-15	40.0414	15-16	37/15-16	40.0815	6-7	50/6-7	40.1205
15-16	30/15-16	40.0415	16-17	37/16-17	40.0816	7-8	50/7-8	40.1206
16	30/16	40.0416	17-18	37/17-18	40.0817	8-9	50/8-9	40.1207
blind	32/0	40.0500	18-19	37/18-19	40.0818	9-10	50/9-10	40.1208
5-6	32/5-6	40.0505	19-20	37/19-20	40.0819	10-12	50/10-12	40.1209
6-7	32/6-7	40.0506	20	37/20	40.0820	12-14	50/12-14	40.1210
7-8	32/7-8	40.0507	blind	40/0	40.0900	14-16	50/14-16	40.1211
8-9	32/8-9	40.0508	5-6	40/5-6	40.0905	16-18	50/16-18	40.1212
9-10	32/9-10	40.0509	6-7	40/6-7	40.0906	18-20	50/18-20	40.1213
10-11	32/10-11	40.0510	7-8	40/7-8	40.0907	20-22	50/20-22	40.1214
11-12	32/11-12	40.0511	8-9	40/8-9	40.0908	22-24	50/22-24	40.1215
12-13	32/12-13	40.0512	9-10	40/9-10	40.0909	24-26	50/24-26	40.1216
13-14	32/13-14	40.0513	10-11	40/10-11	40.0910	26-28	50/26-28	40.1217
14-15	32/14-15	40.0514	11-12	40/11-12	40.0911	28-29	50/28-29	40.1218
15-16	32/15-16	40.0515	12-14	40/12-14	40.0912	29-30	50/29-30	40.1219
16	32/16	40.0516	14-16	40/14-16	40.0913	30-31	50/30-31	40.1220
			16-18	40/16-18	40.0914	31-32	50/31-32	40.1221



## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
32	50/32	40.1222	40	57/40	40.1526	30-32	68/30-32	40.1919
	<i>50 multi is max. 2x15, 3x8, 5x8</i>					32-34	68/32-34	40.1920
blind	53/0	40.1300	blind	60/0	40.1600	34-36	68/34-36	40.1921
6-7	53/6-7	40.1305	14-16	60/14-16	40.1611	36-38	68/36-38	40.1922
7-8	53/7-8	40.1306	16-18	60/16-18	40.1612	38-40	68/38-40	40.1923
8-9	53/8-9	40.1307	18-20	60/18-20	40.1613	40-42	68/40-42	40.1924
9-10	53/9-10	40.1308	20-22	60/20-22	40.1614	42-44	68/42-44	40.1925
10-12	53/10-12	40.1309	22-24	60/22-24	40.1615	44-46	68/44-46	40.1926
12-14	53/12-14	40.1310	24-26	60/24-26	40.1616	46-48	68/46-48	40.1927
14-16	53/14-16	40.1311	26-28	60/26-28	40.1617	48-50	68/48-50	40.1928
16-18	53/16-18	40.1312	28-30	60/28-30	40.1618	50	68/50	40.1929
18-20	53/18-20	40.1313	30-32	60/30-32	40.1619		<i>68 multi is max. 2x22, 3x12, 5x12</i>	
20-22	53/20-22	40.1314	32-34	60/32-34	40.1620	blind	70/0	40.2000
22-24	53/22-24	40.1315	34-36	60/34-36	40.1621	20-22	70/20-22	40.2014
24-26	53/24-26	40.1316	36-37	60/36-37	40.1622	22-24	70/22-24	40.2015
26-28	53/26-28	40.1317	37-38	60/37-38	40.1623	24-26	70/24-26	40.2016
28-30	53/28-30	40.1318	38-39	60/38-39	40.1624	26-28	70/26-28	40.2017
30-31	53/30-31	40.1319	39-40	60/39-40	40.1625	28-30	70/28-30	40.2018
31-32	53/31-32	40.1320	40	60/40	40.1626	30-32	70/30-32	40.2019
32-33	53/32-33	40.1321		<i>60 multi is max. 2x15, 3x10</i>		32-34	70/32-34	40.2020
33-34	53/33-34	40.1322	blind	62/0	40.1700	34-36	70/34-36	40.2021
34	53/34	40.1323	14-16	62/14-16	40.1711	36-38	70/36-38	40.2022
	<i>53 multi is max. 2x15, 3x10, 5x10</i>		16-18	62/16-18	40.1712	38-40	70/38-40	40.2023
blind	55/0	40.1400	18-20	62/18-20	40.1713	40-42	70/40-42	40.2024
6-7	55/6-7	40.1405	20-22	62/20-22	40.1714	42-44	70/42-44	40.2025
7-8	55/7-8	40.1406	22-24	62/22-24	40.1715	44-46	70/44-46	40.2026
8-9	55/8-9	40.1407	24-26	62/24-26	40.1716	46-48	70/46-48	40.2027
9-10	55/9-10	40.1408	26-28	62/26-28	40.1717	48-50	70/48-50	40.2028
10-12	55/10-12	40.1409	28-30	62/28-30	40.1718	50	70/50	40.2029
12-14	55/12-14	40.1410	30-32	62/30-32	40.1719		<i>70 multi is max. 2x22, 3x12</i>	
14-16	55/14-16	40.1411	32-34	62/32-34	40.1720	blind	75/0	40.2100
16-18	55/16-18	40.1412	34-36	62/34-36	40.1721	22-24	75/22-24	40.2115
18-20	55/18-20	40.1413	36-37	62/36-37	40.1722	24-26	75/24-26	40.2116
20-22	55/20-22	40.1414	37-38	62/37-38	40.1723	26-28	75/26-28	40.2117
22-24	55/22-24	40.1415	38-39	62/38-39	40.1724	28-30	75/28-30	40.2118
24-26	55/24-26	40.1416	39-40	62/39-40	40.1725	30-32	75/30-32	40.2119
26-28	55/26-28	40.1417	40	62/40	40.1726	32-34	75/32-34	40.2120
28-30	55/28-30	40.1418		<i>62 multi is max. 2x15, 3x10</i>		34-36	75/34-36	40.2121
30-31	55/30-31	40.1419	blind	67/0	40.1800	36-38	75/36-38	40.2122
31-32	55/31-32	40.1420	22-24	67/22-24	40.1815	38-40	75/38-40	40.2123
32-33	55/32-33	40.1421	24-26	67/24-26	40.1816	40-42	75/40-42	40.2124
33-34	55/33-34	40.1422	26-28	67/26-28	40.1817	42-44	75/42-44	40.2125
34	55/34	40.1423	28-30	67/28-30	40.1818	44-46	75/44-46	40.2126
	<i>55 multi is max. 2x15, 3x10, 5x10</i>		30-32	67/30-32	40.1819	46-48	75/46-48	40.2127
blind	57/0	40.1500	32-34	67/32-34	40.1820	48-50	75/48-50	40.2128
14-16	57/14-16	40.1511	34-36	67/34-36	40.1821	50	75/50	40.2129
16-18	57/16-18	40.1512	36-38	67/36-38	40.1822	blind	78/0	40.2200
18-20	57/18-20	40.1513	38-40	67/38-40	40.1823	22-24	78/22-24	40.2215
20-22	57/20-22	40.1514	40-42	67/40-42	40.1824	24-26	78/24-26	40.2216
22-24	57/22-24	40.1515	42-44	67/42-44	40.1825	26-28	78/26-28	40.2217
24-26	57/24-26	40.1516	44-46	67/44-46	40.1826	28-30	78/28-30	40.2218
26-28	57/26-28	40.1517	46-48	67/46-48	40.1827	30-32	78/30-32	40.2219
28-30	57/28-30	40.1518	48-50	67/48-50	40.1828	32-34	78/32-34	40.2220
30-32	57/30-32	40.1519	50	67/50	40.1829	34-36	78/34-36	40.2221
32-34	57/32-34	40.1520	blind	68/0	40.1900	36-38	78/36-38	40.2222
34-36	57/34-36	40.1521	20-22	68/20-22	40.1914	38-40	78/38-40	40.2223
36-37	57/36-37	40.1522	22-24	68/22-24	40.1915	40-42	78/40-42	40.2224
37-38	57/37-38	40.1523	24-26	68/24-26	40.1916	42-44	78/42-44	40.2225
38-39	57/38-39	40.1524	26-28	68/26-28	40.1917	44-46	78/44-46	40.2226
39-40	57/39-40	40.1525	28-30	68/28-30	40.1918	46-48	78/46-48	40.2227

## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
48-50	78/48-50	40.2228	blind	94/0	40.2600	62-64	102/62-64	40.2931
50-52	78/50-52	40.2229	40-42	94/40-42	40.2620	64-66	102/64-66	40.2932
52-53	78/52-53	40.2230	42-44	94/42-44	40.2621	66-68	102/66-68	40.2933
53-54	78/53-54	40.2231	44-46	94/44-46	40.2622	68-70	102/68-70	40.2934
54	78/54	40.2232	46-48	94/46-48	40.2623	70-72	102/70-72	40.2935
<i>78 multi is max. 2x22, 3x15, 5x15</i>			48-50	94/48-50	40.2624	72-74	102/72-74	40.2936
blind	80/0	40.2300	50-52	94/50-52	40.2625	74-75	102/74-75	40.2937
28-30	80/28-30	40.2318	52-54	94/52-54	40.2626	75	102/75	40.2938
30-32	80/30-32	40.2319	54-56	94/54-56	40.2627	blind	103/0	40.3000
32-34	80/32-34	40.2320	56-58	94/56-58	40.2628	26-28	103/26-28	40.3013
34-36	80/34-36	40.2321	58-60	94/58-60	40.2629	28-30	103/28-30	40.3014
36-38	80/36-38	40.2322	60-62	94/60-62	40.2630	32-34	103/32-34	40.3016
38-40	80/38-40	40.2323	62-64	94/62-64	40.2631	40-42	103/40-42	40.3020
40-42	80/40-42	40.2324	64	94/64	40.2632	42-44	103/42-44	40.3021
42-44	80/42-44	40.2325	blind	97/0	40.2700	44-46	103/44-46	40.3022
44-46	80/44-46	40.2326	40-42	97/40-42	40.2720	46-48	103/46-48	40.3023
46-48	80/46-48	40.2327	42-44	97/42-44	40.2721	48-50	103/48-50	40.3024
48-50	80/48-50	40.2328	44-46	97/44-46	40.2722	50-52	103/50-52	40.3025
50-52	80/50-52	40.2329	46-48	97/46-48	40.2723	52-54	103/52-54	40.3026
52-54	80/52-54	40.2330	48-50	97/48-50	40.2724	54-56	103/54-56	40.3027
54-56	80/54-56	40.2331	50-52	97/50-52	40.2725	56-58	103/56-58	40.3028
56-58	80/56-58	40.2332	52-54	97/52-54	40.2726	58-60	103/58-60	40.3029
58-60	80/58-60	40.2333	54-56	97/54-56	40.2727	60-62	103/60-62	40.3030
60	80/60	40.2334	56-58	97/56-58	40.2728	62-64	103/62-64	40.3031
<i>80 multi is max. 2x22, 3x15, 5x15</i>			58-60	97/58-60	40.2729	64-66	103/64-66	40.3032
blind	82/0	40.2400	60-62	97/60-62	40.2730	66-68	103/66-68	40.3033
28-30	82/28-30	40.2418	62-64	97/62-64	40.2731	68-70	103/68-70	40.3034
30-32	82/30-32	40.2419	64	97/64	40.2732	70-72	103/70-72	40.3035
32-34	82/32-34	40.2420	blind	100/0	40.2800	72-74	103/72-74	40.3036
34-36	82/34-36	40.2421	40-42	100/40-42	40.2820	74-75	103/74-75	40.3037
36-38	82/36-38	40.2422	42-44	100/42-44	40.2821	75	103/75	40.3038
38-40	82/38-40	40.2423	44-46	100/44-46	40.2822	blind	105/0	40.3100
40-42	82/40-42	40.2424	46-48	100/46-48	40.2823	40-42	105/40-42	40.3120
42-44	82/42-44	40.2425	48-50	100/48-50	40.2824	42-44	105/42-44	40.3121
44-46	82/44-46	40.2426	50-52	100/50-52	40.2825	44-46	105/44-46	40.3122
46-48	82/46-48	40.2427	52-54	100/52-54	40.2826	46-48	105/46-48	40.3123
48-50	82/48-50	40.2428	54-56	100/54-56	40.2827	48-50	105/48-50	40.3124
50-52	82/50-52	40.2429	56-58	100/56-58	40.2828	50-52	105/50-52	40.3125
52-54	82/52-54	40.2430	58-60	100/58-60	40.2829	52-54	105/52-54	40.3126
54-56	82/54-56	40.2431	60-62	100/60-62	40.2830	54-56	105/54-56	40.3127
56-58	82/56-58	40.2432	62-64	100/62-64	40.2831	56-58	105/56-58	40.3128
58-60	82/58-60	40.2433	64-66	100/64-66	40.2832	58-60	105/58-60	40.3129
60	82/60	40.2434	66-68	100/66-68	40.2833	60-62	105/60-62	40.3130
<i>82 multi is max. 2x22, 3x15, 5x15</i>			68-70	100/68-70	40.2834	62-64	105/62-64	40.3131
blind	90/0	40.2500	70-72	100/70-72	40.2835	64-66	105/64-66	40.3132
40-42	90/40-42	40.2520	72-74	100/72-74	40.2836	66-68	105/66-68	40.3133
42-44	90/42-44	40.2521	74-75	100/74-75	40.2837	68-70	105/68-70	40.3134
44-46	90/44-46	40.2522	75	100/75	40.2838	70-72	105/70-72	40.3135
46-48	90/46-48	40.2523	blind	102/0	40.2900	72-74	105/72-74	40.3136
48-50	90/48-50	40.2524	40-42	102/40-42	40.2920	74-75	105/74-75	40.3137
50-52	90/50-52	40.2525	42-44	102/42-44	40.2921	75	105/75	40.3138
52-54	90/52-54	40.2526	44-46	102/44-46	40.2922	blind	107/0	40.3200
54-56	90/54-56	40.2527	46-48	102/46-48	40.2923	40-42	107/40-42	40.3220
56-58	90/56-58	40.2528	48-50	102/48-50	40.2924	42-44	107/42-44	40.3221
58-60	90/58-60	40.2529	50-52	102/50-52	40.2925	44-46	107/44-46	40.3222
60-62	90/60-62	40.2530	52-54	102/52-54	40.2926	46-48	107/46-48	40.3223
62-64	90/62-64	40.2531	54-56	102/54-56	40.2927	48-50	107/48-50	40.3224
64	90/64	40.2532	56-58	102/56-58	40.2928	50-52	107/50-52	40.3225
<i>90 multi is max. 2x25, 3x15</i>			58-60	102/58-60	40.2929	52-54	107/52-54	40.3226
			60-62	102/60-62	40.2930			









## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
54-56	107/54-56	40.3227	82-84	122/82-84	40.3541	blind	146/0	40.3900
56-58	107/56-58	40.3228	84-86	122/84-86	40.3542	88-90	146/88-90	40.3920
58-60	107/58-60	40.3229	86-88	122/86-88	40.3543	90-92	146/90-92	40.3921
60-62	107/60-62	40.3230	88-90	122/88-90	40.3544	92-94	146/92-94	40.3922
62-64	107/62-64	40.3231	90-92	122/90-92	40.3545	94-96	146/94-96	40.3923
64-66	107/64-66	40.3232	92	122/92	40.3546	96-98	146/96-98	40.3924
66-68	107/66-68	40.3233				98-100	146/98-100	40.3925
68-70	107/68-70	40.3234	blind	125/0	40.3600	100-102	146/100-102	40.3926
70-72	107/70-72	40.3235	60-62	125/60-62	40.3630	102-104	146/102-104	40.3927
72-74	107/72-74	40.3236	62-64	125/62-64	40.3631	104-106	146/104-106	40.3928
74-75	107/74-75	40.3237	64-66	125/64-66	40.3632	106-108	146/106-108	40.3929
75-76	107/75-76	40.3238	66-68	125/66-68	40.3633	108-110	146/108-110	40.3930
76	107/76	40.3239	68-70	125/68-70	40.3634	110-112	146/110-112	40.3931
			70-72	125/70-72	40.3635	112-114	146/112-114	40.3932
blind	110/0	40.3300	72-74	125/72-74	40.3636	114-116	146/114-116	40.3933
48-50	110/48-50	40.3324	74-76	125/74-76	40.3637	116-118	146/116-118	40.3934
50-52	110/50-52	40.3325	76-78	125/76-78	40.3638	118-120	146/118-120	40.3935
52-54	110/52-54	40.3326	78-80	125/78-80	40.3639	120	146/120	40.3936
54-56	110/54-56	40.3327	80-82	125/80-82	40.3640			
56-58	110/56-58	40.3328	82-84	125/82-84	40.3641	blind	150/0	40.4000
58-60	110/58-60	40.3329	84-86	125/84-86	40.3642	88-90	150/88-90	40.4020
60-62	110/60-62	40.3330	86-88	125/86-88	40.3643	90-92	150/90-92	40.4021
62-64	110/62-64	40.3331	88-90	125/88-90	40.3644	92-94	150/92-94	40.4022
64-66	110/64-66	40.3332	90-92	125/90-92	40.3645	94-96	150/94-96	40.4023
66-68	110/66-68	40.3333	92	125/92	40.3646	96-98	150/96-98	40.4024
68-70	110/68-70	40.3334	100	125/100	40.3650	98-100	150/98-100	40.4025
70-72	110/70-72	40.3335				100-102	150/100-102	40.4026
72-74	110/72-74	40.3336	blind	128/0	40.3700	102-104	150/102-104	40.4027
74-76	110/74-76	40.3337	60-62	128/60-62	40.3730	104-106	150/104-106	40.4028
76-78	110/76-78	40.3338	62-64	128/62-64	40.3731	106-108	150/106-108	40.4029
78-80	110/78-80	40.3339	64-66	128/64-66	40.3732	108-110	150/108-110	40.4030
80	110/80	40.3340	66-68	128/66-68	40.3733	110-112	150/110-112	40.4031
			68-70	128/68-70	40.3734	112-114	150/112-114	40.4032
blind	118/0	40.3400	70-72	128/70-72	40.3735	114-116	150/114-116	40.4033
60-62	118/60-62	40.3430	72-74	128/72-74	40.3736	116-118	150/116-118	40.4034
62-64	118/62-64	40.3431	74-76	128/74-76	40.3737	118-120	150/118-120	40.4035
64-66	118/64-66	40.3432	76-78	128/76-78	40.3738	120-122	150/120-122	40.4036
66-68	118/66-68	40.3433	78-80	128/78-80	40.3739	122-124	150/122-124	40.4037
68-70	118/68-70	40.3434	80-82	128/80-82	40.3740	124-125	150/124-125	40.4038
70-72	118/70-72	40.3435	82-84	128/82-84	40.3741	125	150/125	40.4039
72-74	118/72-74	40.3436	84-86	128/84-86	40.3742			
74-76	118/74-76	40.3437	86-88	128/86-88	40.3743	blind	152/0	40.4100
76-78	118/76-78	40.3438	88-90	128/88-90	40.3744	88-90	152/88-90	40.4120
78-80	118/78-80	40.3439	90-92	128/90-92	40.3745	90-92	152/90-92	40.4121
80-82	118/80-82	40.3440	92	128/92	40.3746	92-94	152/92-94	40.4122
82-84	118/82-84	40.3441				94-96	152/94-96	40.4123
84-86	118/84-86	40.3442	blind	131/0	40.3800	96-98	152/96-98	40.4124
86-88	118/86-88	40.3443	60-62	131/60-62	40.3830	98-100	152/98-100	40.4125
88-90	118/88-90	40.3444	62-64	131/62-64	40.3831	100-102	152/100-102	40.4126
90	118/90	40.3445	64-66	131/64-66	40.3832	102-104	152/102-104	40.4127
			66-68	131/66-68	40.3833	104-106	152/104-106	40.4128
blind	122/0	40.3500	68-70	131/68-70	40.3834	106-108	152/106-108	40.4129
60-62	122/60-62	40.3530	70-72	131/70-72	40.3835	108-110	152/108-110	40.4130
62-64	122/62-64	40.3531	72-74	131/72-74	40.3836	110-112	152/110-112	40.4131
64-66	122/64-66	40.3532	74-76	131/74-76	40.3837	112-114	152/112-114	40.4132
66-68	122/66-68	40.3533	76-78	131/76-78	40.3838	114-116	152/114-116	40.4133
68-70	122/68-70	40.3534	78-80	131/78-80	40.3839	116-118	152/116-118	40.4134
70-72	122/70-72	40.3535	80-82	131/80-82	40.3840	118-120	152/118-120	40.4135
72-74	122/72-74	40.3536	82-84	131/82-84	40.3841	120-122	152/120-122	40.4136
74-76	122/74-76	40.3537	84-86	131/84-86	40.3842	122-124	152/122-124	40.4137
76-78	122/76-78	40.3538	86-88	131/86-88	40.3843	124-125	152/124-125	40.4138
78-80	122/78-80	40.3539	88-90	131/88-90	40.3844	125	152/125	40.4139
80-82	122/80-82	40.3540	90-92	131/90-92	40.3845			
			92	131/92	40.3846			

## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	multi-sealing plugs for 2, 3 or 5 same diameter cables/pipes
blind	154/0	40.4200	124-125	160/124-125	40.4438	 <p>type code: series/2xcable diameter For instance 40/2x6-7</p>
88-90	154/88-90	40.4220	125	160/125	40.4439	
90-92	154/90-92	40.4221	blind	190/0	40.4500	
92-94	154/92-94	40.4222	110-112	190/110	40.4520	 <p>type code: series/3xcable diameter For instance 40/3x6-7</p>
94-96	154/94-96	40.4223	114-116	190/114	40.4523	
96-98	154/96-98	40.4224	125-127	190/125	40.4528	
98-100	154/98-100	40.4225	139-141	190/139	40.4533	 <p>type code: series/5xcable diameter For instance 40/5x6-7</p>
100-102	154/100-102	40.4226	142-144	190/142	40.4534	
102-104	154/102-104	40.4227	150-152	190/150	40.4538	
104-106	154/104-106	40.4228	153-155	190/153	40.4541	 <p>type code: series/5xcable diameter For instance 40/5x6-7</p>
106-108	154/106-108	40.4229	159-161	190/159	40.4543	
108-110	154/108-110	40.4230	blind	200/0	40.4600	
110-112	154/110-112	40.4231	110-112	200/110	40.4620	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
112-114	154/112-114	40.4232	114-116	200/114	40.4623	
114-116	154/114-116	40.4233	120-122	200/120	40.4626	
116-118	154/116-118	40.4234	122-124	200/122	40.4627	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
118-120	154/118-120	40.4235	125-127	200/125	40.4628	
120-122	154/120-122	40.4236	133-135	200/133	40.4631	
122-124	154/122-124	40.4237	135-137	200/135	40.4632	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
124-125	154/124-125	40.4238	139-141	200/139	40.4633	
125	154/125	40.4239	141-143	200/141	40.4634	
blind	156/0	40.4300	159-160	200/159	40.4643	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
88-90	156/88-90	40.4320	160	200/160	40.4644	
90-92	156/90-92	40.4321	blind	203/0	40.4700	
92-94	156/92-94	40.4322	110-112	203/110	40.4720	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
94-96	156/94-96	40.4323	114-116	203/114	40.4723	
96-98	156/96-98	40.4324	125-127	203/125	40.4728	
98-100	156/98-100	40.4325	133-135	203/133	40.4731	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
100-102	156/100-102	40.4326	139-141	203/139	40.4733	
102-104	156/102-104	40.4327	141-143	203/141	40.4734	
104-106	156/104-106	40.4328	159-161	203/159	40.4743	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
106-108	156/106-108	40.4329	162-164	200/162	40.4744	
108-110	156/108-110	40.4330	168-170	203/168	40.4748	
110-112	156/110-112	40.4331	blind	207/0	40.4800	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
112-114	156/112-114	40.4332	110-112	207/110	40.4820	
114-116	156/114-116	40.4333	114-116	207/114	40.4823	
116-118	156/116-118	40.4334	125-127	207/125	40.4828	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
118-120	156/118-120	40.4335	129-131	207/129	40.4829	
120-122	156/120-122	40.4336	133-135	207/133	40.4831	
122-124	156/122-124	40.4337	139-141	207/139	40.4833	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
124-125	156/124-125	40.4338	156-158	207/156	40.4842	
125	156/125	40.4339	159-161	207/159	40.4843	
blind	160/0	40.4400	168-170	207/168	40.4848	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
88-90	160/88-90	40.4420	160	250/160	40.5010	
90-92	160/90-92	40.4421	168	250/168	40.5014	
92-94	160/92-94	40.4422	171	250/171	40.5015	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
94-96	160/94-96	40.4423	180	250/180	40.5020	
96-98	160/96-98	40.4424	200	250/200	40.5030	
98-100	160/98-100	40.4425	160	260/160	40.5210	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
100-102	160/100-102	40.4426	168	260/168	40.5214	
102-104	160/102-104	40.4427	200	260/200	40.5230	
104-106	160/104-106	40.4428	204	260/204	40.5232	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
106-108	160/106-108	40.4429	219	260/219	40.5239	
108-110	160/108-110	40.4430	200	300/200	40.5321	
110-112	160/110-112	40.4431	219	300/219	40.5330	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
112-114	160/112-114	40.4432	225	300/225	40.5333	
114-116	160/114-116	40.4433	250	300/250	40.5346	
116-118	160/116-118	40.4434	219	339/219	40.5518	<p>type code: series/5xcable diameter For instance 40/5x6-7</p>
118-120	160/118-120	40.4435	273	339/273	40.5545	
120-122	160/120-122	40.4436				
122-124	160/122-124	40.4437				

# SLIPSIL® MULTI-SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
5-6	40/2x5-6	40.0925	14-15	62/2x14-15	40.1739	15-16	90/2x15-16	40.2541
6-7	40/2x6-7	40.0926	15-16	62/2x15-16	40.1740	16-17	90/2x16-17	40.2542
7-8	40/2x7-8	40.0927				17-18	90/2x17-18	40.2543
8-9	40/2x8-9	40.0928	11-12	68/2x11-12	40.1936	18-19	90/2x18-19	40.2544
9-10	40/2x9-10	40.0929	12-13	68/2x12-13	40.1937	19-20	90/2x19-20	40.2545
10-11	40/2x10-11	40.0930	13-14	68/2x13-14	40.1938	20-21	90/2x20-21	40.2546
			14-15	68/2x14-15	40.1939	21-22	90/2x21-22	40.2547
5-6	41/2x5-6	40.1025	15-16	68/2x15-16	40.1940	22-23	90/2x22-23	40.2548
6-7	41/2x6-7	40.1026	16-17	68/2x16-17	40.1941	23-24	90/2x23-24	40.2549
7-8	41/2x7-8	40.1027	17-18	68/2x17-18	40.1942	24-25	90/2x24-25	40.2550
8-9	41/2x8-9	40.1028	18-19	68/2x18-19	40.1943	25-26	90/2x25-26	40.2551
9-10	41/2x9-10	40.1029	19-20	68/2x19-20	40.1944			
10-11	41/2x10-11	40.1030	20-21	68/2x20-21	40.1945			
			21-22	68/2x21-22	40.1946			
5-6	43/2x5-6	40.1125	22-23	68/2x22-23	40.1947			
6-7	43/2x6-7	40.1126						
7-8	43/2x7-8	40.1127	11-12	70/2x11-12	40.2036			
8-9	43/2x8-9	40.1128	12-13	70/2x12-13	40.2037			
9-10	43/2x9-10	40.1129	13-14	70/2x13-14	40.2038			
10-11	43/2x10-11	40.1130	14-15	70/2x14-15	40.2039			
			15-16	70/2x15-16	40.2040			
6-7	50/2x6-7	40.1231	16-17	70/2x16-17	40.2041			
7-8	50/2x7-8	40.1232	17-18	70/2x17-18	40.2042			
8-9	50/2x8-9	40.1233	18-19	70/2x18-19	40.2043			
9-10	50/2x9-10	40.1234	19-20	70/2x19-20	40.2044			
10-11	50/2x10-11	40.1235	20-21	70/2x20-21	40.2045			
11-12	50/2x11-12	40.1236	21-22	70/2x21-22	40.2046			
12-13	50/2x12-13	40.1237	22-23	70/2x22-23	40.2047			
13-14	50/2x13-14	40.1238						
14-15	50/2x14-15	40.1239	12-13	78/2x12-13	40.2241			
15-16	50/2x15-16	40.1240	13-14	78/2x13-14	40.2242			
			14-15	78/2x14-15	40.2243			
6-7	53/2x6-7	40.1331	15-16	78/2x15-16	40.2244			
7-8	53/2x7-8	40.1332	16-17	78/2x16-17	40.2245			
8-9	53/2x8-9	40.1333	17-18	78/2x17-18	40.2246			
9-10	53/2x9-10	40.1334	18-19	78/2x18-19	40.2247			
10-11	53/2x10-11	40.1335	19-20	78/2x19-20	40.2248			
11-12	53/2x11-12	40.1336	20-21	78/2x20-21	40.2249			
12-13	53/2x12-13	40.1337	21-22	78/2x21-22	40.2250			
13-14	53/2x13-14	40.1338	22-23	78/2x22-23	40.2251			
14-15	53/2x14-15	40.1339						
15-16	53/2x15-16	40.1340	12-13	80/2x12-13	40.2341			
			13-14	80/2x13-14	40.2342			
6-7	55/2x6-7	40.1431	14-15	80/2x14-15	40.2343			
7-8	55/2x7-8	40.1432	15-16	80/2x15-16	40.2344			
8-9	55/2x8-9	40.1433	16-17	80/2x16-17	40.2345			
9-10	55/2x9-10	40.1434	17-18	80/2x17-18	40.2346			
10-11	55/2x10-11	40.1435	18-19	80/2x18-19	40.2347			
11-12	55/2x11-12	40.1436	19-20	80/2x19-20	40.2348			
12-13	55/2x12-13	40.1437	20-21	80/2x20-21	40.2349			
13-14	55/2x13-14	40.1438	21-22	80/2x21-22	40.2350			
14-15	55/2x14-15	40.1439	22-23	80/2x22-23	40.2351			
15-16	55/2x15-16	40.1440						
			12-13	82/2x12-13	40.2441			
11-12	60/2x11-12	40.1636	13-14	82/2x13-14	40.2442			
12-13	60/2x12-13	40.1637	14-15	82/2x14-15	40.2443			
13-14	60/2x13-14	40.1638	15-16	82/2x15-16	40.2444			
14-15	60/2x14-15	40.1639	16-17	82/2x16-17	40.2445			
15-16	60/2x15-16	40.1640	17-18	82/2x17-18	40.2446			
			18-19	82/2x18-19	40.2447			
11-12	62/2x11-12	40.1736	19-20	82/2x19-20	40.2448			
12-13	62/2x12-13	40.1737	20-21	82/2x20-21	40.2449			
13-14	62/2x13-14	40.1738	21-22	82/2x21-22	40.2450			
			22-23	82/2x22-23	40.2451			

multi-plugs for other plug series are made upon customer request.  
The listed sizes are standard items. For other sizes, please contact our sales department.


SLIPSIL® multi-sealing plugs for two up to five **same diameter cables or pipes** consist of two or four equal parts, so that they can be installed after the cables or pipes have been laid. For selecting the right type of sealing plug, look for the plug series from the tables.



type code: series/2xcable diameter  
For instance 40/2x6-7



## SLIPSIL® MULTI-SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
5-6	40/3x5-6	40.0935	10-11	80/3x10-11	40.2356	10-11	80/5x10-11	40.2366
6-7	40/3x6-7	40.0936	11-12	80/3x11-12	40.2357	11-12	80/5x11-12	40.2367
7-8	40/3x7-8	40.0937	12-13	80/3x12-13	40.2358	12-13	80/5x12-13	40.2368
			13-14	80/3x13-14	40.2359	13-14	80/5x13-14	40.2369
5-6	41/3x5-6	40.1036	14-15	80/3x14-15	40.2360	14-15	80/5x14-15	40.2370
6-7	41/3x6-7	40.1036	15-16	80/3x15-16	40.2361	15-16	80/5x15-16	40.2371
7-8	41/3x7-8	40.1037						
5-6	43/3x5-6	40.1136	10-11	82/3x10-11	40.2456	10-11	82/5x10-11	40.2466
6-7	43/3x6-7	40.1136	11-12	82/3x11-12	40.2457	11-12	82/5x11-12	40.2467
7-8	43/3x7-8	40.1137	12-13	82/3x12-13	40.2458	12-13	82/5x12-13	40.2468
			13-14	82/3x13-14	40.2459	13-14	82/5x13-14	40.2469
6-7	50/3x6-7	40.1241	14-15	82/3x14-15	40.2460	14-15	82/5x14-15	40.2470
7-8	50/3x7-8	40.1242	15-16	82/3x15-16	40.2461	15-16	82/5x15-16	40.2471
8-9	50/3x8-9	40.1243						
6-7	53/3x6-7	40.1341	10-11	90/3x10-11	40.2556	<p>* multi-plugs for other plug series are made upon customer request. The listed sizes are standard items. For other sizes, please contact our sales department.</p> <p>* the tooling for the multi-plugs 5x is very expensive. Specials only on request based on quantities.</p>		
7-8	53/3x7-8	40.1342	11-12	90/3x11-12	40.2557			
8-9	53/3x8-9	40.1343	12-13	90/3x12-13	40.2558			
9-10	53/3x9-10	40.1344	13-14	90/3x13-14	40.2559			
10-11	53/3x10-11	40.1345	14-15	90/3x14-15	40.2560			
			15-16	90/3x15-16	40.2561			
6-7	55/3x6-7	40.1441	5-6	40/5x5-6	40.0940			
7-8	55/3x7-8	40.1442	6-7	40/5x6-7	40.0941			
8-9	55/3x8-9	40.1443	7-8	40/5x7-8	40.0942			
9-10	55/3x9-10	40.1444						
10-11	55/3x10-11	40.1445	5-6	41/5x5-6	40.1040	 <p>type code: series/3xcable diameter For instance 40/3x6-7</p>		
6-7	60/3x6-7	40.1646	6-7	41/5x6-7	40.1041			
7-8	60/3x7-8	40.1647	7-8	41/5x7-8	40.1042			
8-9	60/3x8-9	40.1648						
9-10	60/3x9-10	40.1649	5-6	43/5x5-6	40.1140			
10-11	60/3x10-11	40.1650	6-7	43/5x6-7	40.1141			
			7-8	43/5x7-8	40.1142			
6-7	62/3x6-7	40.1746	6-7	50/5x6-7	40.1251			
7-8	62/3x7-8	40.1747	7-8	50/5x7-8	40.1252			
8-9	62/3x8-9	40.1748	8-9	50/5x8-9	40.1253			
9-10	62/3x9-10	40.1749						
10-11	62/3x10-11	40.1750	6-7	53/5x6-7	40.1351			
6-7	68/3x6-7	40.1951	7-8	53/5x7-8	40.1352			
7-8	68/3x7-8	40.1952	8-9	53/5x8-9	40.1353			
8-9	68/3x8-9	40.1953	9-10	53/5x9-10	40.1354			
9-10	68/3x9-10	40.1954	10-11	53/5x10-11	40.1355			
10-11	68/3x10-11	40.1955						
11-12	68/3x11-12	40.1956	6-7	55/5x6-7	40.1451			
12-13	68/3x12-13	40.1957	7-8	55/5x7-8	40.1452			
			8-9	55/5x8-9	40.1453			
6-7	70/3x6-7	40.2051	9-10	55/5x9-10	40.1454			
7-8	70/3x7-8	40.2052	10-11	55/5x10-11	40.1455			
8-9	70/3x8-9	40.2053						
9-10	70/3x9-10	40.2054	6-7	68/5x6-7	40.1961			
10-11	70/3x10-11	40.2055	7-8	68/5x7-8	40.1962			
11-12	70/3x11-12	40.2054	8-9	68/5x8-9	40.1963			
12-13	70/3x12-13	40.2055	9-10	68/5x9-10	40.1964			
			10-11	68/5x10-11	40.1965			
10-11	78/3x10-11	40.2256	11-12	68/5x11-12	40.1966			
11-12	78/3x11-12	40.2257	12-13	68/5x12-13	40.1967			
12-13	78/3x12-13	40.2258						
13-14	78/3x13-14	40.2259	10-11	78/5x10-11	40.2266			
14-15	78/3x14-15	40.2260	11-12	78/5x11-12	40.2267			
15-16	78/3x15-16	40.2261	12-13	78/5x12-13	40.2268			
			13-14	78/5x13-14	40.2269			
			14-15	78/5x14-15	40.2270			
			15-16	78/5x15-16	40.2271			



type code: series/3xcable diameter  
For instance 40/3x6-7




type code: series/5xcable diameter  
For instance 40/5x6-7




## SLIPSIL® SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT

Preferably use the CSD® embedded conduit pipe system to ensure exact fitting conduit openings and optimum water tightness/fixation in concrete.

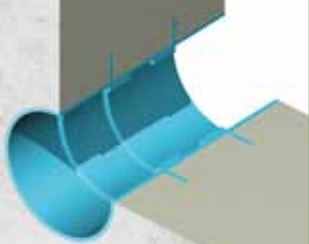

1) Before starting the installation procedure, any dirt or concrete residues should be removed from the conduit inlet pipe. For fire rated penetrations, plastic conduit sleeves should never be used.

Note: the pipe has to be ducted straight and centrally!  
Note: Always use sufficient lubricant to avoid installation problems.

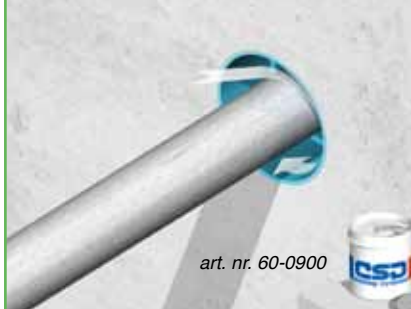

2) The inside wall of the conduit inlet pipe is treated with CSD® lubricant up to the shoulder inside the conduit inlet pipe. In case of drilled holes or non-CSD® conduit sleeves, sharp edges have to be rounded off to avoid damage to the plugs during insertion.

Always use sufficient lubricant to avoid installation problems.



3) The inside surfaces of both segments of the SLIPSIL® sealing plug are then treated with CSD® lubricant.

For selecting the right sealing plug, look for the plug series and the plug type in this series on the basis of the ID of the conduit and the OD of the ducted pipe.

Always use sufficient lubricant to avoid installation problems.



4) The segments of the SLIPSIL® sealing plug are also treated with CSD® lubricant on the outside.

Please refer to the Safety Data Sheet of the CSD® lubricant for more information.

For inspection purposes, the allowed dimensions of the ducted pipe are indicated on the flange of the plug.



5) Both segments of the SLIPSIL® sealing plug are placed around the ducted pipe and then pushed into the conduit opening as far as the first serration. The first serration is smaller than the other serrations to make this procedure very easy.

Larger plugs can be tapped in using a hammer and a piece of wood.




6) Then both segments of the SLIPSIL® sealing plug are pushed by hand evenly, serration by serration, further into the conduit opening.

The flange has a distinctive design and is clearly marked with the CSD® and S(lipsil)® logo.




7) The flanged edge of the sealing plug must be flush against the front side of the wall. The shoulder inside the conduit pipe inlet prevents the SLIPSIL® plug from being inserted too deep into the conduit opening.

It is advisable to always apply the plugs at both sides. During insertion of the second plug, the air between both plugs will be compressed, and has to be released from time to time, by inserting a screwdriver between both plug halves.

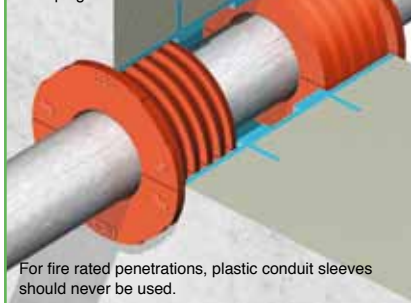

8) SLIPSIL® sealing plugs always have to be inserted in both ends of conduits for heavy pipes, when to cope with settling in front of the foundation, in drilled holes and for fire rated penetrations.


For horizontal ducts of heavy pipes/cables it is extremely important to support the pipes properly at both sides of the conduit.

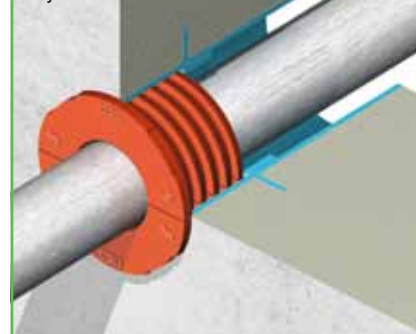

9) In cases where the required tightness is not excessive, a SLIPSIL® sealing plug can be installed at one side of the conduit. Only applicable in combination with CSD® embedded conduit pipe system.



## SLIPSIL® MULTI-SEALING PLUGS FOR PIPE/CABLE ENTRIES - FIRESAFE/GAS & WATERTIGHT



1) Before starting the installation procedure, any dirt or concrete residues should be removed from the conduit inlet pipe. For fire rated penetrations, plastic conduit sleeves should never be used.



2) The inside wall of the conduit inlet pipe is treated with CSD® lubricant up to the shoulder inside the conduit inlet pipe. In case of drilled holes or non-CSD® conduit sleeves, sharp edges have to be rounded off to avoid damage to the plugs during insertion.




3) The inside surfaces of the four segments of the SLIPSIL® multi-sealing plug are then treated with CSD® lubricant.


*For selecting the right sealing plug, look for the plug series and the plug type in this series on the basis of the ID of the conduit and the OD of the ducted pipes.*




4) The four segments of the SLIPSIL® multi-sealing plug are also treated with CSD® lubricant on the outside. Please refer to the Safety Data Sheet of the CSD® lubricant for more information.

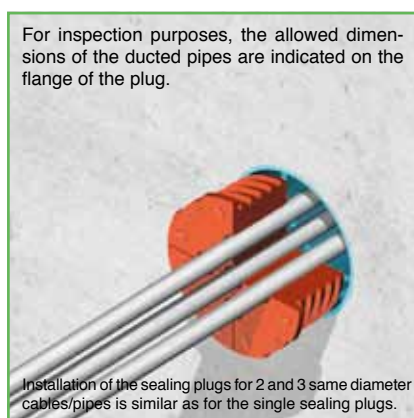


5) The segments of the SLIPSIL® multi-sealing plug are placed around the ducted pipes and then pushed into the conduit opening as far as the first serration. The first serration is smaller than the other serrations to make this procedure very easy.

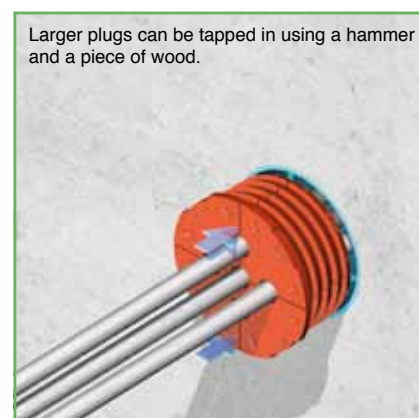


6) Then the four segments of the SLIPSIL® multi-sealing plug are pushed by hand evenly, serration by serration, further into the conduit opening.

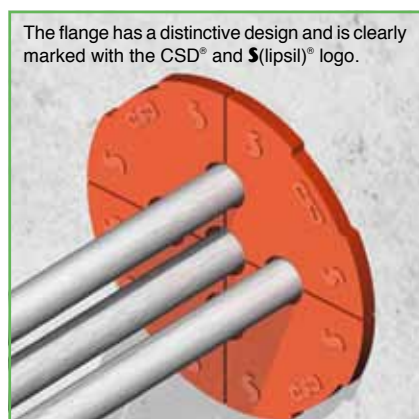

7) The flanged edge of the sealing plug must be flush against the front side of the wall. The shoulder inside the conduit pipe inlet prevents the SLIPSIL® plug from being inserted too deep into the conduit opening.

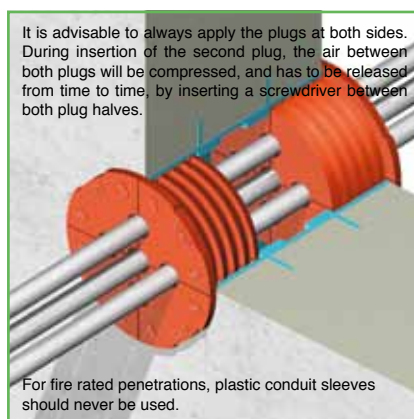


8) SLIPSIL® sealing plugs always have to be inserted in both ends of conduits for heavy pipes, to cope with settling in front of the foundation, in drilled holes and for fire rated penetrations.

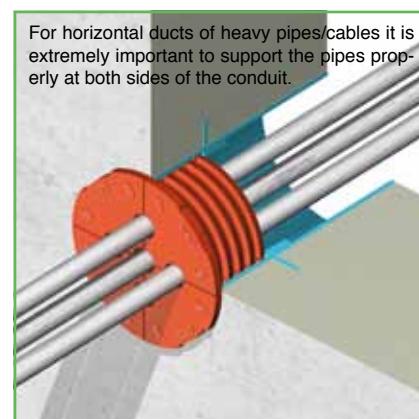


9) In cases where the required tightness is not excessive, a SLIPSIL® sealing plug can be installed at one side of the conduit. Only applicable in combination with CSD® embedded conduit pipe system.






## CSD® CONDUIT PIPE INLET SYSTEM AND SLIPSIL® 3 SEGMENT PLUG FOR 3 SINGLE CORE CABLES MAX. 44 MM

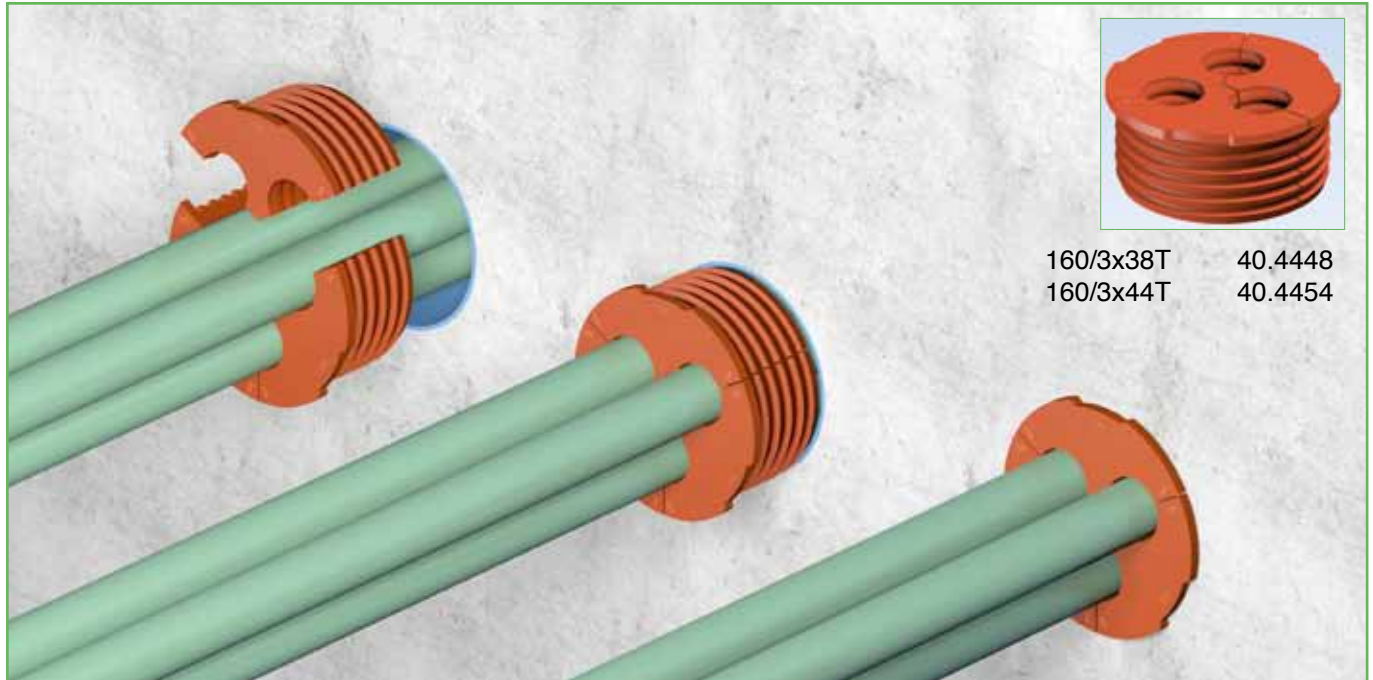


## CSD® CONDUIT PIPE INLET SYSTEM AND SLIPSIL® 4 SEGMENT PLUG FOR HDPE MAX. 40/CABLES MAX. 20 MM

- COMBINATION OF 4-SEGMENT PLUG AND ADAPTER PLUG
- SLIPSIL® ADAPTER FOR ADJUSTING 40 MM OPENING TO SIZE
- SLIPSIL® ADAPTER FITTING FOR DUCTED CABLE
- ADAPTER HALVES TO BE PLACED IN THE TWO PLUG SEGMENTS
- SLIPSIL® ADAPTER TO BE LUBRICATED ONLY AT THE INSIDE
- SET OF SEGMENT PLUG/ADAPTER TO BE INSERTED TOGETHER

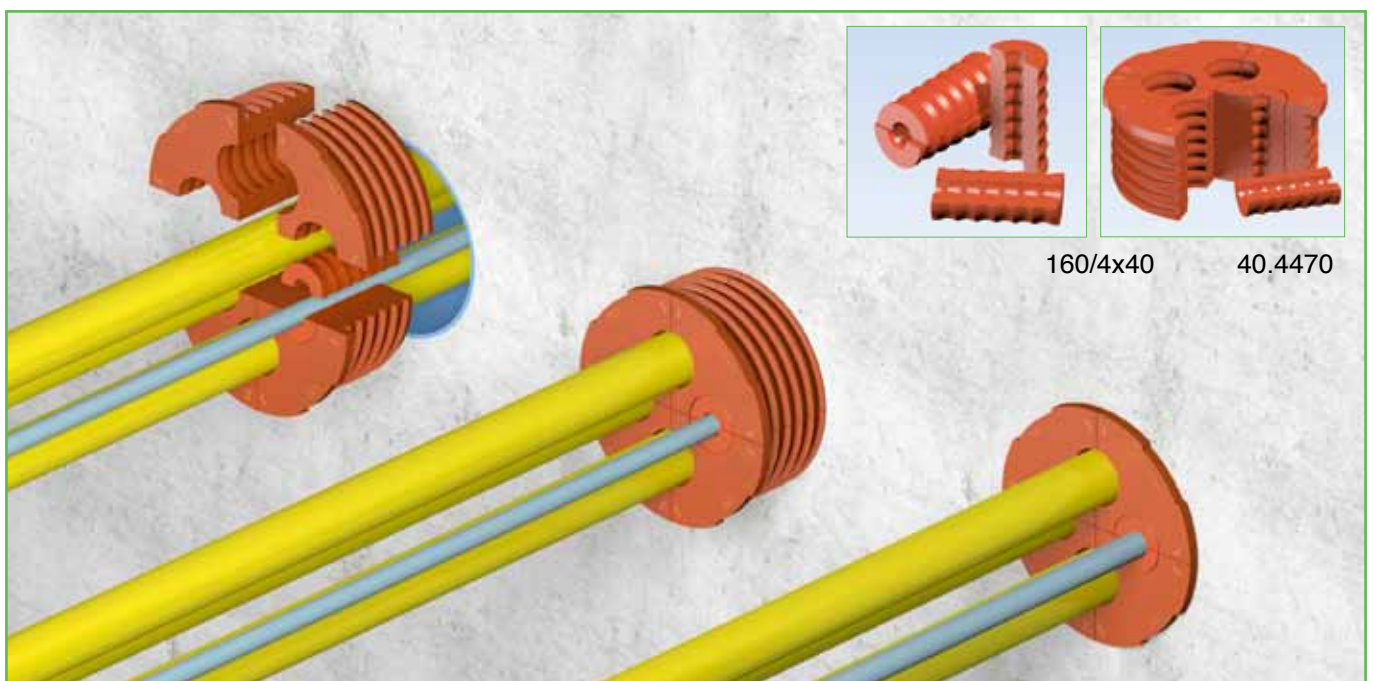


## SLIPSIL®-MPP GAS & WATERTIGHT MULTI-CABLE AND PIPE TRANSIT SEALING SYSTEM


**CSD® multi-passage modules**




**MPP 160/3x67**  
3 conduit openings 67 mm  
shoulder 66 mm deep  
passage opening 57 mm  
article number 60.9208




**MPP 160/4x55**  
4 conduit openings 55 mm  
shoulder 66 mm deep  
passage opening 40 mm  
article number 60.9207




**MPP 160/7x43**  
7 conduit openings 43 mm  
shoulder 54 mm deep  
passage opening 33 mm  
article number 60.9206




**MPP 160/14x30**  
14 conduit openings 30 mm  
shoulder 54 mm deep  
passage opening 20 mm  
article number 60.9205




**MPP 125/4x43**  
4 conduit openings 43 mm  
shoulder 54 mm deep  
passage opening 33 mm  
article number 60.9204




**MPP 125/7x35**  
7 conduit openings 35 mm  
shoulder 54 mm deep  
passage opening 25 mm  
article number 60.9203



**MPP 125/10x27**  
10 conduit openings 27 mm  
shoulder 54 mm deep  
passage opening 17 mm  
article number 60.9202



**MPP 100/4x35**  
4 conduit openings 35 mm  
shoulder 54 mm deep  
passage opening 25 mm  
article number 60.9201



**MPP 100/7x27**  
7 conduit openings 27 mm  
shoulder 54 mm deep  
passage opening 17 mm  
article number 60.9200

CSD® module	SLIPSIL® plug	DYNATITE® series	CSD® inlet
100/7x27	125/100	27	125 CI*
100/4x35	125/100	35	125 CI*
125/10x27	160/125	27	160 CI*
125/7x35	160/125	35	160 CI*
125/4x43	160/125	43	160 CI*
160/14x30	200/159	30	200 CI*
160/7x43	200/159	43	200 CI*
160/4x55	200/159	55	200 CI*
160/3x67	200/159	67	200 CI*

\* look for the CSD® embedded pipe conduit system (pages 6-8)

CSD® module	SLIPSIL® plug	article number	CSD® inlet
100 series	125/100	40.3650	yes
	128/100	40.3750	none
	131/100	40.3850	none
	146/100	40.3926	none
125 series	150/125	40.4039	none
	152/125	40.4139	none
	154/125	40.4239	none
	156/125	40.4339	none
	160/125	40.4439	yes
160 series	190/159	40.4543	none
	200/159	40.4643	yes
	203/159	40.4743	none
	207/159	40.4843	none

**DYNATITE® mono and multi- sealing plugs**





## SLIPSIL®-MPP GAS & WATERTIGHT MULTI-CABLE AND PIPE TRANSIT SEALING SYSTEM

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
blind	27/0DT	45.0200	5-6	43/2x5-6DT	45.1125	36-38	67/36-38DT	45.1822
5-6	27/5-6DT	45.0205	6-7	43/2x6-7DT	45.1126	38-40	67/38-40DT	45.1823
6-7	27/6-7DT	45.0206	7-8	43/2x7-8DT	45.1127	40-42	67/40-42DT	45.1824
7-8	27/7-8DT	45.0207	8-9	43/2x8-9DT	45.1128	42-44	67/42-44DT	45.1825
8-9	27/8-9DT	45.0208	9-10	43/2x9-10DT	45.1129	44-46	67/44-46DT	45.1826
9-10	27/9-10DT	45.0209	10-11	43/2x10-11DT	45.1130	46-48	67/46-48DT	45.1827
10-11	27/10-11DT	45.0210				48-50	67/48-50DT	45.1828
11-12	27/11-12DT	45.0211	5-6	43/3x5-6DT	45.1135	50	67/50DT	45.1829
12-13	27/12-13DT	45.0212	6-7	43/3x6-7DT	45.1136			
13-14	27/13-14DT	45.0213	7-8	43/3x7-8DT	45.1137	11-12	67/2x11-12DT	40.1836
blind	30/0DT	45.0400	5-6	43/5x5-6DT	45.1140	12-13	67/2x12-13DT	40.1837
5-6	30/5-6DT	45.0405	6-7	43/5x6-7DT	45.1141	13-14	67/2x13-14DT	40.1838
6-7	30/6-7DT	45.0406	7-8	43/5x7-8DT	45.1142	14-15	67/2x14-15DT	40.1839
7-8	30/7-8DT	45.0407	blind	55/0DT	45.1400	15-16	67/2x15-16DT	40.1840
8-9	30/8-9DT	45.0408	6-7	55/6-7DT	45.1405	16-17	67/2x16-17DT	40.1841
9-10	30/9-10DT	45.0409	7-8	55/7-8DT	45.1406	17-18	67/2x17-18DT	40.1842
10-11	30/10-11DT	45.0410	8-9	55/8-9DT	45.1407	18-19	67/2x18-19DT	40.1843
11-12	30/11-12DT	45.0411	9-10	55/9-10DT	45.1408	19-20	67/2x19-20DT	40.1844
12-13	30/12-13DT	45.0412	10-12	55/10-12DT	45.1409	20-21	67/2x20-21DT	40.1845
13-14	30/13-14DT	45.0413	12-14	55/12-14DT	45.1410	6-7	67/3x6-7DT	40.1851
14-15	30/14-15DT	45.0414	14-16	55/14-16DT	45.1411	7-8	67/3x7-8DT	40.1852
15-16	30/15-16DT	45.0415	16-18	55/16-18DT	45.1412	8-9	67/3x8-9DT	40.1853
16	30/16DT	45.0416	18-20	55/18-20DT	45.1413	9-10	67/3x9-10DT	40.1854
blind	35/0DT	45.0700	20-22	55/20-22DT	45.1414	10-11	67/3x10-11DT	40.1855
5-6	35/5-6DT	45.0705	22-24	55/22-24DT	45.1415	11-12	67/3x11-12DT	40.1856
6-7	35/6-7DT	45.0706	24-26	55/24-26DT	45.1416	12-13	67/3x12-13DT	40.1857
7-8	35/7-8DT	45.0707	26-28	55/26-28DT	45.1417	6-7	67/5x6-7DT	40.1861
8-9	35/8-9DT	45.0708	28-30	55/28-30DT	45.1418	7-8	67/5x7-8DT	40.1862
9-10	35/9-10DT	45.0709	30-31	55/30-31DT	45.1419	8-9	67/5x8-9DT	40.1863
10-11	35/10-11DT	45.0710	31-32	55/31-32DT	45.1420	9-10	67/5x9-10DT	40.1864
11-12	35/11-12DT	45.0711	32-33	55/32-33DT	45.1421	10-11	67/5x10-11DT	40.1865
12-13	35/12-13DT	45.0712	33-34	55/33-34DT	45.1422	11-12	67/5x11-12DT	40.1866
13-14	35/13-14DT	45.0713	6-7	55/2x6-7DT	45.1431	12-13	67/5x12-13DT	40.1867
14-15	35/14-15DT	45.0714	7-8	55/2x7-8DT	45.1432			
15-16	35/15-16DT	45.0715	8-9	55/2x8-9DT	45.1433			
16-17	35/16-17DT	45.0716	9-10	55/2x9-10DT	45.1434			
17-18	35/17-18DT	45.0717	10-11	55/2x10-11DT	45.1435			
18-19	35/18-19DT	45.0718	11-12	55/2x11-12DT	45.1436			
19-20	35/19-20DT	45.0719	12-13	55/2x12-13DT	45.1437			
20	35/20DT	45.0720	13-14	55/2x13-14DT	45.1438			
blind	43/0DT	45.1100	14-15	55/2x14-15DT	45.1439			
5-6	43/5-6DT	45.1105	15-16	55/2x15-16DT	45.1440			
6-7	43/6-7DT	45.1106						
7-8	43/7-8DT	45.1107	6-7	55/3x6-7DT	45.1441			
8-9	43/8-9DT	45.1108	7-8	55/3x7-8DT	45.1442			
9-10	43/9-10DT	45.1109	8-9	55/3x8-9DT	45.1443			
10-12	43/10-12DT	45.1110	9-10	55/3x9-10DT	45.1444			
12-14	43/12-14DT	45.1111	10-11	55/3x10-11DT	45.1445			
14-16	43/14-16DT	45.1112	6-7	55/5x6-7DT	45.1451			
16-18	43/16-18DT	45.1113	7-8	55/5x7-8DT	45.1452			
18-20	43/18-20DT	45.1114	8-9	55/5x8-9DT	45.1453			
20-22	43/20-22DT	45.1115	9-10	55/5x9-10DT	45.1454			
22-24	43/22-24DT	45.1116	10-11	55/5x10-11DT	45.1455			
24-25	43/24-25DT	45.1117	blind	67/0DT	45.1800			
25-26	43/25-26DT	45.1118	22-24	67/22-24DT	45.1815			
26-27	43/26-27DT	45.1119	24-26	67/24-26DT	45.1816			
27-28	43/27-28DT	45.1120	26-28	67/26-28DT	45.1817			
28	43/28DT	45.1121	28-30	67/28-30DT	45.1818			
			30-32	67/30-32DT	45.1819			
			32-34	67/32-34DT	45.1820			
			34-36	67/34-36DT	45.1821			

**\* Note:**

The functionality of the MPP system can be guaranteed only by application of the the DYNATITE® plugs in the MPP modules. Application of DYNATITE® plugs cannot be guaranteed in other conduit systems.



**DYNATITE® blind plugs**





## SLIPSIL®-MPP GAS & WATERTIGHT MULTI-CABLE AND PIPE TRANSIT SEALING SYSTEM

Preferably use the CSD® embedded conduit pipe system to ensure exact fitting conduit openings and optimum water tightness/fixation in concrete.



Please refer to the Safety Data Sheet of the CSD® lubricant for more information.


1) Before starting the installation procedure, any dirt or concrete residues should be removed from the conduit inlet pipe. Then the inside wall of the conduit inlet pipe is treated with CSD® lubricant up to the shoulder inside the conduit inlet pipe.

Always use sufficient lubricant to avoid installation problems.



2) The segments of the SLIPSIL® sealing plug are treated with CSD® lubricant on the outside. Both segments of the SLIPSIL® plug are fitted around a SLIPSIL®/MPP multi-passage module.

Always use sufficient lubricant to avoid installation problems.

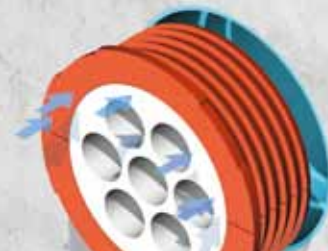

3) The set of SLIPSIL® plug and multi-passage module is pushed into the conduit opening as far as the first serration and then pushed by hand evenly, serration by serration, further into the conduit opening.


The flange of the SLIPSIL® plug has to be flush with the wall.




4) A cable is pulled through one of the conduit openings in the module. The segments of the DYNATITE® plugs are lubricated all around, placed around the ducted cable and then pushed into the conduit opening.



5) After insertion, the front side of the sealing plug must be flush with the front side of the module. This proves that the back side of the plug is positioned against the shoulder inside the conduit opening of the multi-passage module.

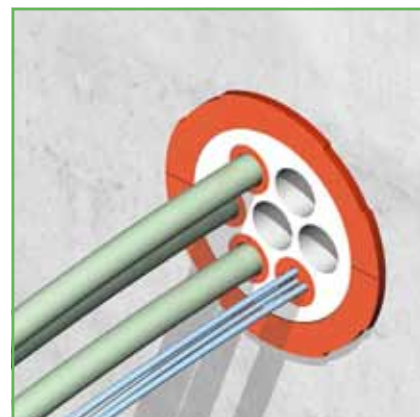

6) In the same way, all conduit openings with a single ducted cable are sealed with DYNATITE® sealing plugs. Multi-sealing plugs are used for conduit openings through which 2, 3 or 5 same diameter cables are pulled.

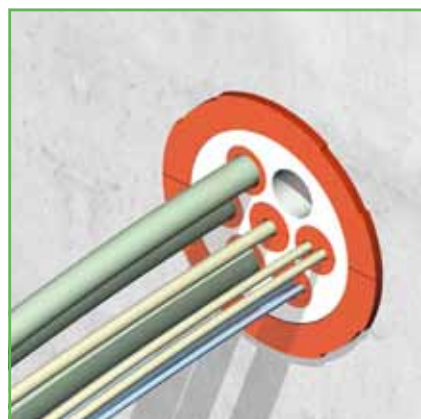


7) The SLIPSIL®/MPP multi-passage modules allow ducting of cables with various diameters through the multi-passage module. Spare openings can be used for ducting extra cables in a later stage.

Note: tightness of the plugs guaranteed only when applied in the MPP modules.




8) DYNATITE® blind plugs are used to seal the openings for later extensions. Blind plugs can easily be removed. Cable can be pulled through and sealed with a fitting sealing plug. No need to dismantle the whole penetration.

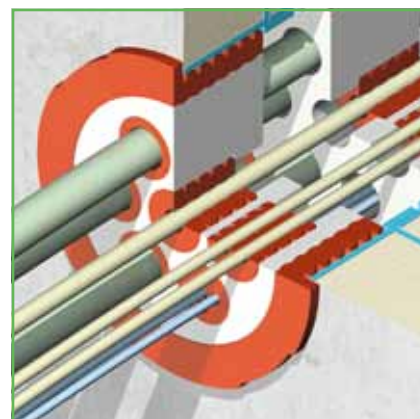


9) For highest performance and mechanical stability, it is advisable to install the set of SLIPSIL® plug and multi-passage module at both sides of the wall or floor.






**GLANDMOD - MULTI-GLAND SYSTEM**  
**MULTI-MODULES - NOFIRNO GASKETS - CET-A-SIL PLUGS**

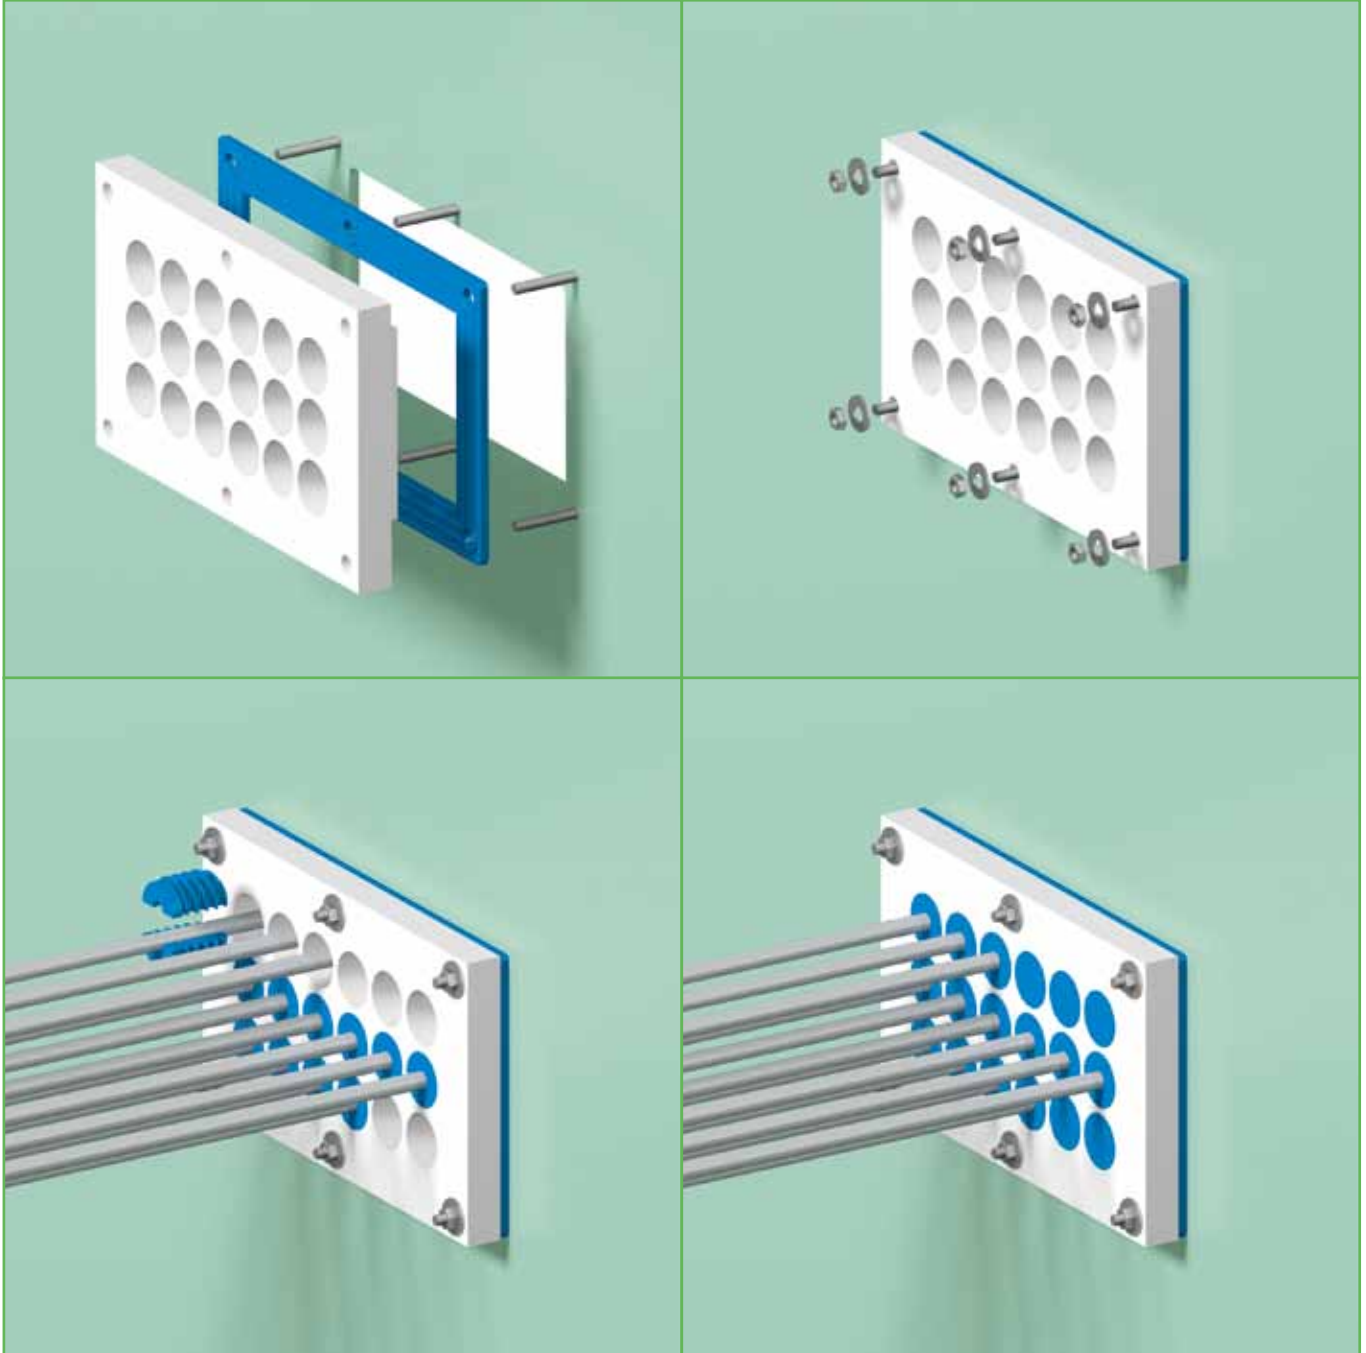

**GLANDMOD - MULTI-GLAND SYSTEM**  
effective alternative for cable gland systems  
plugs/gasket made of NOFIRNO® rubber -  
body of HMPE plastic  
IP 67 rated - 1-2 meter water column tight  
various configurations

## GLANDMOD - MULTI-GLAND SYSTEM

### MULTI-MODULES - NOFIRNO GASKETS - CET-A-SIL PLUGS

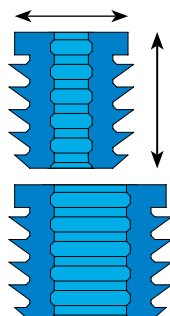


flange 15 mm  
length 18 mm

type	cable diameter	art. no.
15/0	blind	46.0100
15/4	3.7-4.7	46.0104
15/5	4.7-5.7	46.0105
15/6	5.7-6.7	46.0106
15/7	6.7-7.7	46.0107

#### CET-A-SIL SERIES 15

type	cable diameter	art. no.
20/0	blind	46.0200
20/4	3.7-4.7	46.0204
20/5	4.7-5.7	46.0205
20/6	5.7-6.7	46.0206
20/7	6.7-7.7	46.0207
20/8	7.7-8.7	46.0208
20/9	8.7-9.7	46.0209
20/10	9.7-10.7	46.0210

#### CET-A-SIL SERIES 20




flange 25 mm  
length 27 mm

type	cable diameter	art. no.
25/0	blind	46.0300
25/8	7.7-8.7	46.0308
25/9	8.7-9.7	46.0309
25/10	9.7-10.7	46.0310
25/11	10.7-11.7	46.0311
25/12	11.7-12.7	46.0312
25/13	12.7-13.7	46.0313
25/14	13.7-14.7	46.0314

#### CET-A-SIL SERIES 25

type	cable diameter	art. no.
30/0	blind	46.0400
30/10	9.7-10.7	46.0410
30/11	10.7-11.7	46.0411
30/12	11.7-12.7	46.0412
30/13	12.7-13.7	46.0413
30/14	13.7-14.7	46.0414
30/15	14.7-15.7	46.0415
30/16	15.7-16.7	46.0416
30/17	16.7-17.7	46.0417


#### CET-A-SIL SERIES 30




flange 30 mm  
length 27 mm

type	cable diameter	art. no.
35/0	blind	46.0500
35/15	14.7-15.7	46.0515
35/16	15.7-16.7	46.0516
35/17	16.7-17.7	46.0517
35/18	17.7-18.7	46.0518
35/19	18.7-19.7	46.0519
35/20	19.7-20.7	46.0520
35/21	20.7-21.7	46.0521
35/22	21.7-22.7	46.0522

#### CET-A-SIL SERIES 35



flange 35 mm  
length 27 mm

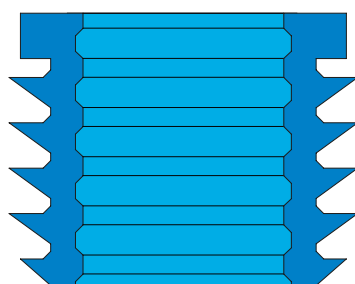


flange 43 mm  
length 36 mm

type	cable diameter	art. no.
43/0	blind	46.0600
43/20	19.7-20.7	46.0620
43/21	20.7-21.7	46.0621
43/22	21.7-22.7	46.0622
43/23	22.7-23.7	46.0623
43/24	23.7-24.7	46.0624
43/25	24.7-25.7	46.0625
43/26	25.7-26.7	46.0626
43/27	26.7-27.7	46.0627
43/28	27.7-28.7	46.0628
43/29	28.7-29.7	46.0629


#### CET-A-SIL SERIES 43

type	cable diameter	art. no.
50/0	blind	46.0700
50/25	24.7-25.7	46.0725
50/26	25.7-26.7	46.0726
50/27	26.7-27.7	46.0727
50/28	27.7-28.7	46.0728
50/29	28.7-29.7	46.0729
50/30	29.7-30.7	46.0730
50/31	30.7-31.7	46.0731
50/32	31.7-32.7	46.0732
50/33	32.7-33.7	46.0733
50/34	33.7-34.7	46.0734

#### CET-A-SIL SERIES 50

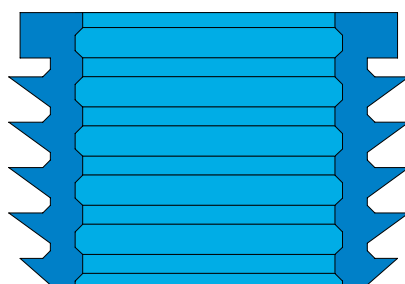

flange 50 mm  
length 36 mm

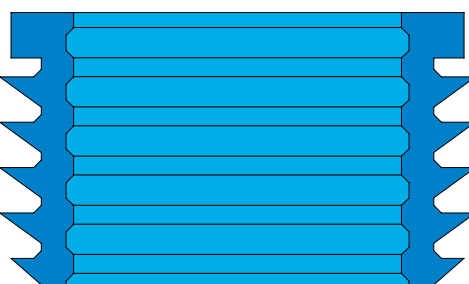


flange 60 mm  
length 36 mm

type	cable diameter	art. no.
60/0	blind	46.0800
60/30	29.7-30.7	46.0830
60/31	30.7-31.7	46.0831
60/32	31.7-32.7	46.0832
60/33	32.7-33.7	46.0833
60/34	33.7-34.7	46.0834
60/35	34.7-35.7	46.0835
60/36	35.7-36.7	46.0836
60/37	36.7-37.7	46.0837
60/38	37.7-38.7	46.0838
60/39	38.7-39.7	46.0839
60/40	39.7-40.7	46.0840

#### CET-A-SIL SERIES 60



## GLANDMOD - MULTI-GLAND SYSTEM MULTI-MODULES - NOFIRNO GASKETS - CET-A-SIL PLUGS

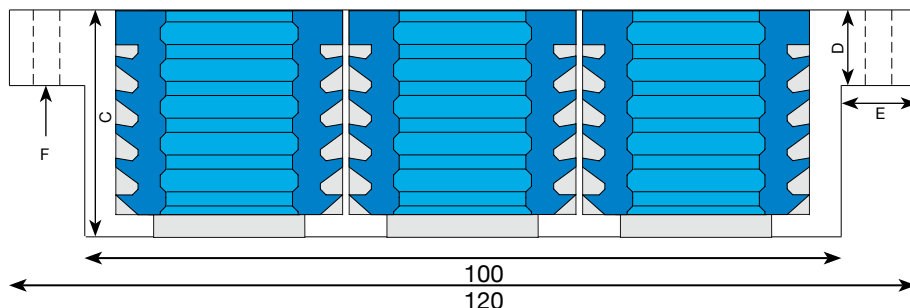


### GLANDMOD SERIES 01:

outer dimensions 120x75 mm

recessed dimensions 100x55 mm

TYPE	A	B	C	D	E	F	art. no.
14x15	15	10	20	10	10	M4	60.9300
8x20	20	15	20	10	10	M4	60.9301
5x25	25	17.5	30	10	10	M4	60.9302
3x30	30	20	30	10	10	M4	60.9303

TYPE	conduit openings	plug series	cable size
14x15	14	15	3.7-7.7
8x20	8	20	3.7-9.7
5x25	5	25	7.7-14.7
3x30	3	30	9.7-17.7

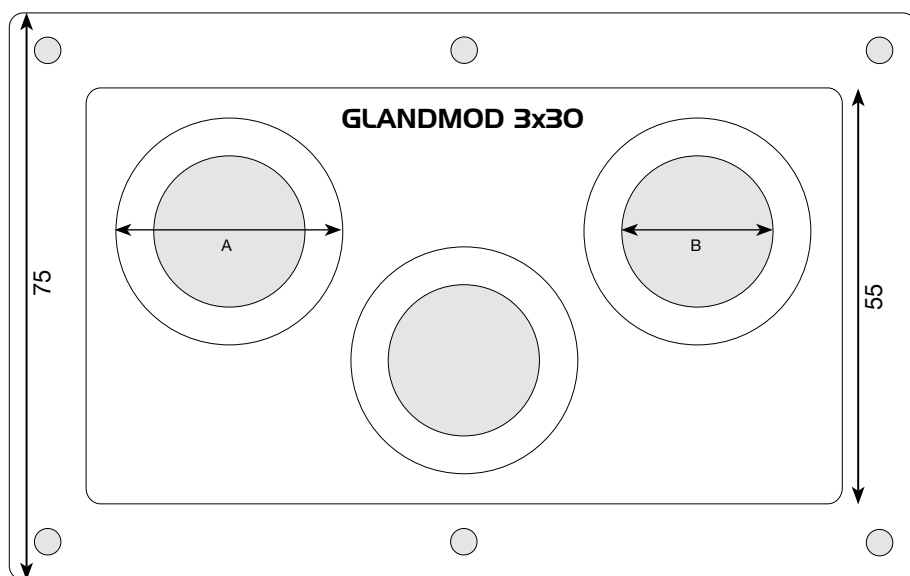


### GLANDMOD SERIES 02:

outer dimensions 230x130 mm

recessed dimensions 200x100 mm

TYPE	A	B	C	D	E	F	art. no.
18x30	30	20	30	10	15	M6	60.9310
11x35	35	25	30	10	15	M6	60.9311
8x43	43	33	40	10	15	M6	60.9312
5x50	50	40	40	10	15	M6	60.9313

TYPE	conduit openings	plug series	cable size
18x30	18	30	9.7-17.7
11x35	11	35	14.7-22.7
8x43	8	43	19.7-28.7
5x50	5	50	24.7-34.7

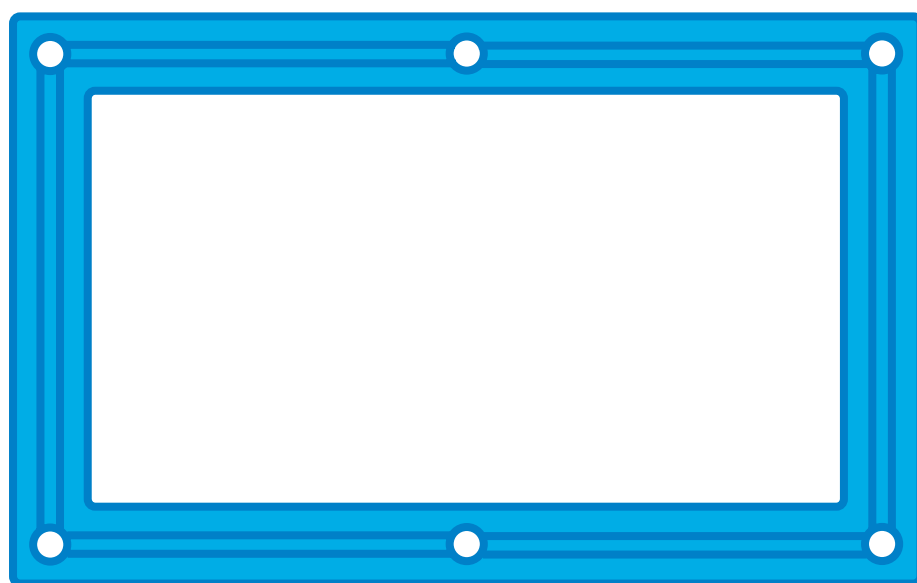

### NOFIRNO GASKET SERIES 01

profiled, thickness overall 5 mm,  
width 10 mm

dimensions outside 120x75 mm

dimensions inside 100x55 mm

art. nr. 51.9301

### NOFIRNO GASKET SERIES 02

profiled, thickness overall 5 mm,  
width 15 mm


dimensions outside 230x130 mm

dimensions inside 200x100 mm

art. nr. 51.9302

Note: the functionality with regard to tightness of the multi-gland system can be guaranteed only by application of the CET-A-SIL plugs in GLANDMOD modules. Application of CET-A-SIL plugs cannot be guaranteed in other conduit systems. Two standard series of the GLANDMOD modules are available. Ask for the drawings of the GLANDMOD modules. On request modules with various hole configurations can be made to size. The largest one so far made is a module 565 x 240 mm with 24 conduit openings 50 mm. For special sizes, please contact our sales department.

## DYNATITE® SEALING PLUGS IN COMBINATION WITH DYNATITE® CONDUIT SLEEVES FOR HIGH PRESSURE RATINGS

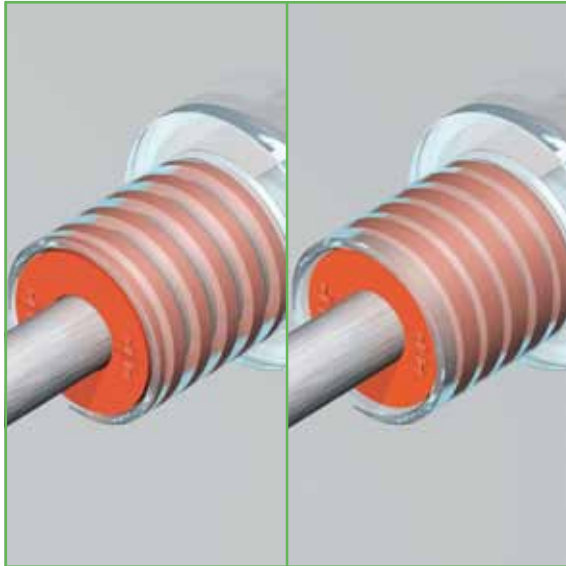

In view of the incompressibility of rubbers, the design work focused on finding an ideal solution to allow rubber to move in the right directions under mechanical loads. To cope with instantaneous pressure loads, an ultimate displacement of the rubber is needed.

For this reason, the flange has been designed to enable functioning as a guidance for the movement inside the conduit sleeve. The DYNATITE® plugs have a flange which has the same outer dimensions as the inside diameter of the conduit sleeve.

By allowing displacement of the rubber, the initial labyrinth seal of the profiling without pressure load is then automatically improving to cope with higher ratings.

The higher the pressure, the higher the tightness.



The conduit sleeves are milled to exact internal dimensions from stainless steel 1.4571. The milled sleeves are CDW seam welded to the flanges used for bolting or welding.

To optimize corrosion resistance, especially in salt water conditions and harsh environments, the DYNATITE® conduit sleeves are surface treated on the basis of a unique passivation process. This prevents corrosion for a service life up to 20 years. Salt Fog test according to DIN EN 60068-2-52 to simulate 20 years operation in sea water atmosphere successfully carried out.

The inner walls of the conduit sleeves for welding (right side of the picture) are treated with a silicon dioxide ceramic coating (500 °C resistant, fire resistant); the inner walls of the conduit sleeves for bolting have a black PTFE (Teflon) coating.



The NOFIRNO® rubber, used for the plugs and gaskets, has excellent weathering properties, UV and ozone resistance and long term behaviour. Service life easily exceeds 50 years under normal environmental conditions. The rubber can be used in a very wide temperature range. Even at low temperatures down to -50° C the rubber stays flexible. This guarantees tightness even at low temperatures.



NOFIRNO® rubber is made of a high grade, inert silicone polymer. The NOFIRNO® gaskets have a special profiling to exclude the need for excessive compression and the need for retightening from time to time.

NOFIRNO® gaskets are also available for the plastic CSD® flanged conduit sleeves.






## DYNATITE® SEALING PLUGS IN COMBINATION WITH DYNATITE® CONDUIT SLEEVES FOR HIGH PRESSURE RATINGS

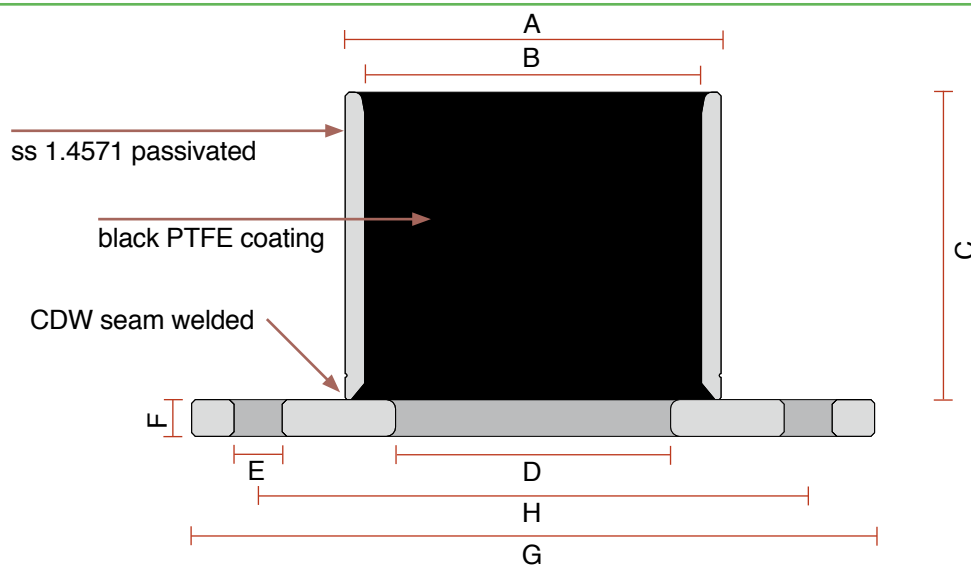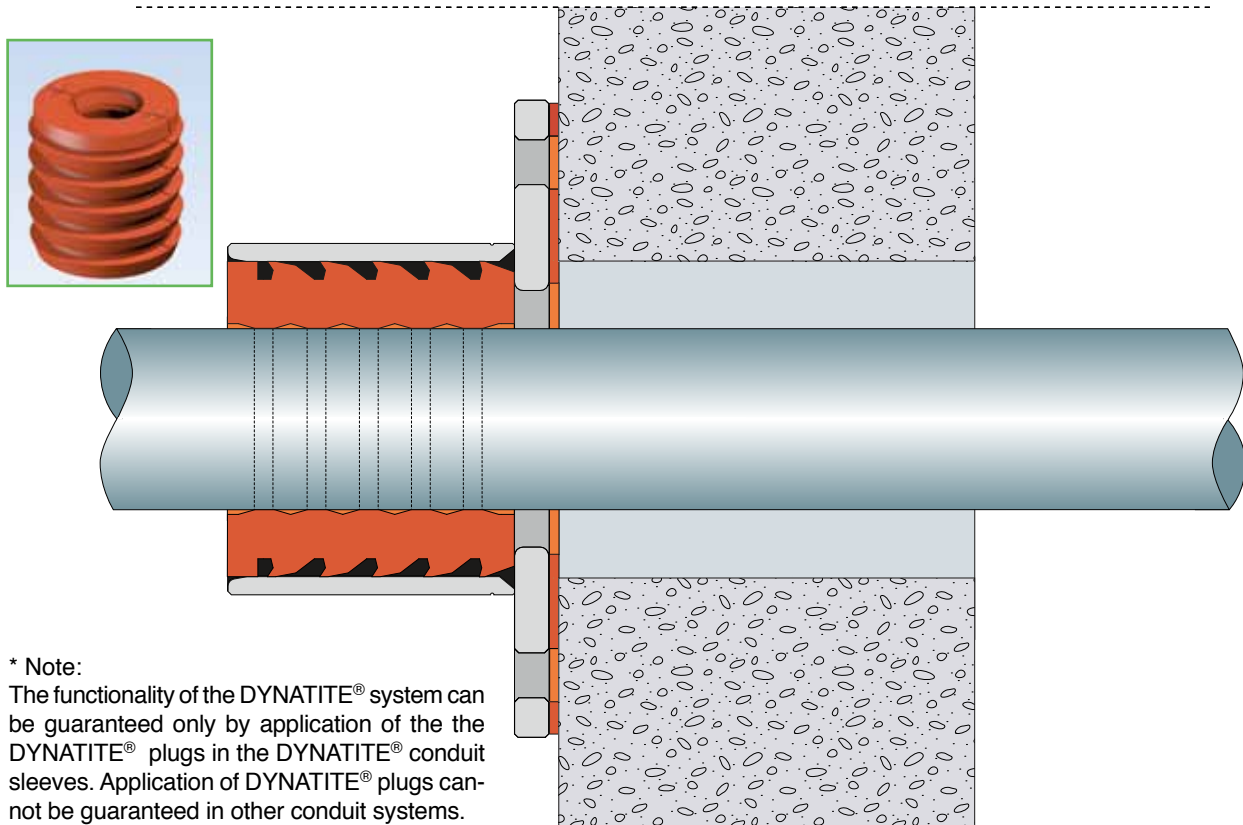

type	A	B	C	D	E	F	G	H	art. no.	gasket	art. no.
DT 25 FB	33.5	25	54	12	10.5	8	92	63	60.9000	DT 25 FB	51.9000
DT 32 FB	40.5	32	54	16	10.5	8	99	70	60.9001	DT 32 FB	51.9001
DT 41 FB	49.5	41	54	25	10.5	8	108	79	60.9002	DT 41 FB	51.9002
DT 55 FB	63.5	55	66	34	10.5	8	122	93	60.9003	DT 55 FB	51.9003
DT 70 FB	78.5	70	66	50	10.5	8	137	108	60.9004	DT 70 FB	51.9004
DT 82 FB	90.5	82	66	60	10.5	8	149	120	60.9005	DT 82 FB	51.9005
DT 100 FB	108.5	100	66	75	10.5	8	167	138	60.9006	DT 100 FB	51.9006
DT 125 FB	133.5	125	66	95	10.5	8	192	163	60.9007	DT 125 FB	51.9007
DT 150 FB	158.5	150	79	120	10.5	8	217	188	60.9008	DT 150 FB	51.9008

## DYNATITE® SEALING PLUGS IN COMBINATION WITH DYNATITE® CONDUIT SLEEVES FOR HIGH PRESSURE RATINGS

cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number	cable/ pipe diameter	plug type	article number
5-6	25/5-6DT	45.0105	11-12	70/2x11-12DT	45.2036	70-72	125/70-72DT	45.3635
6-7	25/6-7DT	45.0106	12-13	70/2x12-13DT	45.2037	72-74	125/72-74DT	45.3636
7-8	25/7-8DT	45.0107	13-14	70/2x13-14DT	45.2038	74-76	125/74-76DT	45.3637
8-9	25/8-9DT	45.0108	14-15	70/2x14-15DT	45.2039	76-78	125/76-78DT	45.3638
5-6 alle maten in mm	32/5-6DT	45.0505	15-16	70/2x15-16DT	45.2040	78-80	125/78-80DT	45.3639
	32/6-7DT	45.0506	16-17	70/2x16-17DT	45.2041	80-82	125/80-82DT	45.3640
	32/7-8DT	45.0507	17-18	70/2x17-18DT	45.2042	82-84	125/82-84DT	45.3641
	32/8-9DT	45.0508	18	70/2x18DT	45.2043	84-86	125/84-86DT	45.3642
	32/9-10DT	45.0509	28-30	82/28-30DT	45.2418	86-88	125/86-88DT	45.3643
10-11	32/10-11DT	45.0510	30-32	82/30-32DT	45.2419	88	125/88DT	45.3644
11-12	32/11-12DT	45.0511	32-34	82/32-34DT	45.2420	88-90 90-92 92-94 94-96 96-98 98-100 100-102 102-104 104-106 106-108 108-110 110-112 112-114 114	150/88-90DT	45.4020
12	32/12DT	45.0512	34-36	82/34-36DT	45.2421		150/90-92DT	45.4021
5-6	41/5-6DT	45.1005	36-38	82/36-38DT	45.2422		150/92-94DT	45.4022
6-7	41/6-7DT	45.1006	38-40	82/38-40DT	45.2423		150/94-96DT	45.4023
7-8	41/7-8DT	45.1007	40-42	82/40-42DT	45.2424		150/96-98DT	45.4024
8-9	41/8-9DT	45.1008	42-44	82/42-44DT	45.2425		150/98-100DT	45.4025
9-10	41/9-10DT	45.1009	44-46	82/44-46DT	45.2426		150/100-102DT	45.4026
10-11	41/10-11DT	45.1010	46-48	82/46-48DT	45.2427		150/102-104DT	45.4027
11-12	41/11-12DT	45.1011	48-50	82/48-50DT	45.2428		150/104-106DT	45.4028
12-14	41/12-14DT	45.1012	50-52	82/50-52DT	45.2429		150/106-108DT	45.4029
14-16	41/14-16DT	45.1013	52-54	82/52-54DT	45.2430		150/108-110DT	45.4030
16-18	41/16-18DT	45.1014	54	82/54DT	45.2431		150/110-112DT	45.4031
18-20	41/18-20DT	45.1015	12-13	82/2x12-13DT	45.2441		150/112-114DT	45.4032
20	41/20	40.1016	13-14	82/2x13-14DT	45.2442		150/114DT	45.4033
6-7	41/2x6-7DT	45.1026	14-15	82/2x14-15DT	45.2443	<p>* Note: With the largest pipe diameter to be ducted there is limited space between the hole in the retainer ring and the ducted pipe. Care has to be taken for adequate fixation.</p> <p>* Note: The functionality of the DYNATITE® system can be guaranteed only by application of the the DYNATITE® plugs in the DYNATITE® conduit sleeves. Application of DYNATITE® plugs cannot be guaranteed in other conduit systems.</p> 		
7	41/2x7DT	45.1027	15-16	82/2x15-16DT	45.2444			
14-16	55/14-16DT	45.1411	16-17	82/2x16-17DT	45.2445			
16-18	55/16-18DT	45.1412	17-18	82/2x17-18DT	45.2446			
18-20	55/18-20DT	45.1413	18-19	82/2x18-19DT	45.2447			
20-22	55/20-22DT	45.1414	19-20	82/2x19-20DT	45.2448			
22-24	55/22-24DT	45.1415	20	82/2x20	45.2449			
24-26	55/24-26DT	45.1416	10-11	82/3x10-11DT	45.2456			
26-28	55/26-28DT	45.1417	11-12	82/3x11-12DT	45.2457			
28	55/28	45.1418	12	82/3x12DT	45.2458			
6-7	55/2x6-7DT	45.1431	40-42	100/40-42DT	45.2820			
7-8	55/2x7-8DT	45.1432	42-44	100/42-44DT	45.2821			
8-9	55/2x8-9DT	45.1433	44-46	100/44-46DT	45.2822			
9-10	55/2x9-10DT	45.1434	46-48	100/46-48DT	45.2823			
10	55/2x10DT	45.1435	48-50	100/48-50DT	45.2824			
20-22	70/20-22DT	45.2014	50-52	100/50-52DT	45.2825			
22-24	70/22-24DT	45.2015	52-54	100/52-54DT	45.2826			
24-26	70/24-26DT	45.2016	54-56	100/54-56DT	45.2827			
26-28	70/26-28DT	45.2017	56-58	100/56-58DT	45.2828			
28-30	70/28-30DT	45.2018	58-60	100/58-60DT	45.2829			
30-32	70/30-32DT	45.2019	60-62	100/60-62DT	45.2830			
32-34	70/32-34DT	45.2020	62-64	100/62-64DT	45.2831			
34-36	70/34-36DT	45.2021	64	100/64DT	45.2832			
36-38	70/36-38DT	45.2022	60-62	125/60-62DT	45.3630			
38-40	70/38-40DT	45.2023	62-64	125/62-64DT	45.3631			
40-42	70/40-42DT	45.2024	64-66	125/64-66DT	45.3632			
42	70/42DT	45.2025	66-68	125/66-68DT	45.3633			
			68-70	125/68-70DT	45.3634			



## DYNATITE® SEALING PLUGS IN COMBINATION WITH DYNATITE® CONDUIT SLEEVES FOR HIGH PRESSURE RATINGS

Note: DYNATITE® conduit sleeves for welding into the construction available also.




1) When DYNATITE® conduit sleeves for bolting are going to be used, anchor bolts have to be provided in the wall/floor in accordance with the hole configuration of the flange of the conduit sleeve.



2) A fitting NOFIRNO® gasket is placed over the threaded ends against the wall/floor. The DYNATITE® conduit sleeve can then be positioned. Avoid excessive forces on tightening of the NOFIRNO® gasket to guarantee tightness on long term.

Note: the pipe/heavy cable has to be ducted straight and centrally!

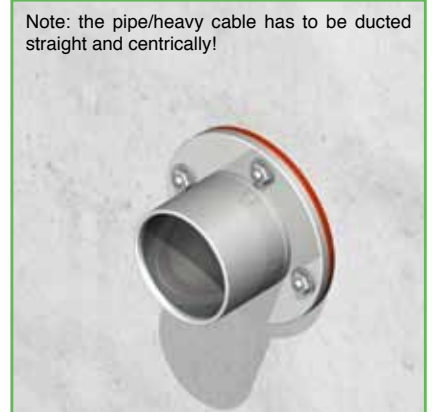

3) Once the DYNATITE® conduit sleeve is fixed against the wall/floor, the pipe/cable can be passed through. Before starting the installation procedure, any dirt or oil residues should be removed from the conduit sleeve.

Always use sufficient lubricant to avoid installation problems.



4) The inside wall of the conduit sleeve is treated with CSD® lubricant over its full length. The inlet of the DYNATITE® conduit sleeve is rounded off to avoid any damages to the plug during insertion.



5) The inside surfaces of both segments of the DYNATITE® sealing plug are then treated with CSD® lubricant. *For selecting the right sealing plug, look for the plug series and the plug type in this series on the basis of the ID of the sleeve and the OD of the ducted pipe.*

Always use sufficient lubricant to avoid installation problems.



6) The segments of the DYNATITE® sealing plug are also treated with CSD® lubricant on the outside.

Please refer to the Safety Data Sheet of the CSD® lubricant for more information.

The plugs can also be tapped in using a hammer and a piece of wood.




7) Both segments of the DYNATITE® sealing plug are placed around the ducted pipe, then pushed into the conduit sleeve as far as the first serration. Both halves are then pushed by hand evenly, further into the conduit sleeve.

Note: tightness guaranteed only when applied in DYNATITE® conduit sleeves.



8) The front side of the sealing plug must be flush with the front side of the conduit sleeve. This proves that the back side of the plug is positioned against the shoulder inside the conduit sleeve.

The front side of the plug is clearly marked with the DYNATITE® logo.

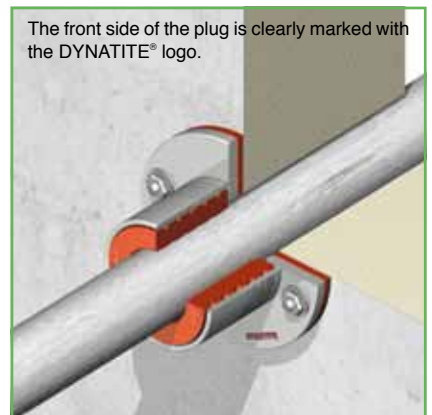

9) The DYNATITE® system has to be installed with its face on the side of the boundary that will be exposed to pressure. For pressure loads from both sides, DYNATITE® conduit sleeves must be installed at both sides of the wall.

## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR NEW AND EXISTING MULTI-CABLE PENETRATIONS

### RISWAT® cable sleeves



*cable sleeves are supplied split lengthwise*

RISWAT® sleeves are made from a specially developed extrudable thermoplastic which offers sufficient stiffness to enable ease of insertion. RISWAT® sleeves have a clearly recognizable blue colour to ensure that they are easily distinguishable from the NOFIRNO® sleeves which are used for fire-resistant conduits. RISWAT® sleeves are supplied in lengths of 60, 80, 110, 140 and 160 mm. They are also available in lengths of 500 and 1000 mm. They can be cut to length as required on the construction site. RISWAT® cable sleeves are split lengthwise to facilitate fitting them around cables which are already in place. The wall thickness of sleeves is so chosen to ensure sufficient separation of the cables to facilitate application of the DRIFIL®, FIWA® or NOFIRNO® sealant. RISWAT® filler sleeves are not split lengthwise.

*The article numbers for the cable sleeves 500 mm long are 80.3200 and following; for the cable sleeves 1000 mm long 80.3220 and following.*

RISWAT® cable sleeve	cable diameter	sleeve length	article number
12/6	5 - 7	160	80.3120
14/8	7 - 9	160	80.3121
16/10	9 - 11	160	80.3122
18/12	11 - 13	160	80.3123
20/14	13 - 15	160	80.3124
22/16	15 - 17	160	80.3125
27/19	17 - 21	160	80.3126
31/23	21 - 25	160	80.3127
35/27	25 - 29	160	80.3128
39/31	29 - 33	160	80.3129
46/36	33 - 39	160	80.3130
52/42	39 - 45	160	80.3131
58/48	45 - 51	160	80.3132
64/54	51 - 57	160	80.3133
70/60	57 - 63	160	80.3134

*all dimensions in mm*

RISWAT® cable sleeve	cable diameter	sleeve length	article number
12/6	5 - 7	60	80.3000
14/8	7 - 9	60	80.3001
16/10	9 - 11	60	80.3002
18/12	11 - 13	60	80.3003
20/14	13 - 15	60	80.3004
22/16	15 - 17	60	80.3005
27/19	17 - 21	60	80.3006
31/23	21 - 25	60	80.3007
35/27	25 - 29	60	80.3008
39/31	29 - 33	60	80.3009
46/36	33 - 39	60	80.3010
52/42	39 - 45	60	80.3011
58/48	45 - 51	60	80.3012
64/54	51 - 57	60	80.3013
70/60	57 - 63	60	80.3014
12/6	5 - 7	80	80.3020
14/8	7 - 9	80	80.3021
16/10	9 - 11	80	80.3022
18/12	11 - 13	80	80.3023
20/14	13 - 15	80	80.3024
22/16	15 - 17	80	80.3025
27/19	17 - 21	80	80.3026
31/23	21 - 25	80	80.3027
35/27	25 - 29	80	80.3028
39/31	29 - 33	80	80.3029
46/36	33 - 39	80	80.3030
52/42	39 - 45	80	80.3031
58/48	45 - 51	80	80.3032
64/54	51 - 57	80	80.3033
70/60	57 - 63	80	80.3034
12/6	5 - 7	110	80.3060
14/8	7 - 9	110	80.3061
16/10	9 - 11	110	80.3062
18/12	11 - 13	110	80.3063
20/14	13 - 15	110	80.3064
22/16	15 - 17	110	80.3065
27/19	17 - 21	110	80.3066
31/23	21 - 25	110	80.3067
35/27	25 - 29	110	80.3068
39/31	29 - 33	110	80.3069
46/36	33 - 39	110	80.3070
52/42	39 - 45	110	80.3071
58/48	45 - 51	110	80.3072
64/54	51 - 57	110	80.3073
70/60	57 - 63	110	80.3074
12/6	5 - 7	140	80.3100
14/8	7 - 9	140	80.3101
16/10	9 - 11	140	80.3102
18/12	11 - 13	140	80.3103
20/14	13 - 15	140	80.3104
22/16	15 - 17	140	80.3105
27/19	17 - 21	140	80.3106
31/23	21 - 25	140	80.3107
35/27	25 - 29	140	80.3108
39/31	29 - 33	140	80.3109
46/36	33 - 39	140	80.3110
52/42	39 - 45	140	80.3111
58/48	45 - 51	140	80.3112
64/54	51 - 57	140	80.3113
70/60	57 - 63	140	80.3114

*all dimensions in mm*





# RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR NEW AND EXISTING MULTI-CABLE PENETRATIONS

RISWAT® filler sleeve	sleeve length	article number
18/12 single	60	80.3018
18/12 multi (NOFIRNO®)	60	80.5050
18/12 single	80	80.3038
18/12 single	110	80.3078
18/12 multi (NOFIRNO®)	110	80.5051
18/12 single	140	80.3118
18/12 multi (NOFIRNO®)	140	80.5052
18/12 single	160	80.3138
18/12 multi (NOFIRNO®)	160	80.5053
18/12 single	500	80.3218
18/12 single	1000	80.3238

all dimensions in mm

RISWAT® filler sleeve	sleeve length	article number
27/19 single	60	80.3019
27/19 multi (NOFIRNO®)	60	80.5060
27/19 single	80	80.3039
27/19 single	110	80.3079
27/19 multi (NOFIRNO®)	110	80.5061
27/19 single	140	80.3119
27/19 multi (NOFIRNO®)	140	80.5062
27/19 single	160	80.3139
27/19 multi (NOFIRNO®)	160	80.5063
27/19 single	500	80.3219
27/19 single	1000	80.3239

all dimensions in mm



## PRODUCT INFORMATION SEALANT

- |                         |   |
|-------------------------|---|
| 01) colour              | dark blue   |
| 02) specific gravity    | 1.40 ± 0.03 g/cm³   |
| 03) curing of top layer | 0.5 - 1 hour depending on temperature and air humidity  |
| 04) service temperature | -50 °C up to +180 °C  |
| 05) tensile strength    | 0.95 MPa  |
| 06) elongation at break | 375%  |
| 07) hardness            | 35 Shore A  |
| 08) elastic deformation | approx. 75%   |
| 09) resistance          | UV, Ozone, arctic conditions  |
| 10) ageing              | more than 20 years  |
| 11) supplied in         | 310 ml cartridges   |
| 12) storage             | to be stored cool and dry<br>min/max temperature = +5/+30° C  |
| 13) storage life        | guaranteed 6 months; when applied later than 6 months after date of manufacturing, curing and adhesive properties have to be checked before application |

## PRODUCT INFORMATION SEALANT

- |                         |   |
|-------------------------|---|
| 01) colour              | dark grey   |
| 02) specific gravity    | 1.30 ± 0.03 g/cm³   |
| 03) curing of top layer | 0.5 - 1 hour depending on temperature and air humidity  |
| 04) service temperature | -50 °C up to +160 °C  |
| 05) tensile strength    | 1.15 MPa  |
| 06) elongation at break | 125%  |
| 07) hardness            | 35 Shore A  |
| 08) elastic deformation | approx. 25%   |
| 09) resistance          | UV, Ozone, arctic conditions  |
| 10) ageing              | more than 20 years  |
| 11) supplied in         | 310 ml cartridges   |
| 12) storage             | to be stored cool and dry<br>min/max temperature = +5/+30° C  |
| 13) storage life        | guaranteed 6 months; when applied later than 6 months after date of manufacturing, curing and adhesive properties have to be checked before application |



article number 80.0920

DRIFIL® is a paste-like, halogen free compound which is simple to use. DRIFIL® has a balanced viscosity and can be applied overhead.

After applying the sealant, it can be smoothed by means of a wet cloth or by hand. Because the sealant adheres very tightly, the cloth and hands should be wetted with water before use to prevent sealant from sticking to them.

Shelf life is 12 months when stored properly. Since we have no control on storage, we can only guarantee for 6 months.




article number 80.0900

FIWA® is a paste-like, halogen free compound (tested according to Naval Engineering Standard NES 713: Issue 3). Furthermore FIWA® has a low smoke index (NES 711: Issue 2: 1981) and a high oxygen index (ISO 4589-2: 1996), and low flame spread characteristics according to IMO Resolution A.653(16).

Shelf life is 12 months when stored properly. Since we have no control on storage, we can only guarantee for 6 months.

## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR NEW AND EXISTING MULTI-CABLE PENETRATIONS

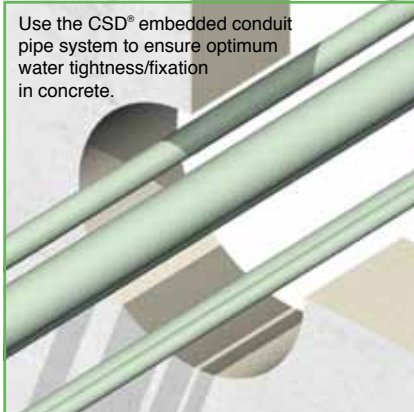


Use the CSD® embedded conduit pipe system to ensure optimum water tightness/fixation in concrete.

1) The cables can be ducted through the conduit opening in random order. It is most important that they are not pulled too tight so as not to hamper their separation when RISWAT® insert sleeves are inserted.




The DRIFIL® sealant adheres very well to the most common substrates. Check the adhesion properties especially in case of watertight penetrations.

2) After the cables have been ducted, RISWAT® insert sleeves are applied around each cable. The insert sleeves are split lengthwise and can therefore be placed around the cables in front of the conduit.

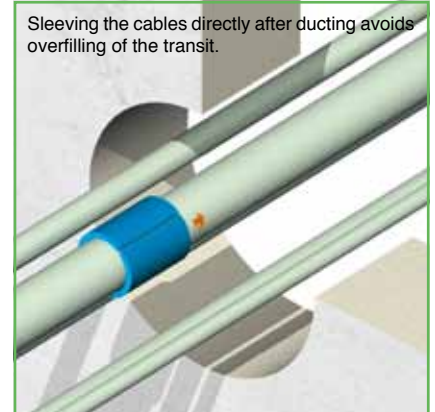

Sleeving the cables directly after ducting avoids overfilling of the transit.

3) The insert sleeves are primarily used for separation of the cables to enable to apply the sealant. An exact fit is for this reason not required. Push the sleeves into the conduit in such a way as to leave about 20 mm free space at the front and back.

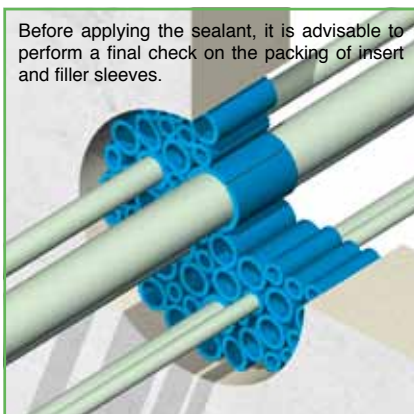

Before applying the sealant, it is advisable to perform a final check on the packing of insert and filler sleeves.

4) The remaining free space in the conduit is filled with RISWAT® filler sleeves type 27/19 and 18/12. The whole set of insert and filler sleeves should fit tightly into the conduit to provide sufficient mechanical stability.



Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.

5) A 20 mm thick layer of DRIFIL® sealant is applied at each side of the conduit. Clean and dry the conduit opening and the cables thoroughly, and remove any dirt, rust or oil residues before applying the sealant.



People with sensitive skin should use gloves when working with DRIFIL®. Please refer to the Safety Data Sheet for more information.

6) The conduit should be overfilled with DRIFIL® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



7) To smooth the surface of the DRIFIL® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!



8) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with DRIFIL®. Please refer to the Safety Data Sheet for more information.



People with sensitive skin should use gloves when working with DRIFIL®.

9) The surface can be further smoothed by hand. Just wet the hand thoroughly with soap and water. No dirty hands when working with DRIFIL® and a very neat surface is the result.




## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR NEW AND EXISTING MULTI-CABLE PENETRATIONS

To obtain optimum adhesion during the curing process of the sealant, the cables should be tightly fixed immediately after finishing the transit.




10) After smoothing is finished, a last check should be taken to ensure sealant is applied in between the cables, especially at penetrations with larger amounts of cables.

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

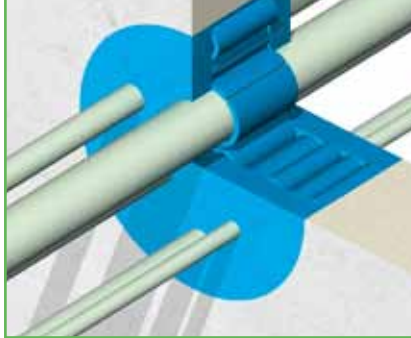

11) For optimum gas and water tightness it is advisable to apply at both sides of the penetration a 20 mm thick layer of the DRIFIL® sealant.

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

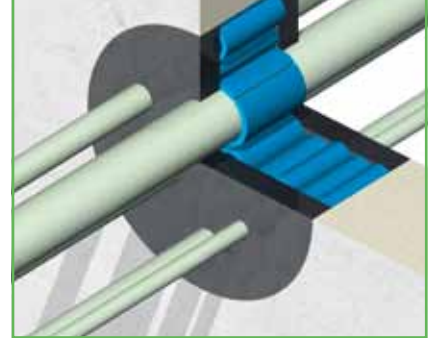

12) For optimized mechanical stability and to obtain higher pressure ratings, FIWA® or NOFIRNO® sealant can be used in place of DRIFIL® sealant. NOFIRNO® sealant has optimum mechanical properties.

Before applying the sealant, it is advisable to perform a final check on the packing of insert and filler sleeves.



Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.

13) For vertical conduits it is advisable to select the insert sleeves a bit undersized. They will then cling to the ducted cables in such a way to prevent them from sliding down.

People with sensitive skin should use gloves when working with DRIFIL®. Please refer to the Safety Data Sheet for more information.




14) The optimized viscosity and the superb adhesion properties of the DRIFIL® sealant make applying the sealant overhead an easy matter. DRIFIL® sealant does not sag and will not drip off.


Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.



15) The conduit should be overfilled with DRIFIL® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.

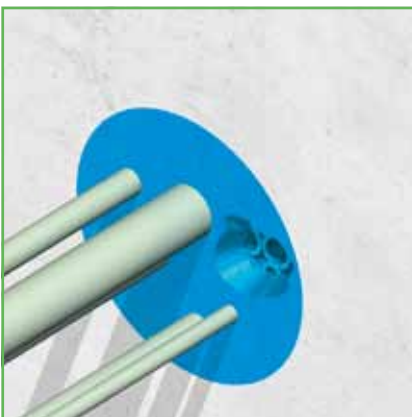

16) Adding extra cables is an easy job. Cut away the sealant layer at both sides of the penetration with a knife or a hollow punch in a tapering shape as shown above. This creates a good foundation for the sealant to be applied later.

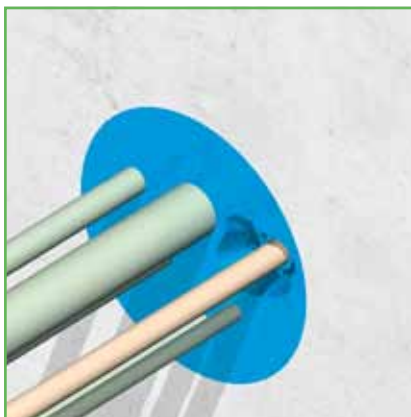

17) Pull the cable through one of the empty filler sleeves with an inner diameter more or less corresponding to the outer diameter of the cable. Or remove one or more RISWAT® filler sleeves to create a fitting opening for the cable to be ducted.

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.




18) Place in this case a RISWAT® sleeve around the newly ducted cable. Push the insert sleeve into the conduit. Refill the opening in the sealant layer at both sides of the penetration with sufficient DRIFIL® sealant.




## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR NEW AND EXISTING (MULTI-) PIPE PENETRATIONS

Note: maximum continuous service temperature of the RISWAT® sleeves not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

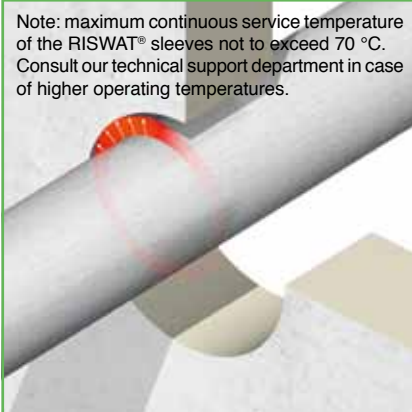

1) The pipe(s) can be ducted through the conduit opening off centre. Sufficient space to accommodate the RISWAT® sleeves must remain everywhere between the pipe(s) and the wall of the conduit opening.

For pipe penetrations, only filler sleeves to be applied.

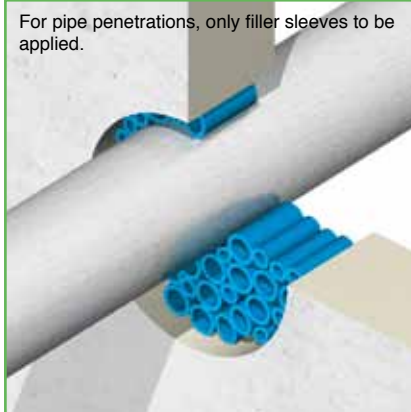

2) The remaining free space in the conduit is filled with RISWAT® filler sleeves type 27/19 and 18/12. Push the sleeves into the conduit opening in such a way as to leave at least about 20 mm free space at the front and back.

Before applying the sealant, it is advisable to perform a final check on the packing of filler sleeves.



3) The sleeves should fill the entire conduit opening. The whole set of insert and filler sleeves should fit tightly into the conduit to provide sufficient mechanical stability.

Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.



Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C.

4) A 20 mm thick layer of DRIFIL® sealant is applied at each side of the conduit. Clean and dry the conduit opening and the surface of the ducted pipe thoroughly, and remove any dirt, rust or oil residues before applying the sealant.

People with sensitive skin should use gloves when working with DRIFIL®.



Please refer to the Safety Data Sheet for more information.

5) The conduit should be overfilled with DRIFIL® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



6) To smooth the surface of the DRIFIL® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!




7) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with DRIFIL®. Please refer to the Safety Data Sheet for more information.

People with sensitive skin should use gloves when working with DRIFIL®.



8) The surface can be further smoothed by hand. Just wet the hand thoroughly with soap and water. No dirty hands when working with DRIFIL® and a very neat surface is the result.


Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

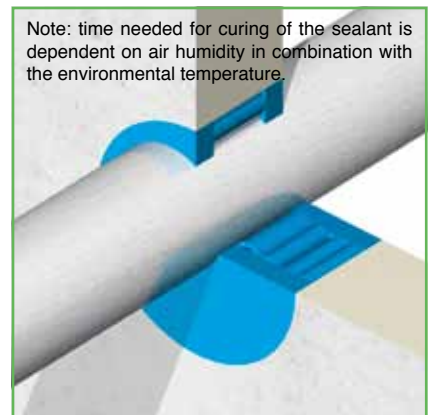

9) For optimum gas and water tightness it is advisable to apply at both sides of the penetration a 20 mm thick layer of the DRIFIL® sealant. FIWA® or NOFIRNO® sealant can be used instead of DRIFIL® sealant.




## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR EXISTING MULTI-CABLE PENETRATIONS

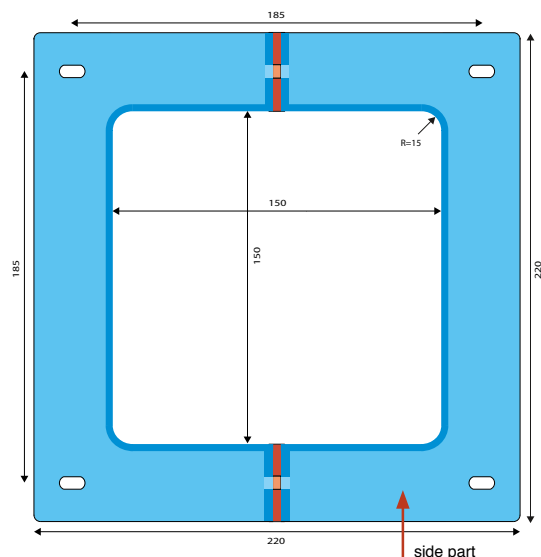

In many instances, it may be impossible to remove the leaking penetration seal through which cables or pipes have been ducted. For this purpose, the CSD® split frames have been developed. The sections of the frame can be placed around the ducted cables/pipes and connected to each other by placing a NOFIRNO® gasket between the flanges and bolted together. The frame is then fixed to the wall with a NOFIRNO® split gasket between the frame and the wall. With the developed intermediate parts, multi-frames can be assembled to larger sizes.

After the frame has been installed, the RISWAT® sealing system can be applied. The depth of the frames is 80 mm which accommodates 60 mm RISWAT® insert and filler sleeves. The remaining 20 mm is used for applying a 20 mm layer of either either DRIFIL® or NOFIRNO® sealant.

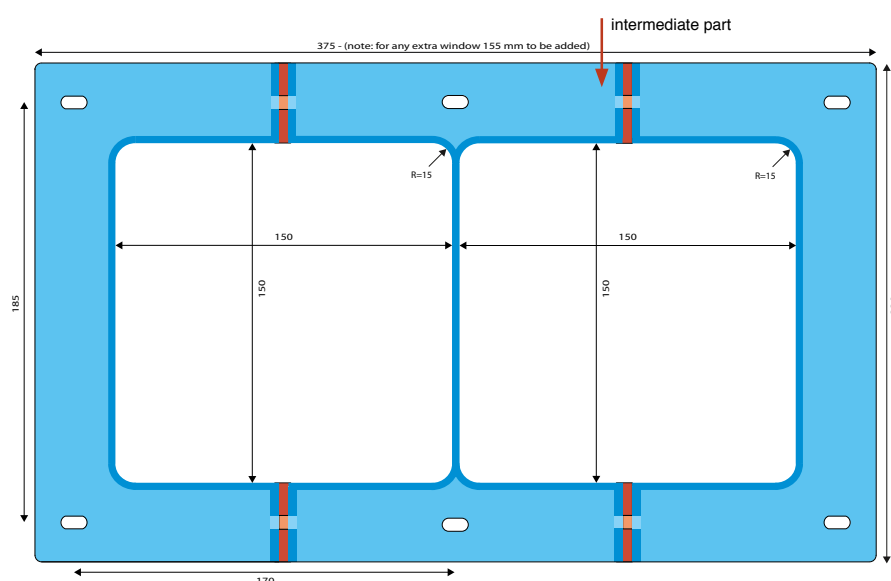


side part frame	60.9300
intermediate part	60.9301
frame 1x150 complete	60.9310
frame 2x150 complete	60.9311
frame 3x150 complete	60.9312

gasket flanges	51.9300
gasket side part 1x150	51.9301
gasket side part nx150	51.9302
extension gasket nx150	51.9303

gasket 1x150 complete	51.9310
gasket 2x150 complete	51.9311
gasket 3x150 complete	51.9312

The CSD® split flanged frames are made of an impact resistant plastic. The design is modular and can be easily assembled to multi-bay units for larger existing penetrations. Frames with an internal dimension of 250 mm are in development.

The NOFIRNO® rubber has excellent weathering properties, UV and Ozone resistance and long term behaviour. The NOFIRNO® gaskets have a special profiling to exclude the need for excessive compression and the need for retightening from time to time.

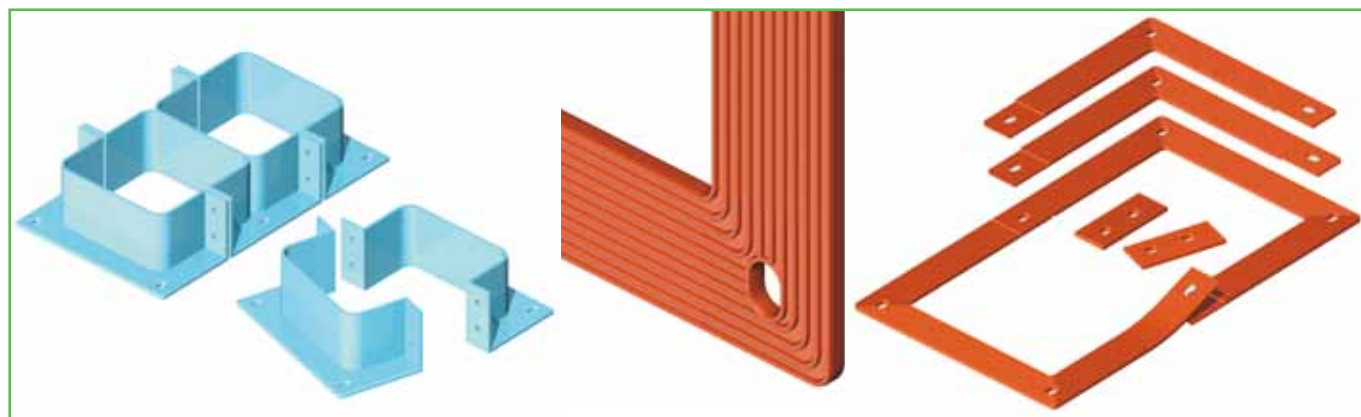


## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR EXISTING MULTI-CABLE PENETRATIONS



1) Occasionally it is impossible to remove an existing seal in an opening. In this case, just remove the protruding portion of the seal and utilize a CSD® split flanged frame and the RISWAT® system.




2) If there are large irregularities in the wall around the opening, they should be locally smoothed with DRIFIL® or NOFIRNO® sealant. NOFIRNO® sealant has highest mechanical properties.

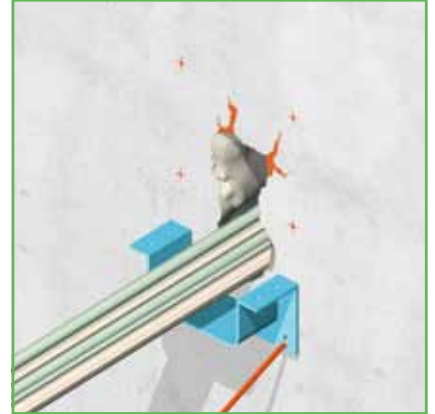


3) The CSD® split flanged frames are made of impact resistant plastic. Attachment holes are marked off on the wall or floor, corresponding to the pattern of holes in the CSD® split flanged frame.




4) After drilling the attachment holes and positioning the anchoring bolts, place the NOFIRNO® gasket parts over the anchoring bolts against the wall.

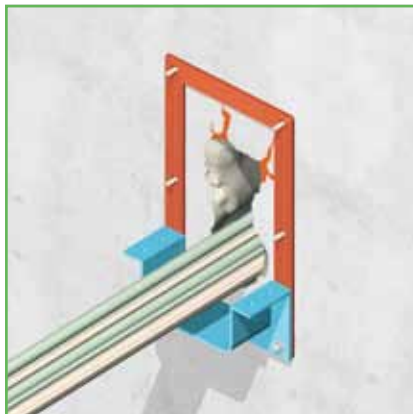


5) The split flanged frame is disassembled, and the lower part secured finger-tight against the wall. Both the CSD® frames and NOFIRNO® gaskets have oval holes for ease of adjustment.

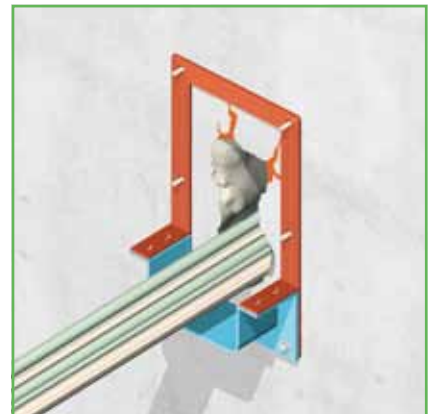


6) Place the NOFIRNO® gaskets on the connector flanges of the CSD® split flanged frame.

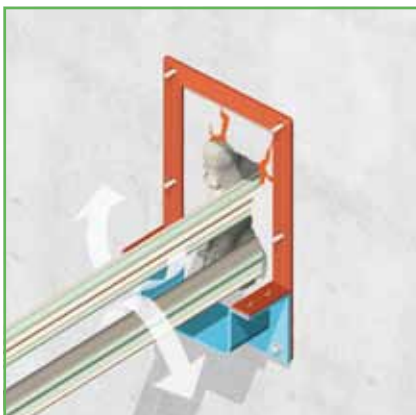

7) If utilizing multi-bay frames, separate the cables and place them in the bay where watertight sealing is most easiest. This may depend on the play in the cable set.

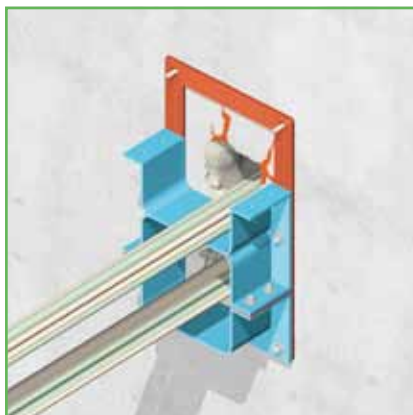

8) Position the intermediate element of the frame over the anchor bolts against the wall, and then fix the element to the previously positioned frame. Secure the intermediate element finger-tight against the wall.

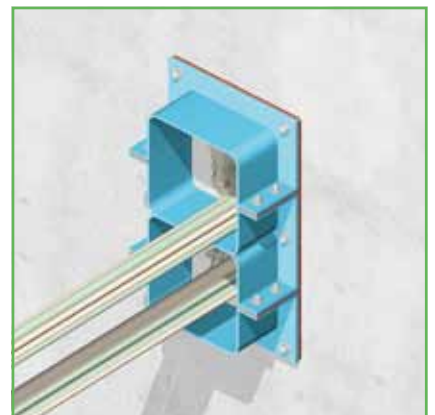


9) In the same way, place the upper part on the intermediate part. Tighten the bolts on the connector flanges. Note: no excessive forces needed. Finally, all the nuts on the anchoring bolts should be firmly tightened.






## RISWAT® GAS & WATERTIGHT SEALING SYSTEM FOR EXISTING MULTI-CABLE PENETRATIONS



10) RISWAT® insert sleeves are applied around each cable. The insert sleeves are split lengthwise. Push the sleeves into the frame in such a way as to leave about 20 mm free space at the front.

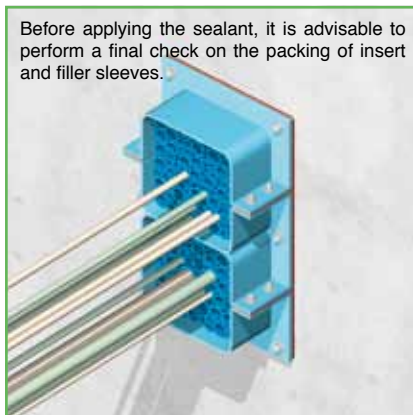


Before applying the sealant, it is advisable to perform a final check on the packing of insert and filler sleeves.

11) The remaining free space in the conduit is filled with RISWAT® filler sleeves type 27/19 and 18/12. The whole set of insert and filler sleeves should fit tightly into the conduit to provide sufficient mechanical stability.



Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.

12) A 20 mm thick layer of DRIFIL® sealant is applied. Clean and dry the conduit opening and the cables thoroughly, and remove any dirt, rust or oil residues before applying the sealant.




The DRIFIL® sealant adheres very well to the most common substrates. Check the adhesion properties especially in case of watertight penetrations.

13) The conduit should be overfilled with DRIFIL® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



People with sensitive skin should use gloves when working with DRIFIL®.

14) To smooth the surface of the DRIFIL® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!

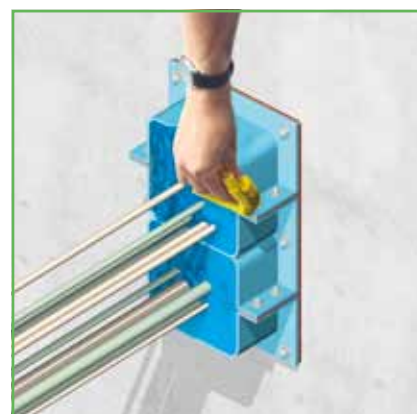


15) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with DRIFIL®. Please refer to the Safety Data Sheet for more information.




People with sensitive skin should use gloves when working with DRIFIL®.

16) The surface can be further smoothed by hand. Just wet the hand thoroughly with soap and water. No dirty hands when working with DRIFIL® and a very neat surface is the result.

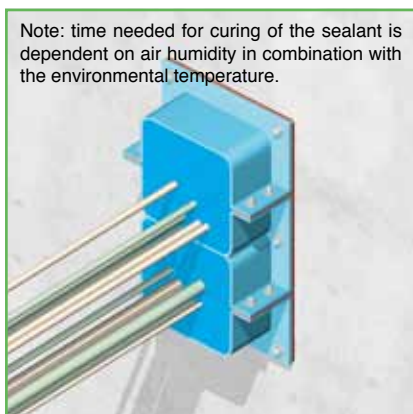

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.


17) After smoothing is finished, a last check should be taken to ensure sealant is applied in between the cables, especially in penetrations with larger amounts of cables. For adding cables see page 29.

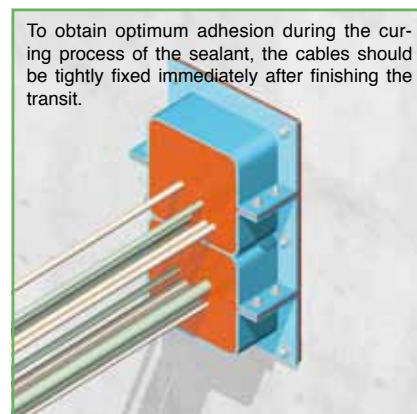



To obtain optimum adhesion during the curing process of the sealant, the cables should be tightly fixed immediately after finishing the transit.

18) For optimized mechanical stability and to obtain higher pressure ratings, NOFIRNO® sealant can be used in place of DRIFIL® sealant. NOFIRNO® sealant has optimum mechanical properties.



## RISWAT® GAS & WATERTIGHT MULTI-CABLE TRANSIT SEALING SYSTEM

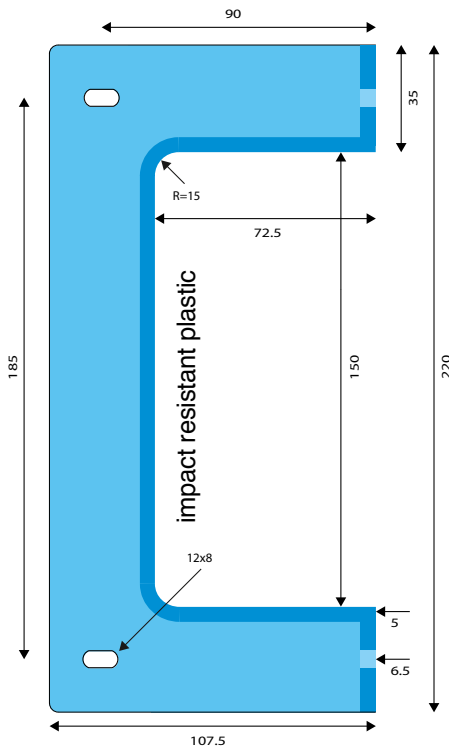


CSD® split flanged frames:  
top: side part of single bay frames  
bottom: intermediate part for multi-bay frames (one or more intermediate parts to be used for larger frame combinations).

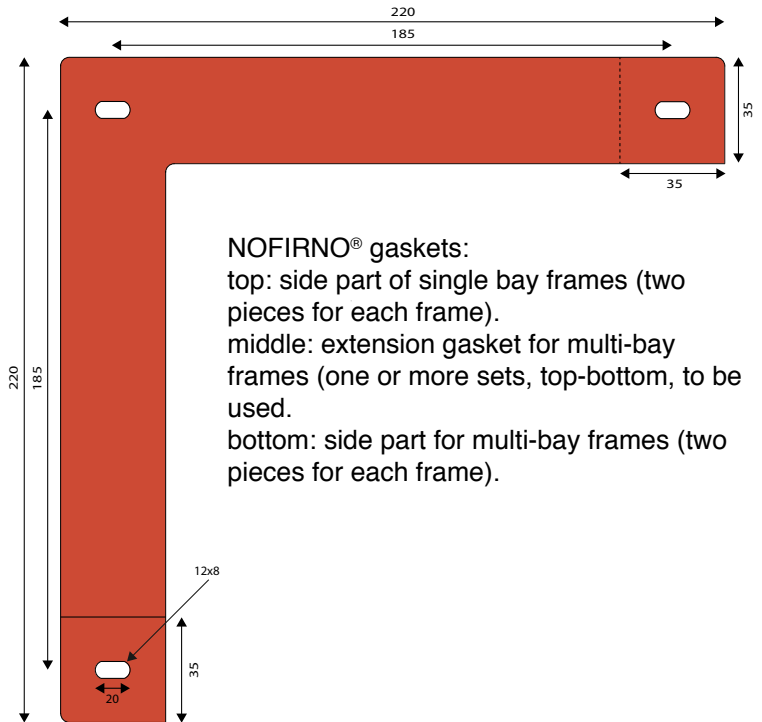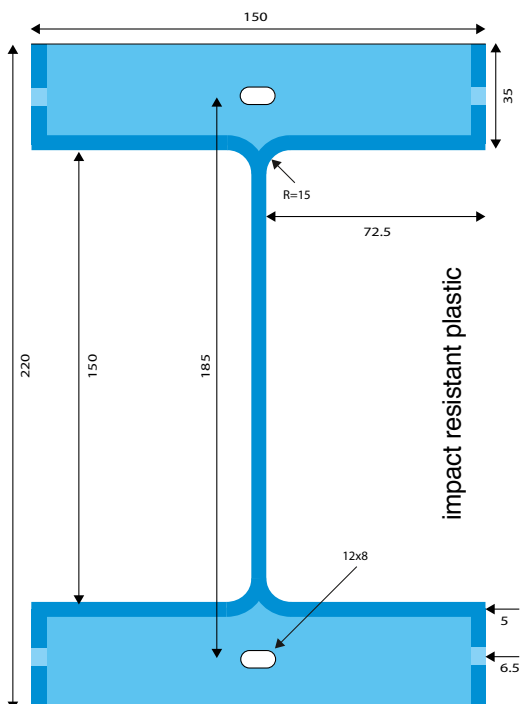

NOFIRNO® gaskets:  
top: side part of single bay frames (two pieces for each frame).  
middle: extension gasket for multi-bay frames (one or more sets, top-bottom, to be used).  
bottom: side part for multi-bay frames (two pieces for each frame).

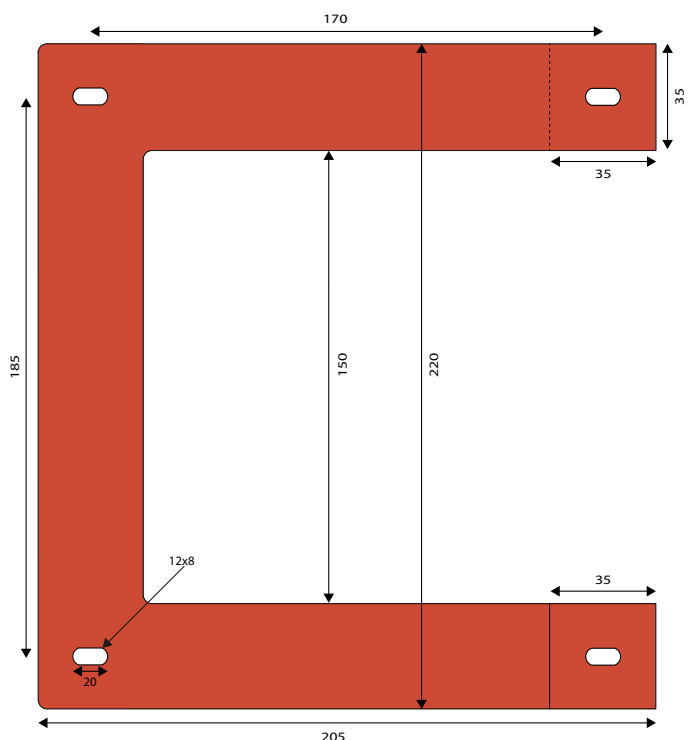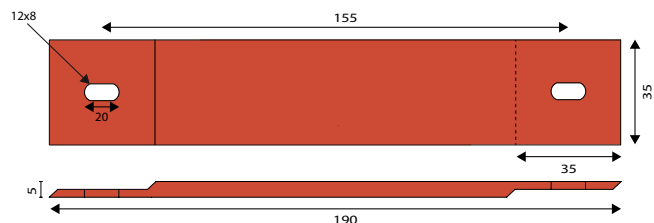



## AQUASTOP® WATERTIGHT SEALING SYSTEM FOR EXISTING, LEAKING CONDUITS



*It is self-evident that water leakages must be prevented under all circumstances. After all, leaking water means not only a nuisance but in most cases damage as well. Although no exact figures are known, it is safe to say that the corrosion damage caused every year by leaking cable and pipe entries runs into hundreds of millions of dollars. Therefore, a great deal of effort goes into minimizing the effects of water leakage. Preventing leaking conduits is an absolute must.*

***We have the products and systems for it, however .....***

Leaking conduits are a problem in many buildings/installations when ducting pipes underground. Attempts are made to stop the water leakage, but most often without any success. We can see the effects of leaks almost daily around us. However, we generally forget that a corrosion process is slowly but surely affecting the structure and equipment concerned. The corrosion damage caused by such conduits can be substantial. Secondary drawbacks are that moist spaces are generally accompanied by a mouldy atmosphere, fungus growth and a proliferation of vermin.

BEELE Engineering has developed three solutions to stop the water leakage in buildings and installations:

- 1) in case the ground water can be pumped away outside the building, the contents of the existing conduit sealing system can be removed and the regular RISWAT® system can be applied in the wall opening.
- 2) in case the existing sealing system cannot be removed and the leakage occurs only during heavy rainfall, for cable and small bore pipe penetrations the RISWAT® system can be applied against the wall by making use of the split, modular frames at the time there is no leakage.
- 3) in most cases, however, it is impossible to work outside the building and the repair work has to be carried out under leaking conditions. In this case it is better to leave as much of the existing material in place and make space available for the application of the AQUASTOP® rubber and the NOFIRNO® or DRIFIL® sealant.

To obtain mechanical stability and tightness over an extended service life, the AQUASTOP® filling is finished with a layer of sealant.



For existing, leaking conduits in buildings and installations as described under 3), the AQUASTOP® mouldable rubber has been developed by the engineers of BEELE Engineering. The AQUASTOP® mouldable rubber is made of a silicone polymer to offer the market an inert material which does not pollute the ground water.

The rubber is very sticky and can be applied on wet surfaces. The rubber can be moulded by hand in the shape required for the repair work.



**article number 80.0940**



## AQUASTOP® WATERTIGHT SEALING SYSTEM FOR EXISTING, LEAKING CONDUITS



1) In many cases the last attempt to stop the leakage is the use of foam. Generally, this is only a temporary solution and the leakage might start again after a while.



2) Remove sufficient amount of the existing sealing material to obtain at least 40 mm free space inside the conduit opening. In case this is not feasible, the split, modular frames have to be used.



3) In order to apply the AQUASTOP® system adequately, the corroded pipe has to be cleaned and rust has to be removed. Note: in many cases the corrosion damage is substantial. However, it is a must to clean all corroded spots thoroughly.



4) Locate the place of the leakage before applying the AQUASTOP® mouldable rubber. Note: the rubber is sticky and is for this reason packed in polyethylene plastic. Please refer to the Safety Data Sheet for more information.



People with sensitive skin should use gloves when working with AQUASTOP®.

5) Work from the non-leaking area towards the leaking area when inserting the AQUASTOP® rubber into the wall opening against the existing sealing material.



6) Apply the AQUASTOP® rubber all around the ducted pipe. Most of the leakage might have stopped by this point. Note: to stop water leakages with higher pressures much more AQUASTOP® rubber mass is needed, so more depth is required.



People with sensitive skin should use gloves when working with AQUASTOP®.

7) Start compressing the AQUASTOP® rubber by hand or with the aid of a piece of wood. This is essential to obtain a solid mass of the rubber inside the penetration.




8) To stop the possible last leakages, the AQUASTOP® mouldable rubber is smeared out by hand against the wall of the conduit opening. Take care that there is 20 mm free space left to apply the sealant.




9) Wait a moment to see that the leakage has actually stopped. This is essential for the application of the sealant afterwards. Any moisture will have a negative impact on the adhesion properties of the sealant.





## AQUASTOP® WATERTIGHT SEALING SYSTEM FOR EXISTING, LEAKING CONDUITS

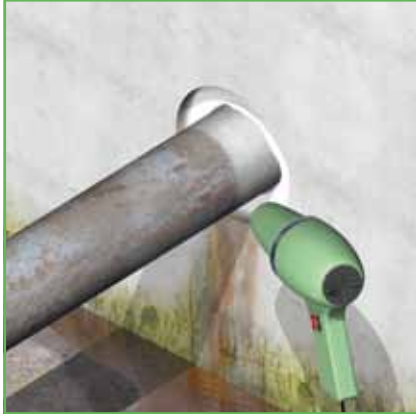

10) With an air blower, the wet surfaces, also that of the AQUASTOP® rubber, are dried properly. Note: a dry surface is needed to obtain optimum adhesion of the sealant.



People with sensitive skin should use gloves when working with the sealants.

11) After drying, remove all dirt and other residues and start applying either the NO-FIRNO® or DRIFIL® sealant. Note: for optimum mechanical stability the sealant should be applied with a layer thickness of 20 mm.



12) Either the NOFIRNO® or DRIFIL® sealant is applied against the AQUASTOP® rubber mass. Both sealants adhere very well to the AQUASTOP® rubber.



13) The surface of the sealant layer is compressed and smoothed with a wet cloth. Note: do not use soap water! Please refer to the Safety Data Sheet for more information.



People with sensitive skin should use gloves when working with the sealants.

14) The surface can be further smoothed by hand. Just wet the hand thoroughly with soap and water. No dirty hands when working with NOFIRNO® and a very neat surface is the result.




Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.


15) For highest mechanical stability it is advisable to use the NOFIRNO® sealant. Note: the pressure ratings of the AQUASTOP® system are lower than those of the regular RISWAT® system.



16) For installations where pipes are exposed to continuous vibration and movements, the DRIFIL® sealant should be used. The cured DRIFIL® sealant has a lower hardness than NOFIRNO® and has a higher flexibility.

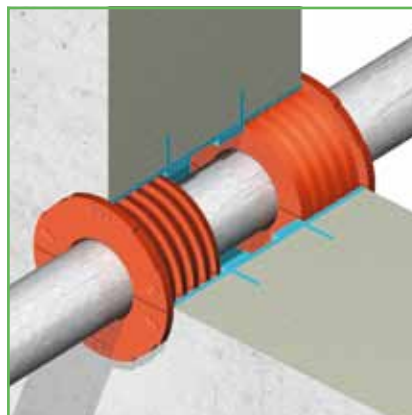


PREVENTION IS BETTER THAN CURE: for proper watertight sealing in new installations use the CSD® embedded conduit inlet system in combination with the SLIPSIL® sealing plugs.

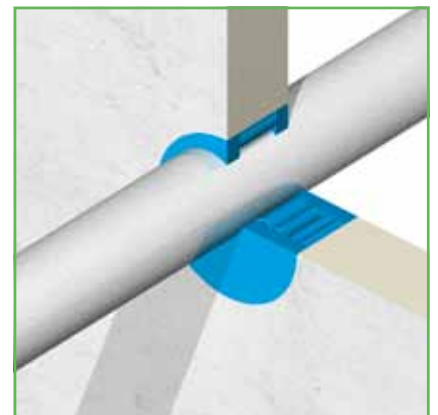


PREVENTION IS BETTER THAN CURE: for proper watertight sealing in new installations use the RISWAT® or NOFIRNO® sealing system.

## AQUASTOP® WATERTIGHT SEALING SYSTEM FOR EXISTING, LEAKING CONDUITS

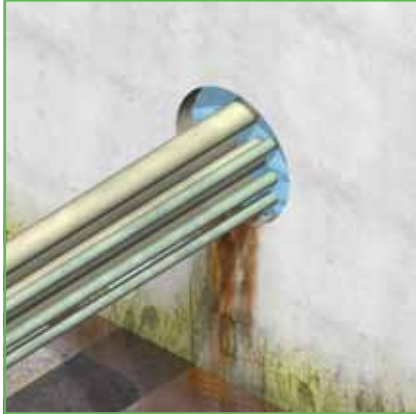


1) Remove sufficient amount of the existing sealing material to obtain at least 40 mm free space inside the conduit opening. In case this is not feasible, the split, modular frames have to be used. The cables have to be cleaned properly to ensure adequate application.

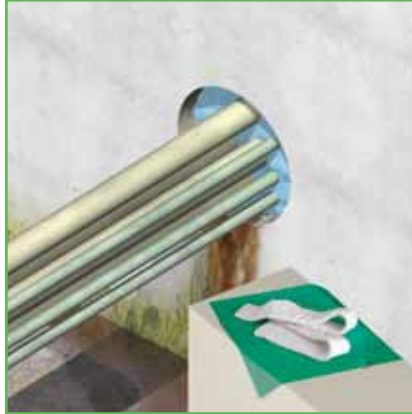

2) Locate the place of the leakage(s) before applying the AQUASTOP® mouldable rubber. Note: the rubber is sticky and is for this reason packed in polyethylene plastic. Please refer to the Safety Data Sheet for more information.



3) Work from the non-leaking area towards the leaking area when inserting the AQUASTOP® rubber into the wall opening against the existing sealing material.

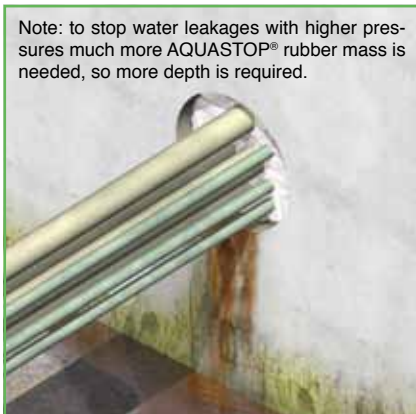

Note: to stop water leakages with higher pressures much more AQUASTOP® rubber mass is needed, so more depth is required.


4) Apply the AQUASTOP® rubber thoroughly all around and in between the ducted cables. Most of the leakage might have stopped by this point.




5) Start compressing the AQUASTOP® rubber by hand or with the aid of a piece of wood. This is essential to obtain a solid mass of the rubber inside the penetration.



6) To stop the possible last leakages, the AQUASTOP® mouldable rubber is smeared out by hand against the wall of the conduit opening. Take care that there is 20 mm free space left to apply the sealant.

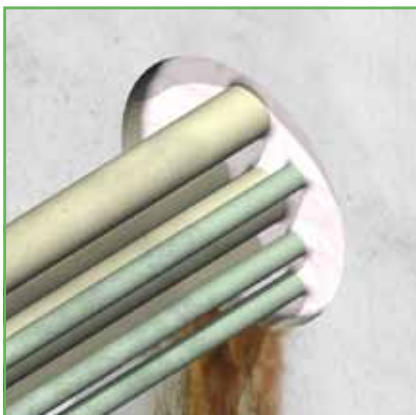

7) Wait a moment to see that the leakage has actually stopped. This is essential for the application of the sealant afterwards. Any moisture will have a negative impact on the adhesion properties of the sealant.

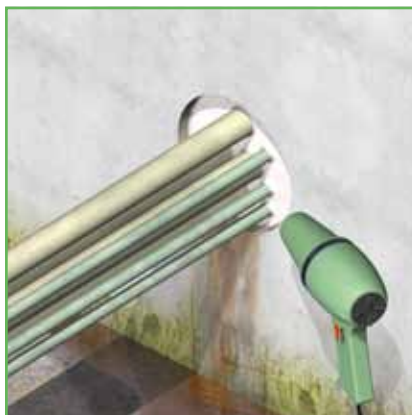

8) With an air blower, the wet surfaces, also that of the AQUASTOP® rubber, are dried properly. Be careful not to damage the cable sheathings. Note: a dry surface is needed to obtain optimum adhesion of the sealant.



9) After drying, remove all dirt and other residues and start applying either the NOFIRNO® or DRIFIL® sealant. Note: for optimum mechanical stability the sealant should be applied with a layer thickness of 20 mm.






## NOFIRNO® (MULTI-) PIPE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

### JET FIRE TEST ACCORDING TO ISO 22899-1:2007 AND ISO/CD 22899-2

Article 6.5 of ISO/CD 22899-2 mentions:

“There are concerns regarding the application and performance of passive fire protection materials and products when subjected to extreme fire events. Limited information is available how passive fire protection materials and products (developed for buildings only to withstand relatively slow build up fire tests such as ISO 834) perform if subjected to a fire exposure significantly more severe.

A fire protection material or system intended to withstand a conventional building fire for a specified period may not perform adequately in an extreme event scenario. Products that have demonstrated the ability to withstand a jet fire can be used to protect buildings more sensitive to extreme fires”.

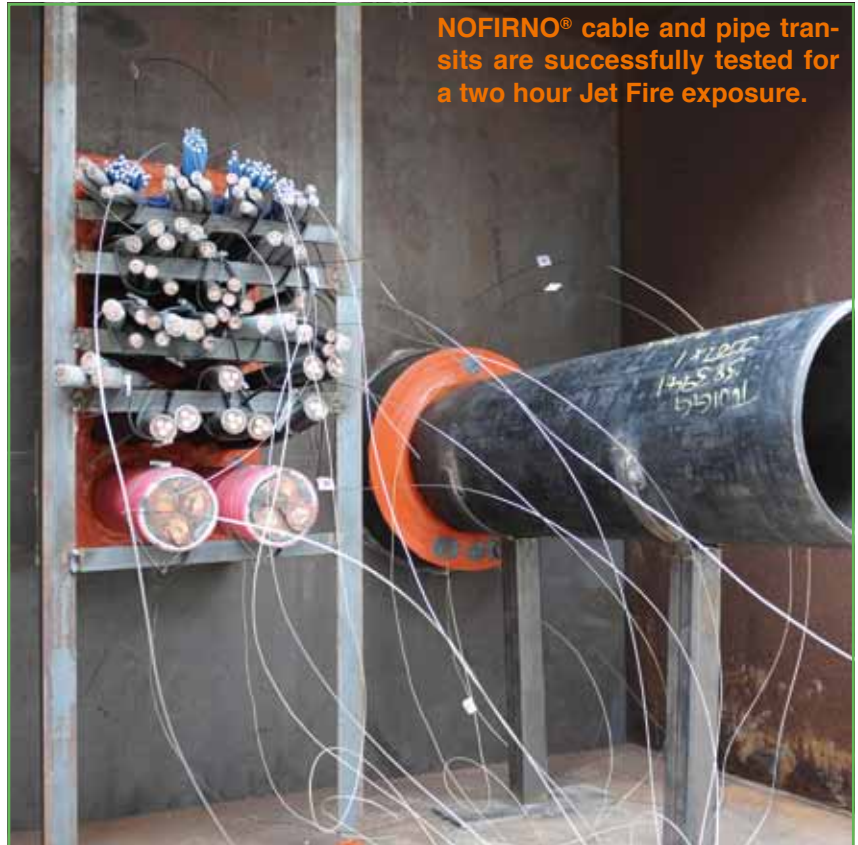


NOFIRNO® cable and pipe transits are successfully tested for a two hour Jet Fire exposure.

Article 9.1 of ISO/CD 22899-2 mentions:

“Whilst hydrocarbon furnace tests are designed to represent a particular type of fire, they do not reproduce the actual fire conditions. Parameters such as: the balance between radiative and convective heat transfer, pressure fluctuations due to turbulence, erosive forces from high gas velocities, thermal shock and differential heating are not reproduced”.

***Jet Fire tests simulate the most onerous conditions of a hydrocarbon fueled fire on an offshore oil rig, or a missile strike on a military warship.***

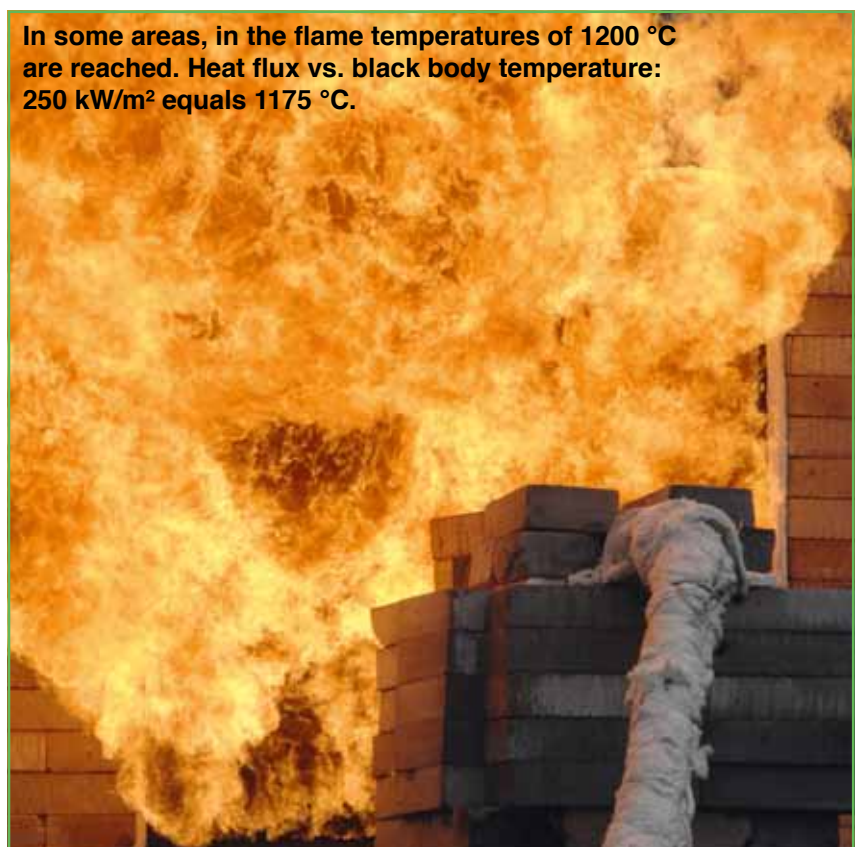

In some areas, in the flame temperatures of 1200 °C are reached. Heat flux vs. black body temperature: 250 kW/m<sup>2</sup> equals 1175 °C.

## NOFIRNO® (MULTI-) PIPE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

### NOFIRNO® filler sleeves



operating temperatures:  
-50 °C up to +180 °C

filler sleeves are supplied non-split

### NOFIRNO® filler sleeve

### sleeve length

### article number

18/12 multi	60	80.5050
18/12 single	110	80.5001
18/12 multi	110	80.5051
18/12 single	140	80.5002
18/12 multi	140	80.5052
18/12 single	160	80.5003
18/12 multi	160	80.5053
18/12 single	210	80.5004
18/12 multi	210	80.5054
<i>all dimensions in mm</i>		
27/19 multi	60	80.5060
27/19 single	110	80.5011
27/19 multi	110	80.5061
27/19 single	140	80.5012
27/19 multi	140	80.5062
27/19 single	160	80.5013
27/19 multi	160	80.5063
27/19 single	210	80.5014
27/19 multi	210	80.5064

Especially for single and multi-pipe penetrations, the multi-filler sleeves offer an advantage when filling the cavity between the conduit sleeve/frame and the ducted pipe. The sets are very flexible and can be wrapped around the ducted pipe. Furthermore, single filler sleeves can be torn off easily. The NOFIRNO® rubber has a good, long lasting memory, enabling a tight fit of the sleeves inside the conduit. This improves the overall mechanical stability of the sealing system during service life.

### NOFIRNO® multi-filler sleeves



filler sleeves can be supplied  
in multi-sets of 10 sleeves

The NOFIRNO® rubber grade has excellent properties and will not be consumed by the fire. The NOFIRNO® sealant immediately forms a protective layer and char when exposed to flames, in this way protecting the filling of the penetration seal.

The thermal insulation is very high because of the air volume inside the penetration. The air is tightly enclosed by the sealant layer at both sides even when one side is exposed to the fire. The NOFIRNO® system has been subjected to A-0, H-0 and even Jet Fires without being severely affected. Due to the superb behaviour of our various systems, the NOFIRNO® sealing system can be easily combined with RISE®. The NOFIRNO® rubber is absolutely HALOGEN FREE (tested according to Naval Engineering Standard NES 713: Issue 3). Furthermore, the NOFIRNO rubber has a low smoke index (NES 711: Issue 2: 1981) and a high oxygen index (ISO 4589-2: 1996).

## PRODUCT INFORMATION SEALANT

- |                         |   |
|-------------------------|---|
| 01) colour              | red brown   |
| 02) specific gravity    | 1.40 ± 0.03 g/cm³   |
| 03) curing of top layer | 0.5 - 1 hour depending on temperature and air humidity  |
| 04) service temperature | -50 °C up to +180 °C  |
| 05) tensile strength    | 1.5 MPa   |
| 06) elongation at break | 200%  |
| 07) hardness            | 45 Shore A  |
| 08) elastic deformation | approx. 50%   |
| 09) resistance          | UV, Ozone, arctic conditions  |
| 10) ageing              | more than 20 years  |
| 11) supplied in         | 310 ml cartridges   |
| 12) storage             | to be stored cool and dry<br>min/max temperature =<br>+5/+30° C   |
| 13) storage life        | guaranteed 6 months; when<br>applied later than 6 months after<br>date of manufacturing, curing<br>and adhesive properties have<br>to be checked before application |



article number 50.0102

*NOFIRNO® is a paste-like compound which is simple to use. NOFIRNO® has a balanced viscosity and can be applied overhead.*


*After applying the sealant, it can be smoothed by means of a wet cloth or by hand. Because the sealant adheres very tightly, the cloth and hands should be wetted with water before use to prevent sealant from sticking to them.*

*Shelf life is 12 months when stored properly. Since we have no control on storage, we can only guarantee for 6 months.*







## NOFIRNO® (MULTI-) PIPE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT



1) The metallic pipe can be passed through the conduit opening in any position, provided there is enough space between the wall of the conduit opening and the ducted pipe (see next at 2). Depth of the conduit for EI90/E120 classification minimum 150 mm.

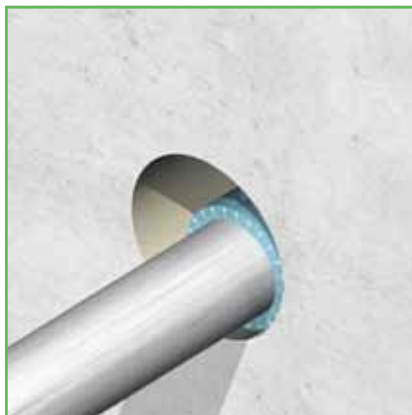


2) Make sure that the minimum space between the pipe and the wall of the conduit opening is in accordance with the minimum allowed distance as certified.



Multi-filler sleeves (set of 10) are available for filling larger empty spaces.

3) The remaining free space in the conduit is filled with NOFIRNO® filler sleeves type 27/19 and 18/12. For ease of filling, the NOFIRNO® filler sleeves are supplied non-split. The ratio 27/19 to 18/12 is maximum 2:1.




Before applying the sealant, it is advisable to perform a final check on the packing of filler sleeves.

4) Push the filler sleeves into the conduit in such a way as to leave about 20 mm free space at the front and back. The whole set of filler sleeves should tightly fit into the conduit to provide sufficient mechanical stability.



Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C. After full curing max. operating temperature is 180 °C.

5) A 20 mm thick layer of NOFIRNO® sealant is applied at each side of the conduit. Clean and dry the conduit opening as well as the pipe thoroughly, and remove any dirt, rust or oil residues before applying the sealant.



People with sensitive skin should use gloves when working with NOFIRNO®. Please refer to the Safety Data Sheet for more information.

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

6) The conduit should be overfilled with NOFIRNO® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



7) To smooth the surface of the NOFIRNO® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!



8) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with NOFIRNO®. Please refer to the Safety Data Sheet for more information.



People with sensitive skin should use gloves when working with NOFIRNO®.

Please refer to the Safety Data Sheet for more information.

9) The surface can be smoothed by hand. Just wet the hands thoroughly with soap and water. No dirty hands when working with NOFIRNO® and a very neat surface is the result.

## NOFIRNO® (MULTI-) PIPE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

Please refer to the Safety Data Sheet for more information.



Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C. After full curing max. operating temperature is 180 °C.

1a) Vertical penetrations are easy to install as well. To prevent the filler sleeves from falling out of the conduit opening, multi-sleeves are preferably used.


People with sensitive skin should use gloves when working with NOFIRNO®.



NOFIRNO® sealant does not sag or drip off.

2a) The optimized viscosity and the superb adhesion properties of the NOFIRNO® sealant make applying the sealant overhead an easy matter. NOFIRNO® sealant does not sag and will not drip off.


Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

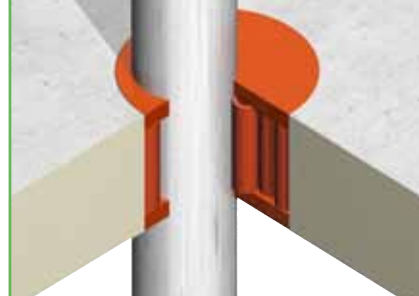

3a) For fire rated penetrations, the ducted pipe might have to be insulated to cope with the thermal insulation criterion according to EN classification (max. temperature rise 180 °C).









## NOFIRNO® (MULTI-) PIPE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

NOFIRNO® also is certified for multi-pipe penetrations.

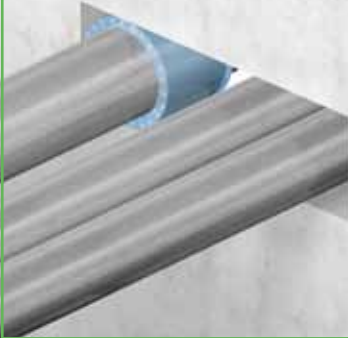


1) The metallic pipes can be passed through the conduit opening in any position. Make sure that the space between the pipes and the wall of the conduit and between the ducted pipes is in accordance with the minimum allowed distance as certified.

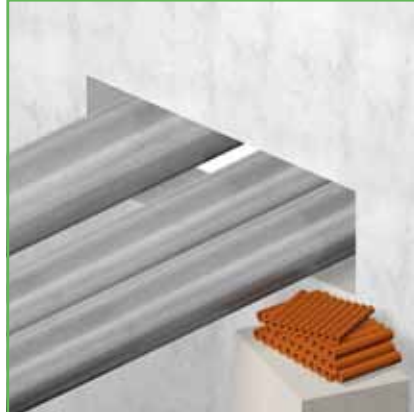


2) The open free space in the conduit opening has to be filled with NOFIRNO® filler sleeves type 27/19 and 18/12. For ease of filling, the filler sleeves are also supplied in multi-sets of 10 pieces. The filling ratio 18/12 to 27/19 should be maximum 1:2.


Multi-filler sleeves (set of 10) are available for filling larger empty spaces.

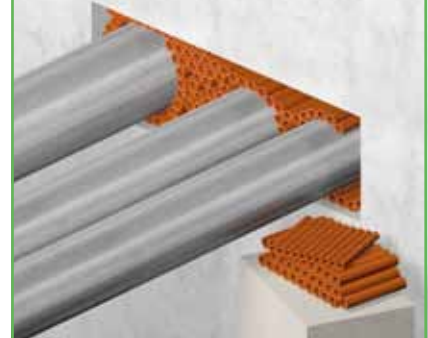


3) Before starting the installation work the ducted pipes and the wall of the conduit opening should be cleaned. Dirt, rust and oil residues should be removed. Start filling the larger open spaces in the conduit by inserting the sets of multi-filler sleeves.

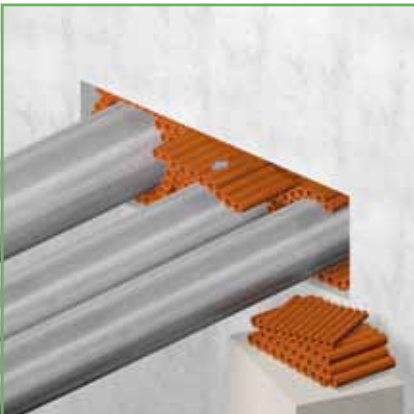


4) The installation of the NOFIRNO® sealing system is extremely fast when using the NOFIRNO® multi-filler sleeves. Besides, it makes it less complicated than using the single filler sleeves.

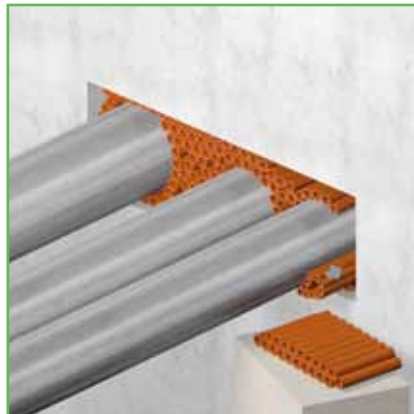

5) Due to the flexibility of the set of filler sleeves, the sets can be easily rolled up and then pushed into the narrow spaces. This is most helpful when installing floor penetrations.

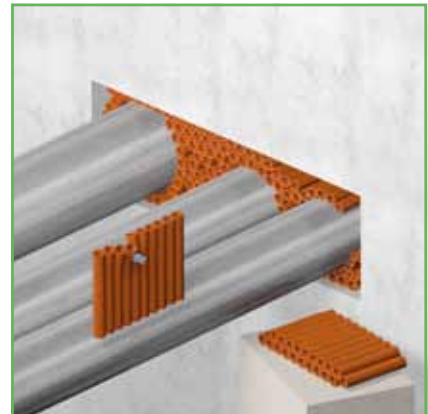


6) The smaller openings are now filled with parts of the sets of multi-filler sleeves. To tear off sleeves from the multi-set, the procedure is to do this backwards/forwards and not sideways. This is because of the strength of the intermediate rubber parts.

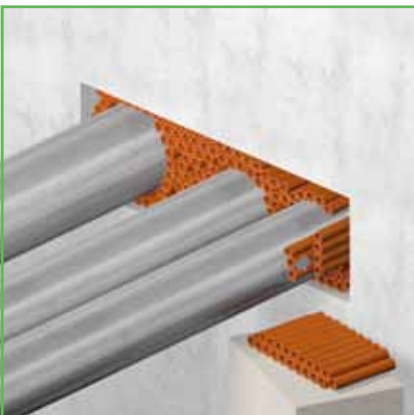

7) These parts of the sets of multi-filler sleeves are then pushed in the fitting remaining open spaces in the set of filling inside the conduit opening.




8) Single filler sleeves are used to fill the remaining small spaces in the set of fillers. Filling these spaces is of utmost importance to obtain a very tight fit of the filling inside the conduit frame.

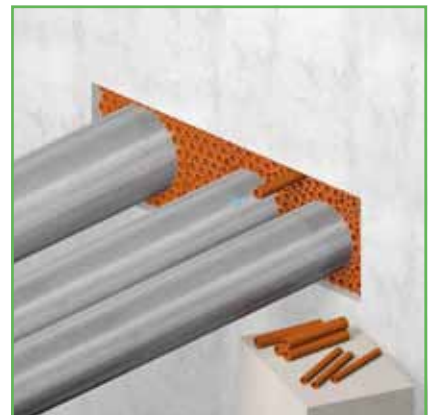


9) The single filler sleeves are inserted in the open spaces. At this stage they can generally be pushed in by hand. At the final stage to create a very tight fit of the whole set of fillers, the sleeves can be inserted with the help of a flat nose pliers.




## NOFIRNO® (MULTI-) PIPE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

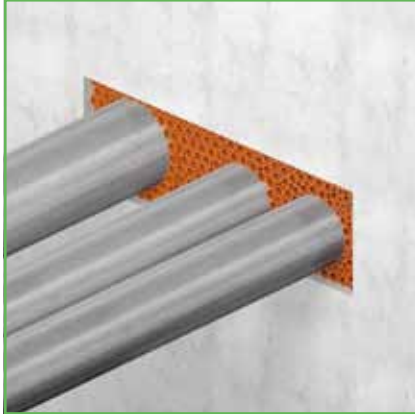


10) A tight fit of the filling with filler sleeves is essential for the overall mechanical stability and the ultimate tightness ratings.

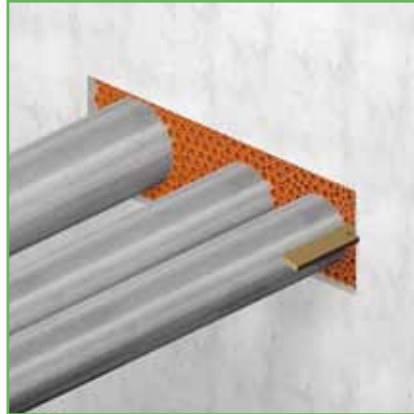

11) Push the filler sleeves into the conduit in such a way as to leave about 20 mm free space at the front and the back. The whole set of filler sleeves should fit tightly into the conduit to provide sufficient mechanical stability.

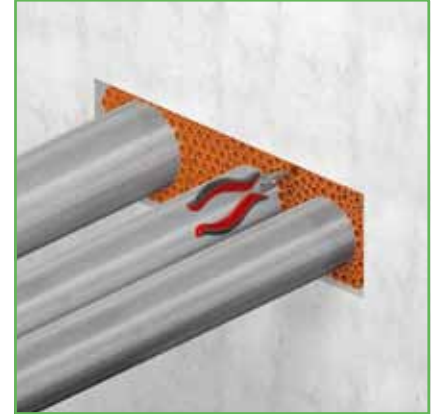

12) The surface structure of the rubber of the sleeves makes it easy to pull NOFIRNO® filler sleeves back which are too deep inserted. Before applying the sealant, it is advisable to perform a final check on the packing of (multi-) filler sleeves.

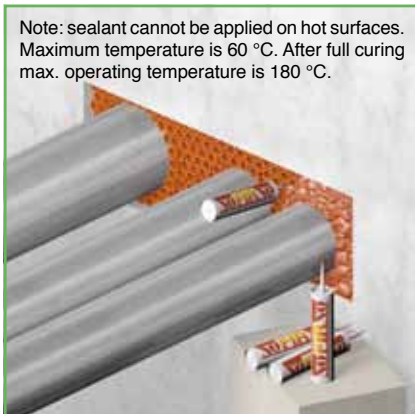

Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C. After full curing max. operating temperature is 180 °C.

13) A 20 mm thick layer of NOFIRNO® sealant is applied at each side of the conduit. When the application of the sealant is in a later stage, clean and dry the conduit opening and the pipes thoroughly. Remove any dirt, rust or oil residues before applying the sealant.



Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.

14) When working on larger conduits, the sealant should be applied in two or more parts. Due to the fast curing of the top layer of the sealant, the amount of sealant should not be more than can be finished within 10 minutes.




People with sensitive skin should use gloves when working with NOFIRNO®.


15) A cloth is sprayed with water. Note: do not use soap water! The cloth is used to press down the sealant layer. Pressing down the NOFIRNO® sealant in a stiff way is absolutely vital for the mechanical stability of the sealing system.



16) The surface can be smoothed by hand. Wet the hands thoroughly with soap and water to avoid the NOFIRNO® sticking to the hands. A very neat surface is the result. Prevent soap water to be applied on the sealant surface on which the next sealant will be applied.

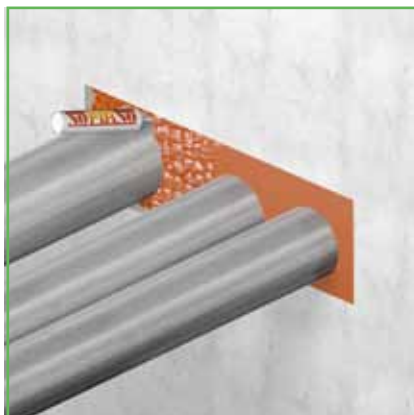

17) Then applying the sealant can be continued for the rest of the transit. Smoothing and finishing in the same way as for the first part of the sealant layer

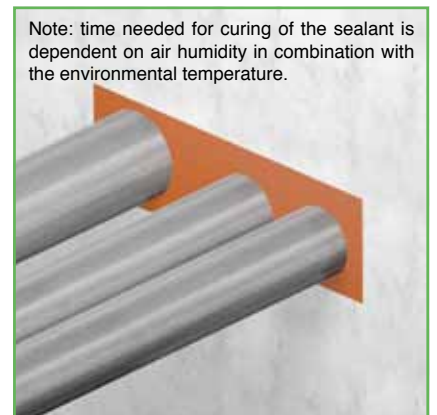


Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

18) The NOFIRNO® multi-pipe penetrations have been successfully tested for a fire resistance of >120 minutes (E120) according to EN 1366-3:2004). EI90 or EI-120-classification is dependent on the thermal insulation to be applied around the ducted pipes.



## NOFIRNO® SEALING SYSTEM FOR STRUCTURAL GAPS - FIRESAFE/GAS & WATERTIGHT

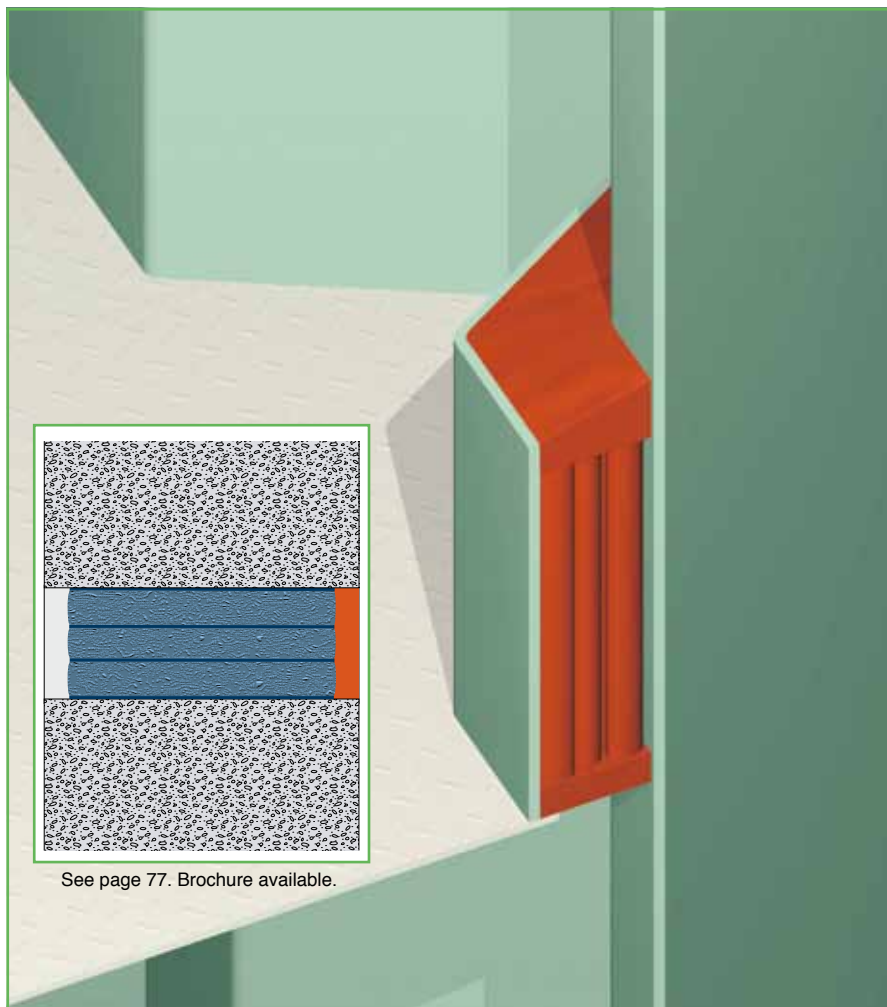

See page 77. Brochure available.

The optimized viscosity and the superb adhesion properties of the NOFIRNO® sealant make applying the sealant overhead at the bottom of the sealing system an easy matter. NOFIRNO® sealant does not sag and will not drip off.

Furthermore, the viscosity of the sealant allows to form a sloped surface of the top layer to ensure that water will drip off in case of leakages in the installation.


For fire safe sealing of horizontal gaps, for instance between walls and ceilings, use can be made of the ACTIFOAM®/ULTRA sandwich construction. The system can be inserted using a hammer and a piece of wood. Jet Fire rated, when covered at the exposed side with NOFIRNO® sealant.

For these type of special applications on offshore installations, so-called Design Verification Reports can be obtained on a case by case project basis. A DVR has been issued for both systems.



JET FIRE TESTED ACCORDING TO ISO 22899-1:2007 AND ISO/CD 22899-2


Specification is 0.3 kg/sec propane. 125 minutes is 7500 sec. This means 2250 kg propane in this test burned. Equals a volume of almost 1300 m<sup>3</sup> propane.




NOFIRNO® single steel and GRP pipe penetrations have been successfully tested for A-0 and H-0 class without the use of any insulation. Conduit depth 250 mm.




## NOFIRNO® SEALING SYSTEM FOR STRUCTURAL GAPS - FIRESAFE/GAS & WATERTIGHT

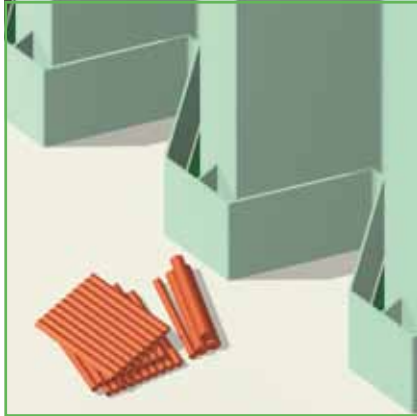


1) Based on the width and length of the gap to be sealed, partitions have to be put in place to ensure that the adhesive surface is in accordance with the maximum certified surface of 1800 cm<sup>2</sup>.

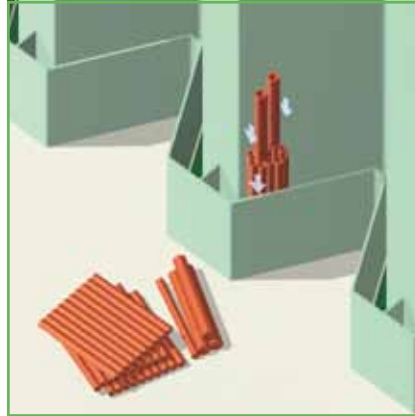

2) NOFIRNO® filler sleeves are inserted in the gap to be sealed. A combination of multi-filler sleeves (set of 10 sleeves) and single filler sleeves type 18/12 and 27/19 can be used. The ratio 27/19 to 18/12 is maximum 2:1.

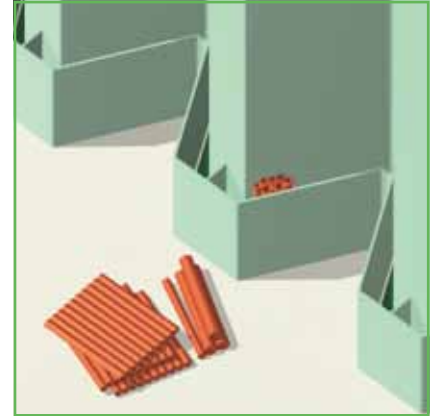


3) For H-class and Jet Fire rated constructions the length of the sleeves is 210 mm. For ease of filling, the filler sleeves are also supplied in multi-sets of 10 pieces. Single sleeves to be used to fill tightly the smaller open spaces

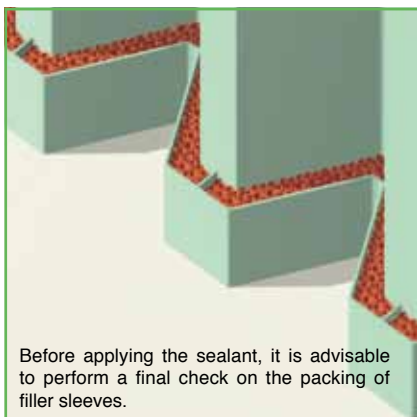

Before applying the sealant, it is advisable to perform a final check on the packing of filler sleeves.


4) Push the filler sleeves into the gap in such a way as to leave about 20 mm free space at the top and the bottom. The whole set of filler sleeves should fit tightly into the gap to provide sufficient mechanical stability.

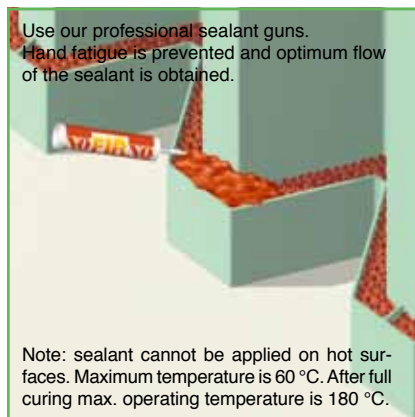

Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.

Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C. After full curing max. operating temperature is 180 °C.

5) A 20 mm thick layer of NOFIRNO® sealant is applied at each side of the gap. Clean and dry the walls of the gap, and remove any dirt, rust or oil residues before applying the sealant.

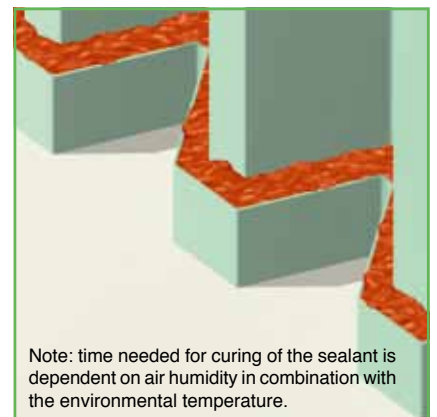


Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

6) An overfill of NOFIRNO® sealant has to be applied, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



7) To smooth the surface of the NOFIRNO® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!

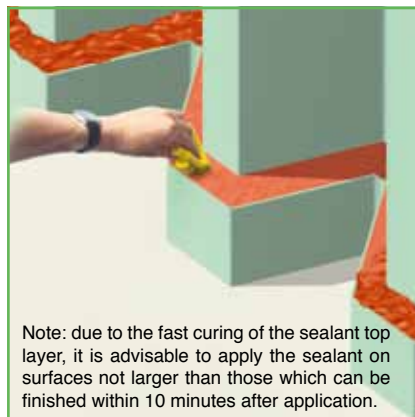

Note: due to the fast curing of the sealant top layer, it is advisable to apply the sealant on surfaces not larger than those which can be finished within 10 minutes after application.

8) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with NOFIRNO®. Please refer to the Safety Data Sheet for more information.



People with sensitive skin should use gloves when working with NOFIRNO®. Please refer to the Safety Data Sheet for more information.

9) The surface can be smoothed by hand. Just wet the hands thoroughly with soap and water. No dirty hands when working with NOFIRNO® and a very neat surface is the result.





## NOFIRNO<sup>®</sup> (MULTI-) CABLE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

### RISE<sup>®</sup> cable sleeves



Note: maximum continuous service temperature of the RISE<sup>®</sup> sleeves not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

*cable sleeves are supplied split lengthwise*

### NOFIRNO<sup>®</sup> filler sleeves

*see page 44 for the article numbers of the filler sleeves*



operating temperatures:  
-50 °C up to +180 °C

*filler sleeves are supplied non-split*

### NOFIRNO<sup>®</sup> multi-filler sleeves




*filler sleeves are supplied in multi-sets of 10 sleeves*

RISE <sup>®</sup> cable sleeve	cable diameter	sleeve length	article number
12/6	5 - 7	110	80.2000
14/8	7 - 9	110	80.2001
16/10	9 - 11	110	80.2002
18/12	11 - 13	110	80.2003
20/14	13 - 15	110	80.2004
22/16	15 - 17	110	80.2005
27/19	17 - 21	110	80.2006
31/23	21 - 25	110	80.2007
35/27	25 - 29	110	80.2008
39/31	29 - 33	110	80.2009
46/36	33 - 39	110	80.2010
52/42	39 - 45	110	80.2011
58/48	45 - 51	110	80.2012
64/54	51 - 57	110	80.2013
70/60	57 - 63	110	80.2014
12/6	5 - 7	140	80.0051
14/8	7 - 9	140	80.0052
16/10	9 - 11	140	80.0053
18/12	11 - 13	140	80.0054
20/14	13 - 15	140	80.0055
22/16	15 - 17	140	80.0056
27/19	17 - 21	140	80.0057
31/23	21 - 25	140	80.0058
35/27	25 - 29	140	80.0059
39/31	29 - 33	140	80.0060
46/36	33 - 39	140	80.0061
52/42	39 - 45	140	80.0062
58/48	45 - 51	140	80.0063
64/54	51 - 57	140	80.0064
70/60	57 - 63	140	80.0065
12/6	5 - 7	160	80.0100
14/8	7 - 9	160	80.0101
16/10	9 - 11	160	80.0102
18/12	11 - 13	160	80.0103
20/14	13 - 15	160	80.0104
22/16	15 - 17	160	80.0105
27/19	17 - 21	160	80.0106
31/23	21 - 25	160	80.0107
35/27	25 - 29	160	80.0108
39/31	29 - 33	160	80.0109
46/36	33 - 39	160	80.0110
52/42	39 - 45	160	80.0111
58/48	45 - 51	160	80.0112
64/54	51 - 57	160	80.0113
70/60	57 - 63	160	80.0114
12/6	5 - 7	210	80.0200
14/8	7 - 9	210	80.0201
16/10	9 - 11	210	80.0202
18/12	11 - 13	210	80.0203
20/14	13 - 15	210	80.0204
22/16	15 - 17	210	80.0205
27/19	17 - 21	210	80.0206
31/23	21 - 25	210	80.0207
35/27	25 - 29	210	80.0208
39/31	29 - 33	210	80.0209
46/36	33 - 39	210	80.0210
52/42	39 - 45	210	80.0211
58/48	45 - 51	210	80.0212
64/54	51 - 57	210	80.0213
70/60	57 - 63	210	80.0214


## NOFIRNO® (MULTI-) CABLE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT

Note: maximum continuous service temperature of the RISE® sleeves not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

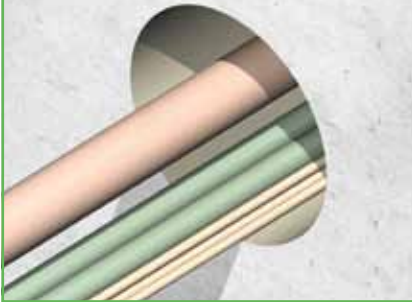


1) The cables can be ducted through the conduit opening in random order. It is most important that they are not pulled too tight so as not to hamper their separation when RISE® insert sleeves are inserted.

Sleeving the cables directly after ducting avoids overfilling of the transit.

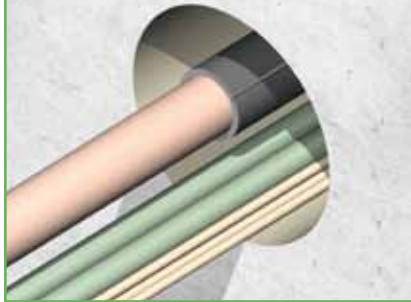


2) After the cables have been ducted, RISE® insert sleeves are applied around each cable. The insert sleeves are split lengthwise and can therefore be placed around the cables in front of the conduit.

Multi-filler sleeves (set of 10) are available for filling larger empty spaces.

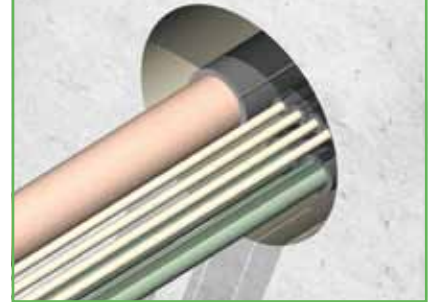


3) The remaining free space in the conduit is filled with NOFIRNO® filler sleeves type 27/19 and 18/12. For ease of filling, the NOFIRNO® filler sleeves are delivered non-split. The ratio 27/19 to 18/12 is maximum 2:1.

Before applying the sealant, it is advisable to perform a final check on the packing of insert and filler sleeves.

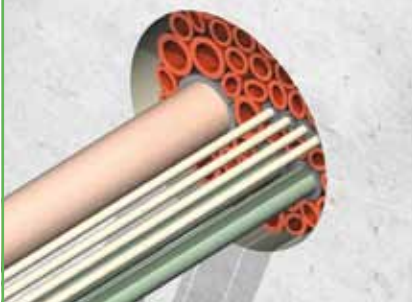


4) Push the insert/filler sleeves into the conduit in such a way as to leave about 20 mm free space at the front and the back. The whole set of insert and filler sleeves should fit tightly into the conduit to provide sufficient mechanical stability.

Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.

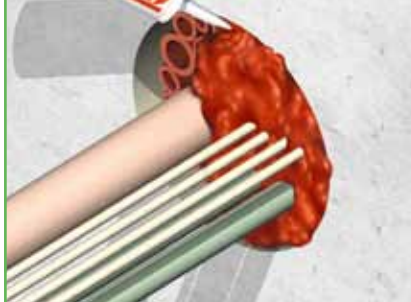

5) A 20 mm thick layer of NOFIRNO® sealant is applied at each side of the conduit. Clean and dry the conduit opening and the cables thoroughly, and remove any dirt, rust or oil residues before applying the sealant.

People with sensitive skin should use gloves when working with NOFIRNO®.

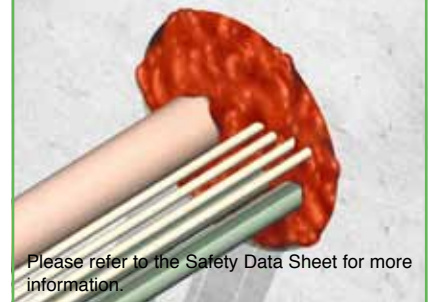

Please refer to the Safety Data Sheet for more information.

6) The conduit should be overfilled with NOFIRNO® sealant because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



7) To smooth the surface of the NOFIRNO® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!



8) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with NOFIRNO®. Please refer to the Safety Data Sheet for more information.

People with sensitive skin should use gloves when working with NOFIRNO®.



9) The surface can be further smoothed by hand. Just wet the hand thoroughly with soap and water. No dirty hands when working with NOFIRNO® and a very neat surface is the result.






## NOFIRNO<sup>®</sup> (MULTI-) CABLE TRANSIT SEALING SYSTEM - FIRESAFE/GAS & WATERTIGHT


To obtain optimum adhesion during the curing process of the sealant, the cables should be tightly fixed immediately after finishing the transit.

The bright, contrasting colour of the sealant contributes to ease of inspection.

10) After smoothing is finished, a last check should be made to ensure that sufficient sealant is applied in between the cables especially at penetrations with larger amounts of cables. This is most important, especially for water and gas tight penetrations.

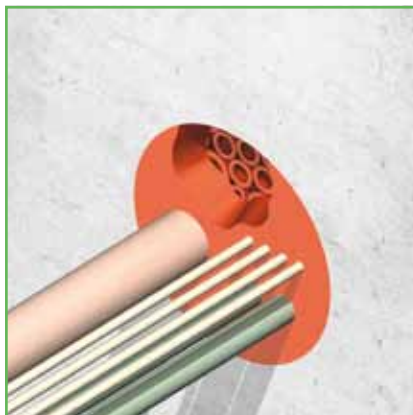


11) Adding extra cables is an easy job. Cut away the sealant layer at both sides of the penetration with a knife or a hollow punch in a tapering shape. This creates a good foundation for the sealant mass to be applied later.

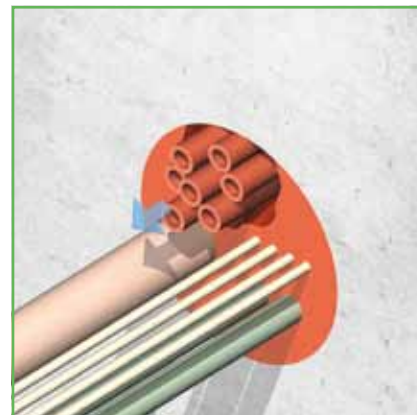


12) Remove one or more NOFIRNO<sup>®</sup> filler sleeves to create a fitting opening for the cable to be ducted.

Cable sets of max. 25 LAN cables with an OD of 5 - 6 mm tightly bundled to max. 35 mm can be passed through the penetration.

Note: maximum continuous service temperature of the RISE<sup>®</sup> sleeves not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

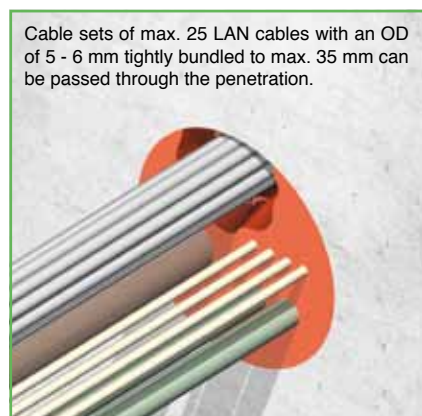

13) Pull the new cable (even a set of bundled cables is allowed) through the conduit.  
Note: bundled cables not approved for gas or watertight penetrations!

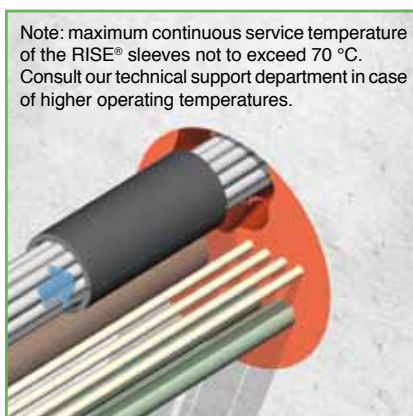

14) After the cable(s) have been ducted, place a RISE<sup>®</sup> insert sleeve around the cable or bundled set. Insert sleeves are split lengthwise and can therefore be placed around the cables in front of the conduit.



15) Push the insert sleeve into the conduit in such a way as to leave about 20 mm free space at the front and back and place, if necessary, NOFIRNO<sup>®</sup> filler sleeves back in the remaining open spaces.

People with sensitive skin should use gloves when working with NOFIRNO<sup>®</sup>.


Please refer to the Safety Data Sheet for more information.



16) Refill the opening in the sealant layer with sufficient NOFIRNO<sup>®</sup> sealant at both sides of the penetration. Finish the sealant layer as described before.



17) The NOFIRNO<sup>®</sup> sealing system can be applied also in square or rectangular openings. The NOFIRNO<sup>®</sup> sealant adheres very well to the most common substrates. Check the adhesion properties especially in case of watertight penetrations.

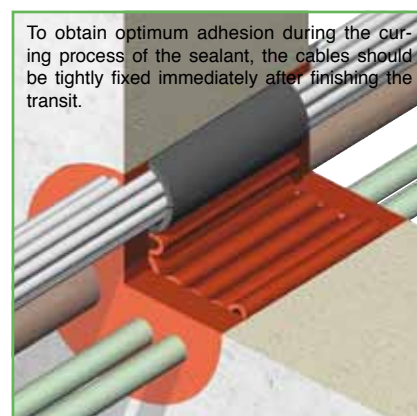

18) For fire rated conduits, plastic conduit sleeves should not be used. This is not a problem for "watertight only" penetrations.



## RISE®/ULTRA - FIRE SAFE PLASTIC PIPE TRANSIT SEALING SYSTEM

### CRUSHER® type C-FIT



Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

### CRUSHER® type WRAP



Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.




article number 50.0102

*NOFIRNO® is a paste-like compound which is simple to use. NOFIRNO® has a balanced viscosity and can be applied overhead. After applying the sealant, it can be smoothed by means of a wet cloth or by hand. Because the sealant adheres very tightly, the cloth and hands should be wetted with water before use to prevent sealant from sticking to them.*


*Shelf life is 12 months when stored properly. Since we have no control on storage, we can only guarantee for 6 months.*

plastic pipe OD	crusher® type	conduit opening	crusher® length	article number
16	30/16	30	110	80.2700
18	30/18	30	110	80.2701
20	40/20	40	110	80.2702
25	40/25	40	110	80.2703
32	50/32	50	110	80.2704
40	50/40	50	110	80.2705
40	60/40	60	110	80.2706
50	70/50	70	110	80.2707
50	80/50	80	110	80.2708
63	80/63	80	110	80.2709
63	90/63	90	110	80.2710
75	100/75	100	110	80.2711
75	110/75	110	110	80.2712
90	125/90	125	110	80.2713
110	150/110	150	110	80.2714
16	30/16	30	140	80.2720
18	30/18	30	140	80.2721
20	40/20	40	140	80.2722
25	40/25	40	140	80.2723
32	50/32	50	140	80.2724
40	50/40	50	140	80.2725
40	60/40	60	140	80.2726
50	70/50	70	140	80.2727
50	80/50	80	140	80.2728
63	80/63	80	140	80.2729
63	90/63	90	140	80.2730
75	100/75	100	140	80.2731
75	110/75	110	140	80.2732
90	125/90	125	140	80.2733
110	150/110	150	140	80.2734
16	30/16	30	160	80.2740
18	30/18	30	160	80.2741
20	40/20	40	160	80.2742
25	40/25	40	160	80.2743
32	50/32	50	160	80.2744
40	50/40	50	160	80.2745
40	60/40	60	160	80.2746
50	70/50	70	160	80.2747
50	80/50	80	160	80.2748
63	80/63	80	160	80.2749
63	90/63	90	160	80.2750
75	100/75	100	160	80.2751
75	110/75	110	160	80.2752
90	125/90	125	160	80.2753
110	150/110	150	160	80.2754
16	30/16	30	170	80.2760
18	30/18	30	170	80.2761
20	40/20	40	170	80.2403
25	40/25	40	170	80.2404
32	50/32	50	170	80.2764
40	50/40	50	170	80.2765
40	60/40	60	170	80.2766
50	70/50	70	170	80.2767
50	80/50	80	170	80.2768
63	80/63	80	170	80.2769
63	90/63	90	170	80.2770
75	100/75	100	170	80.2771
75	110/75	110	170	80.2772
90	125/90	125	170	80.2773
110	150/110	150	170	80.2774
wrap 1000x110x2,5 mm				80.2511
wrap 1000x140x2,5 mm				80.2512
wrap 1000x160x2,5 mm				80.2513
wrap 1000x170x2,5 mm				80.2514
wrap 1000x190x2,5 mm				80.2515
wrap 1000x210x2,5 mm				80.2516


all dimensions in mm




## RISE®/ULTRA - FIRE SAFE PLASTIC PIPE TRANSIT SEALING SYSTEM

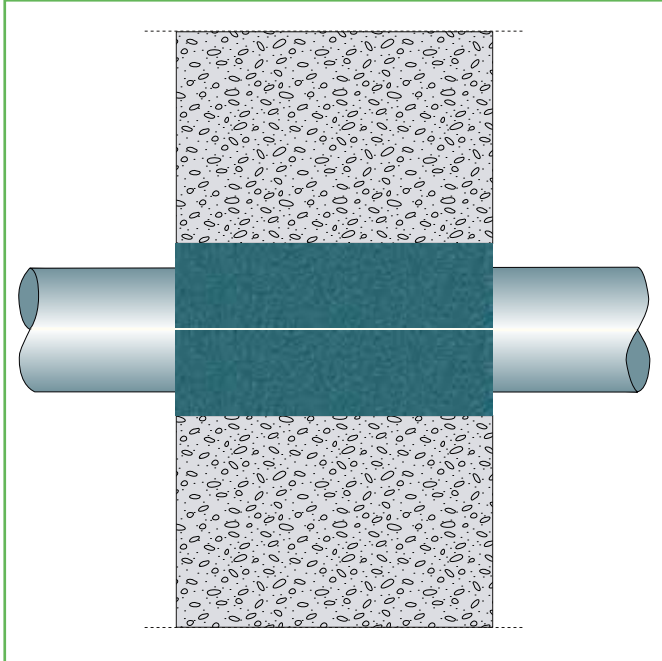

Several options are available with the RISE®/ULTRA crushers. The most simple and cost effective solution is a fitting C-FIT crusher applied in a conduit opening with an exact ID for a tight fit. This application is for **fire-rated only** penetrations, not for watertight penetrations.

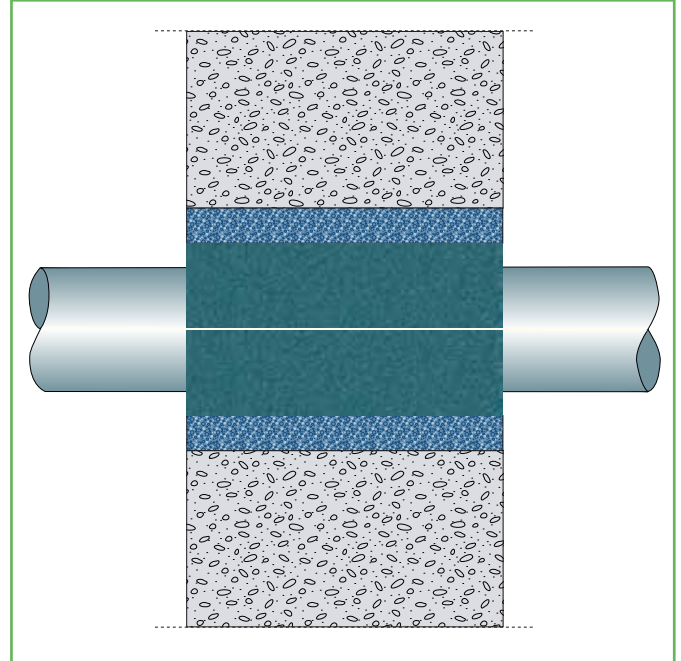


For oversized penetrations, a non-fitting crusher can be used in combination with ACTIFOAM® filler sheets. Care has to be taken that the ACTIFOAM® filler sheets are installed tightly fitting into the conduit opening. Especially in the case of floor penetrations. Non-watertight application.

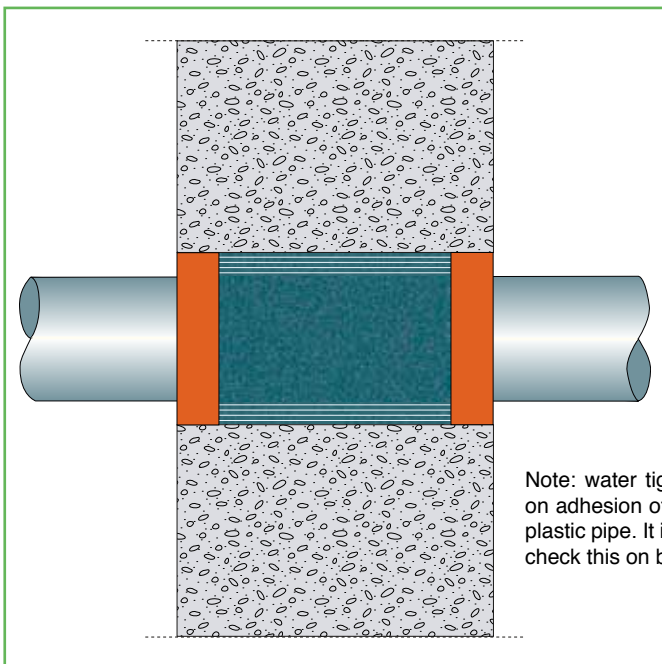


Note: water tightness dependent on adhesion of the sealant to the plastic pipe. It is recommended to check this on beforehand.

Instead of RISE®/ULTRA crushers, RISE®/ULTRA wraps can be used. The RISE®/ULTRA sheets for wrapping are 2.5 mm thick and have to be wrapped to the required thickness. For gas and watertight penetrations, NOFIRNO® sealant with a thickness of minimum 20 mm has to be applied at both sides of the penetration.

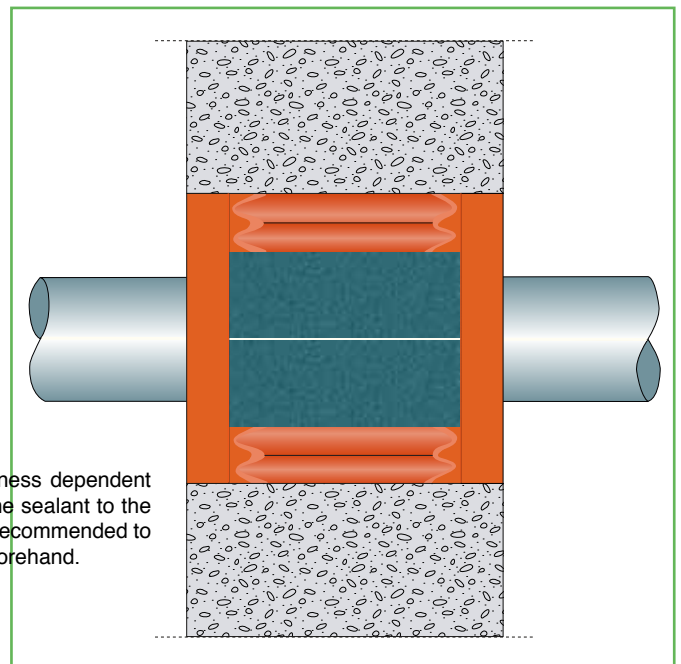


For firesafe, gas and watertight oversized penetrations the open space around the RISE®/ULTRA crusher is filled with NOFIRNO® filler sleeves. A 20 mm thick layer of NOFIRNO® sealant is applied at each side of the conduit. In this case fitting RISE®/ULTRA C/FIT crushers or RISE®/ULTRA wraps can be used.

## RISE®/ULTRA - FIRE SAFE PLASTIC PIPE TRANSIT SEALING SYSTEM

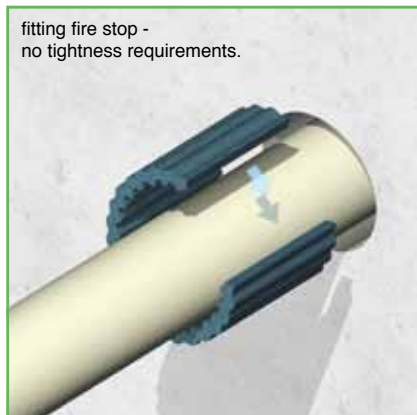


fitting fire stop -  
no tightness requirements.

1) The fitting RISE®/ULTRA C-FIT crusher, which is split lengthwise, is folded around the ducted plastic pipe in front of the conduit opening.

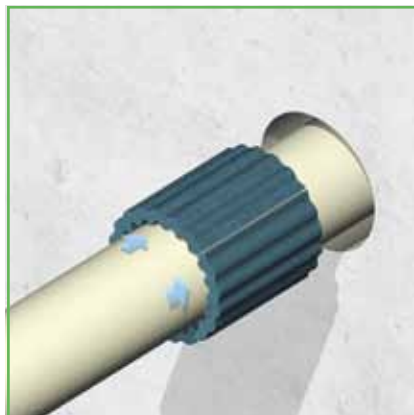


2) In case of a tight fitting crusher, the outside of the crusher and the inner wall of the conduit should be treated with CSD® lubricant for ease of installation. Push the crusher into the conduit opening.



Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.


3) Fire safe ducting of plastic pipes cannot be more simple than with the RISE®/ULTRA crushers.

Care has to be taken for a tight fixation of the crusher, especially in floor penetrations.

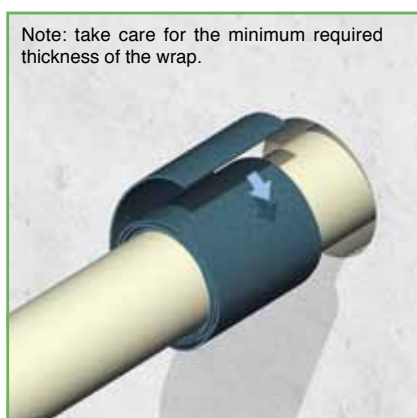


Note: take care for the minimum required thickness of the wrap.

1a) In case no fitting RISE®/ULTRA crusher is available, use can be made of RISE®/ULTRA crusher wraps with a thickness of 2.5 mm to be wrapped around the plastic pipe. Also to be used for conduit openings which are a bit oversized.

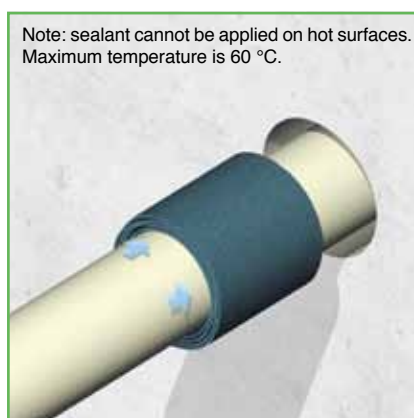

Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C.

2a) For airtight penetrations, a NOFIRNO® sealant layer with thickness of min. 5 mm is applied at both sides of the penetration. For watertight penetrations the sealant layer has to be 20 mm thick at both sides of the penetration.

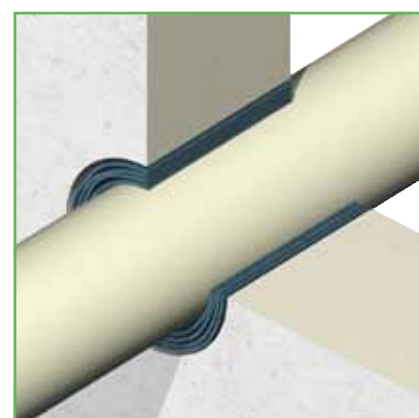


3a) Although RISE®/ULTRA is tested without, it is advisable to apply a layer NOFIRNO® sealant to prevent removal of the crusher. Remove/clean lubricant residues before applying the sealant.




Remove/clean lubricant residues before applying the sealant.

1b) A bundle of max. 12 plastic pipes with an OD of max. 12 mm can be ducted through a single conduit opening and then fire safe sealed with RISE®/ULTRA.

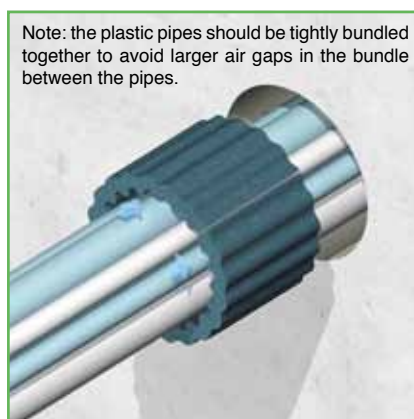

Note: the plastic pipes should be tightly bundled together to avoid larger air gaps in the bundle between the pipes.

2b) A RISE®/ULTRA crusher, with the appropriate wall thickness, which is split lengthwise, is folded around the ducted bundle of plastic pipes in front of the wall.

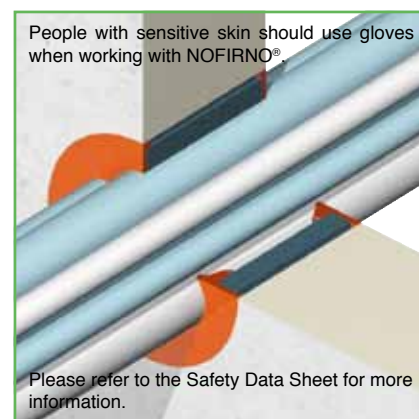

People with sensitive skin should use gloves when working with NOFIRNO®.

Please refer to the Safety Data Sheet for more information.

3b) It is necessary to apply NOFIRNO® sealant around and in between the ducted pipes. Preferably a layer of minimum 5 mm NOFIRNO® sealant is applied at both sides of the conduit. Before applying, clean the pipes and the wall of the conduit opening.





## RISE®/ULTRA - FIRE SAFE PLASTIC PIPE TRANSIT SEALING SYSTEM

### CRUSHER® type C-FIT




Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

plastic pipe OD	crusher® type	crusher® length	article number
16	30/16	110/140/160/170	see page 56
18	30/18	110/140/160/170	
20	40/20	110/140/160/170	
25	40/25	110/140/160/170	
32	50/32	110/140/160/170	
40	50/40	110/140/160/170	
40	60/40	110/140/160/170	
50	70/50	110/140/160/170	
50	80/50	110/140/160/170	
63	80/63	110/140/160/170	
63	90/63	110/140/160/170	
75	100/75	110/140/160/170	
75	110/75	110/140/160/170	
90	125/90	110/140/160/170	
110	150/110	110/140/160/170	

all dimensions in mm


### ACTIFOAM® filler sheets

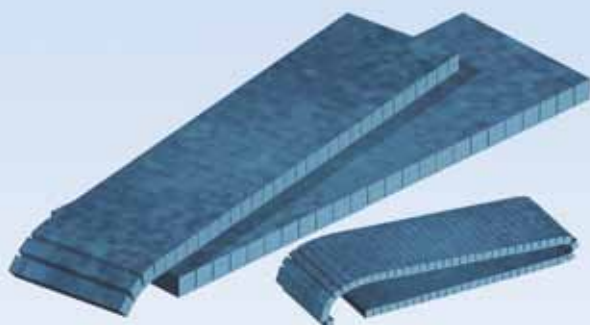


Note: maximum continuous service temperature of the ACTIFOAM® sheets not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

ACTIFOAM® filler sheets	sheet width	article number
300x110x10	110	83.2500
300x110x15	110	83.2501
300x110x20	110	83.2502
300x110x25	110	83.2503
300x140x10	140	83.2510
300x140x15	140	83.2511
300x140x20	140	83.2512
300x140x25	140	83.2513
300x160x10	160	83.2520
300x160x15	160	83.2521
300x160x20	160	83.2522
300x160x25	160	83.2523
300x170x10	170	83.2530
300x170x15	170	83.2531
300x170x20	170	83.2532
300x170x25	170	83.2533


all dimensions in mm

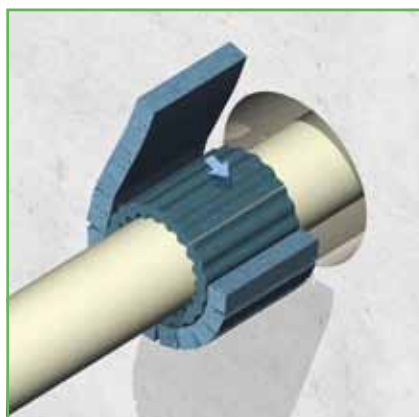

1c) When the conduit opening is over dimensioned, a combination of RISE®/ULTRA and ACTIFOAM® is the solution. A pre-slit ACTIFOAM® sheet is rolled around the crusher. To adjust the length of the wrap around the crusher, slits can be torn off.

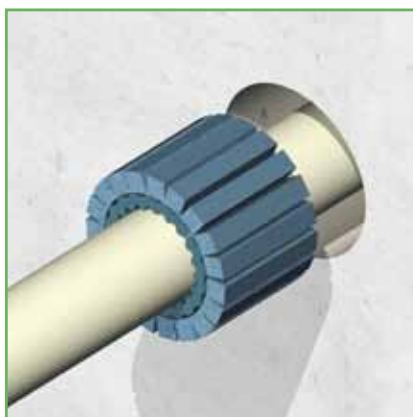

2c) Push the combination of RISE®/ULTRA crusher and pre-slit ACTIFOAM® sheet into the conduit opening. The inner wall of the penetration and the outside of the ACTIFOAM® wrap can be treated with CSD® lubricant to enable ease of installation.

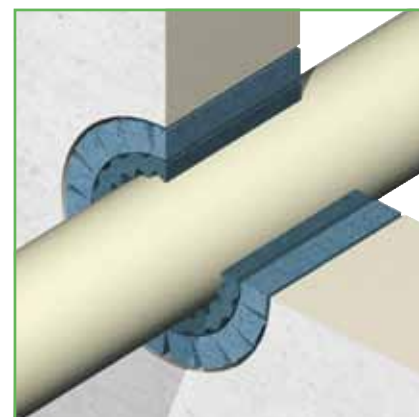

3c) Even installation of a CRUSHER® fire stop for over dimensioned conduit openings of plastic pipes is most easy. Care has to be taken for a tight fit of the RISE®/ULTRA crusher with ACTIFOAM® wrap, especially in floor penetrations.

## RISE®/ULTRA - NOFIRNO® SINGLE & MULTI-PLASTIC PIPE TRANSIT SEALING SYSTEM

### CRUSHER® type C-FIT



Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.



CRUSHER® type WRAP

### NOFIRNO® filler sleeves



filler sleeves are supplied non-split, single and multi (set of 10)

NOFIRNO® is a paste-like compound which is simple to use. NOFIRNO® has a balanced viscosity and can be applied overhead. After applying the sealant, it can be smoothed by means of a wet cloth or by hand. Because the sealant adheres very tightly, the cloth and hands should be wetted with water before use to prevent sealant from sticking to them.

Shelf life is 12 months when stored properly. Since we have no control on storage, we can only guarantee for 6 months.

article number 50.0102



plastic pipe OD	crusher® type	crusher® length	article number
16	30/16	110	80.2700
18	30/18	110	80.2701
20	40/20	110	80.2702
25	40/25	110	80.2703
32	50/32	110	80.2704
40	50/40	110	80.2705
50	70/50	110	80.2706
63	80/63	110	80.2707
75	100/75	110	80.2708
90	125/90	110	80.2709
110	150/110	110	80.2710

16	30/16	140	80.2720
18	30/18	140	80.2721
20	40/20	140	80.2722
25	40/25	140	80.2723
32	50/32	140	80.2724
40	50/40	140	80.2725
50	70/50	140	80.2726
63	80/63	140	80.2727
75	100/75	140	80.2728
90	125/90	140	80.2729
110	150/110	140	80.2730


16	30/16	160	80.2740
18	30/18	160	80.2741
20	40/20	160	80.2742
25	40/25	160	80.2743
32	50/32	160	80.2744
40	50/40	160	80.2745
50	70/50	160	80.2746
63	80/63	160	80.2747
75	100/75	160	80.2748
90	125/90	160	80.2749
110	150/110	160	80.2750

wrap 1000x110x2.5 mm	80.2511
wrap 1000x140x2.5 mm	80.2512
wrap 1000x160x2.5 mm	80.2513
wrap 1000x170x2.5 mm	80.2514
wrap 1000x190x2.5 mm	80.2515
wrap 1000x210x2.5 mm	80.2516

all dimensions in mm

NOFIRNO® filler sleeve	sleeve length	article number
18/12 single	110	80.5001
18/12 multi	110	80.5051
18/12 single	140	80.5002
18/12 multi	140	80.5052
18/12 single	160	80.5003
18/12 multi	160	80.5053
27/19 single	110	80.5011
27/19 multi	110	80.5061
27/19 single	140	80.5012
27/19 multi	140	80.5062
27/19 single	160	80.5013
27/19 multi	160	80.5063

all dimensions in mm




## NOFIRNO® MULTI-PLASTIC/METALLIC PIPE TRANSIT SEALING SYSTEM

The NOFIRNO® sealant adheres very well to the most common substrates. Check the adhesion properties especially in case of watertight penetrations.



1) The metallic and plastic pipe(s) can be passed through the conduit sleeve in any position, provided there is enough space between the wall of the conduit opening and the ducted pipe(s).

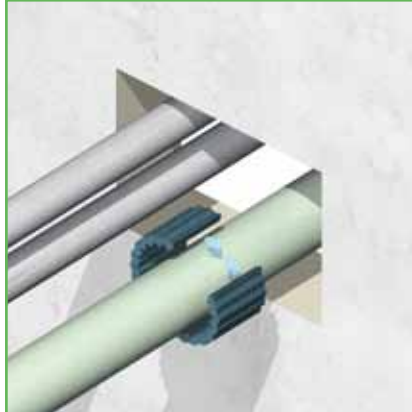


2) Make sure that the minimum space between the metallic pipe(s) and the wall of the conduit opening is in accordance with the minimum allowed distance as certified. Place a fitting RISE®/ULTRA crusher around the ducted plastic pipe(s).

Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.



3) Push the RISE®/ULTRA crusher/wrap into the conduit opening in such a way as to leave 20 mm free space at the front and back side. No crusher to be applied around the ducted metallic pipes.

Multi-filler sleeves (set of 10) are available for filling larger empty spaces.

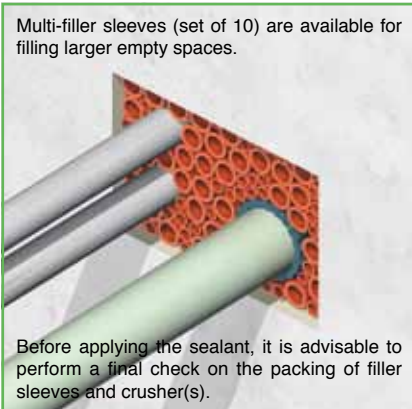

Before applying the sealant, it is advisable to perform a final check on the packing of filler sleeves and crusher(s).

4) The remaining free space in the conduit is filled with NOFIRNO® filler sleeves type 27/19 and 18/12. For ease of filling, the NOFIRNO® filler sleeves are supplied non-split. The ratio 27/19 to 18/12 is maximum 2:1.


Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.



Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C.

5) A 20 mm thick layer of NOFIRNO® sealant is applied at each side of the conduit. Clean and dry the conduit opening and the pipes thoroughly, and remove any dirt, rust or oil residues before applying the sealant.

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

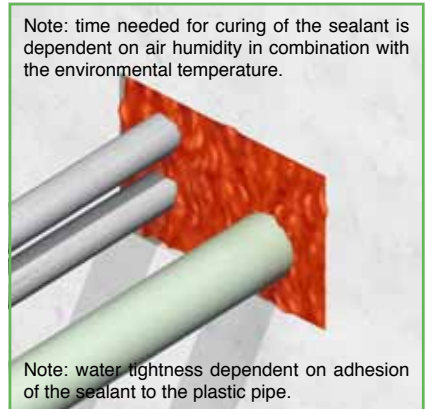


Note: water tightness dependent on adhesion of the sealant to the plastic pipe.

6) The conduit should be overfilled with NOFIRNO® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.

People with sensitive skin should use gloves when working with NOFIRNO®.



7) To smooth the surface of the NOFIRNO® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!

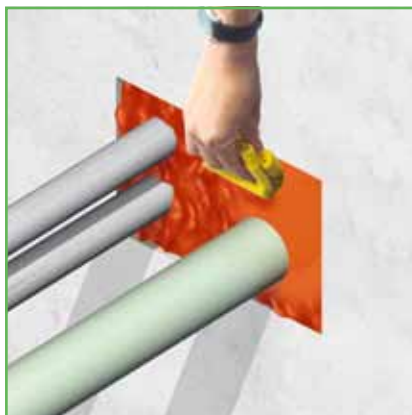

8) The cloth is then used to press down the sealant layer. People with sensitive skin should use gloves when working with NOFIRNO®. Please refer to the Safety Data Sheet for more information.


People with sensitive skin should use gloves when working with NOFIRNO®.




9) The surface can be smoothed by hand. Just wet the hands thoroughly with soap and water. No dirty hands when working with NOFIRNO® and a very neat surface is the result.




## RISE®/ULTRA - PRE-INSULATED PIPE TRANSIT SEALING SYSTEM

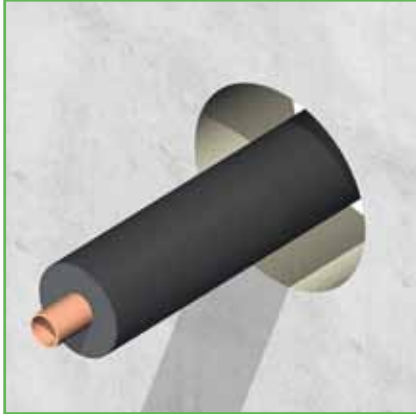

1) For fire rated penetrations of pre-insulated pipes (for instance for chilled water lines), by applying RISE®/ULTRA there is now no need to remove the insulation inside the penetration. This prevents condensation problems.

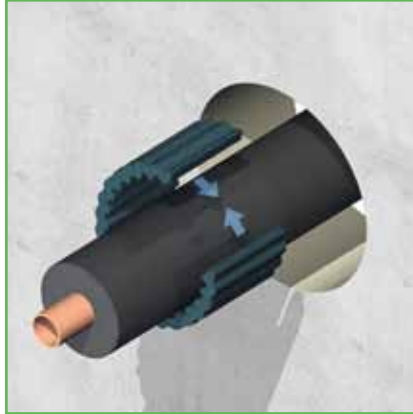

2) A RISE®/ULTRA crusher or wrap with the appropriate thickness is placed around the thermal insulation. The system can be used for insulated steel and copper pipes.

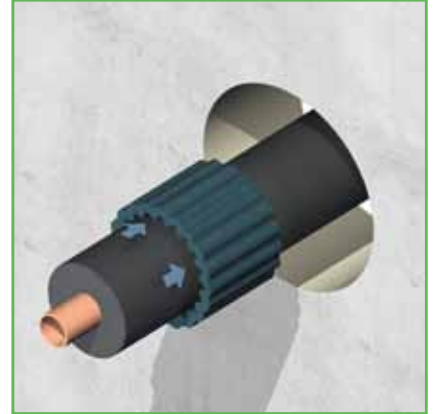


3) Push the RISE®/ULTRA crusher into the conduit opening in such a way as to leave about 20 mm free space at the front and back side.



4) NOFIRNO® sleeves are used to fill larger open spaces in the conduit opening. A minimum 20 mm thick layer of NOFIRNO® sealant is applied at each side of the conduit.



5) Clean and dry the conduit sleeve inside and the surface of the thermal insulation thoroughly and remove any dirt, concrete or oil/lubricant residues before applying the sealant.

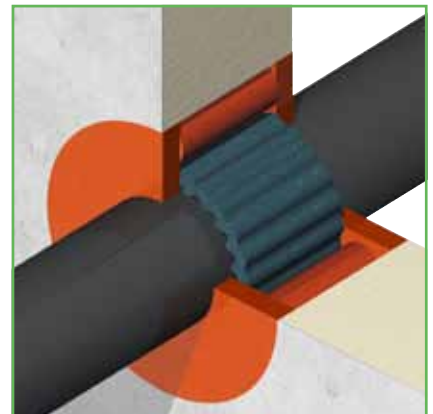

6) Not applicable for watertight conduits. For fire rated penetrations, the ducted pipe might have to be insulated to cope with the thermal insulation criterion.

Based on the CRUSHER® technology it is now possible to make fire stop penetrations for plastic pipes just by inserting a single RISE®/ULTRA crusher into the conduit opening around the ducted plastic pipe.

For conduits which should also be air or water tight, a combination of RISE®/ULTRA and NOFIRNO® sealant, if necessary with NOFIRNO® filler sleeves is used.

The design of the crusher allows for a balanced amount of hot air penetrating around the crusher. The time to close off the opening left by the burned or softened plastic pipe must be very short. Otherwise a chimney effect will occur, causing the pipe at the unexposed side to melt. The unique RISE®/ULTRA rubber reacts at two different temperature levels to speed up compression. The first reaction transfers the rubber under limited expansion to a very adhesive substance. Adhesive sealing all around causes the trapped air to expand rather fast.

In this way compression of the plastic pipe starts already at an early stage of the fire. The unique RISE®/ULTRA crusher allows for smallest conduit openings. For oversized openings and for multi-plastic pipe penetrations use is made of NOFIRNO® filler sleeves and NOFIRNO® sealant. Based on the properties of the RISE®/ULTRA rubber, ultimately a hard solid rubber mass adhering to the wall of the conduit and the remaining part of the plastic pipe is formed. In this way the penetration stays tight. Official fire tests according to EN 1366-3:2004 have successfully been carried out at the EFECTIS (formerly TNO) test institute, including multi-mix (cables, metallic and plastic pipe) transits. RISE®/ULTRA crushers are certified according to EN 13501-2:2003 for a two hour fire rating. The combination of RISE®/ULTRA and NOFIRNO® filler sleeves/sealant is also certified for multi-plastic pipe penetrations and the MULTI-ALL-MIX® system.



## NOFIRNO®/MULTI-ALL-MIX® FIRESAFE CABLE/PIPE TRANSIT SEALING SYSTEM

### CRUSHER® type C-FIT



Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

### CRUSHER® type WRAP



plastic pipe OD	crusher® type	crusher® length	article number
16	30/16	110/140/160	see page 56
18	30/18	110/140/160	
20	40/20	110/140/160	
25	40/25	110/140/160	
32	50/32	110/140/160	
40	50/40	110/140/160	
50	70/50	110/140/160	
63	80/63	110/140/160	
75	100/75	110/140/160	
90	125/90	110/140/160	
110	150/110	110/140/160	
wrap 1000x...x2.5 mm		110/140/160	

CRUSHER

### RISE® cable sleeves




Note: maximum continuous service temperature of the RISE® sleeves not to exceed 70 °C. Consult our technical support department in case of higher operating temperatures.

cable sleeves are supplied split lengthwise

RISE® cable sleeve	cable diameter	sleeve length	article number
12/6	5 - 7	110/140/160	see page 53
14/8	7 - 9	110/140/160	
16/10	9 - 11	110/140/160	
18/12	11 - 13	110/140/160	
20/14	13 - 15	110/140/160	
22/16	15 - 17	110/140/160	
27/19	17 - 21	110/140/160	
31/23	21 - 25	110/140/160	
35/27	25 - 29	110/140/160	
39/31	29 - 33	110/140/160	
46/36	33 - 39	110/140/160	
52/42	39 - 45	110/140/160	
58/48	45 - 51	110/140/160	
64/54	51 - 57	110/140/160	
70/60	57 - 63	110/140/160	

RISE

### NOFIRNO® filler sleeves

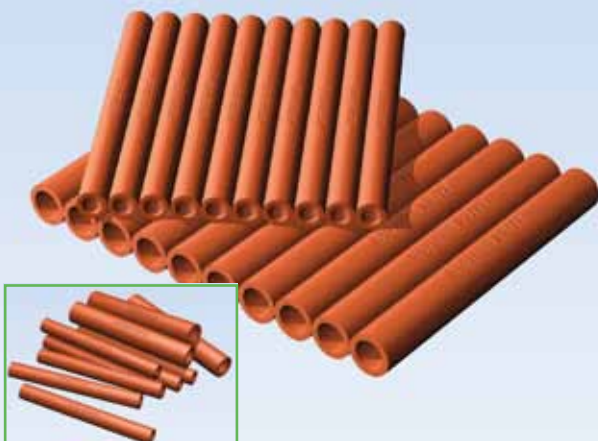

filler sleeves are supplied non-split, single and multi (set of 10)

NOFIRNO® filler sleeve	sleeve length	article number
18/12 single	110	80.5001
18/12 multi	110	80.5051
18/12 single	140	80.5002
18/12 multi	140	80.5052
18/12 single	160	80.5003
18/12 multi	160	80.5053
27/19 single	110	80.5011
27/19 multi	110	80.5061
27/19 single	140	80.5012
27/19 multi	140	80.5062
27/19 single	160	80.5013
27/19 multi	160	80.5063

NOFIRNO

## NOFIRNO®/MULTI-ALL-MIX® FIRESAFE CABLE/PIPE TRANSIT SEALING SYSTEM

Also refer to the NOFIRNO® cable penetrations for installation procedures of the ducted cables.

Note: maximum continuous service temperature of the RISE® sleeves not to exceed 70 °C. Consult our technical support department in case of higher temperatures.


1) The cables can be ducted through the conduit opening in random order. After the cables have been ducted, RISE® insert sleeves are applied around each cable.

Sleeving the cables directly after ducting avoids overfilling of the transit.


2) The RISE® insert sleeves are split lengthwise and can therefore be applied around the cables in front of the conduit. For cable sizes > 64 mm, a RISE® wrap with thickness 5 mm is applied. The wraps can be fixed with a tie-wrap (or similar).

Multi-filler sleeves (set of 10) are available for filling larger empty spaces.


3) The system is also approved for ducting steel/stainless steel pipes. The minimum interspacing should be followed according to the specifications on the installation drawings.

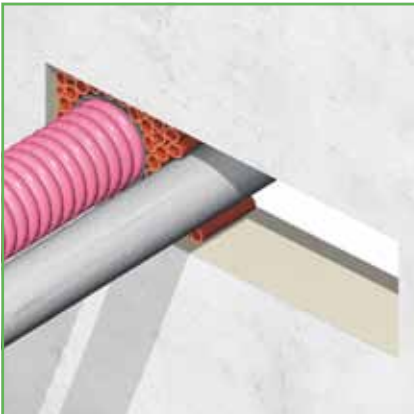

4) Separation of the metallic pipes is provided by NOFIRNO® filler sleeves all around the ducted pipe(s). NOFIRNO® filler sleeves are available in sizes 18/12 and 27/19 and are non-split for ease of installation.

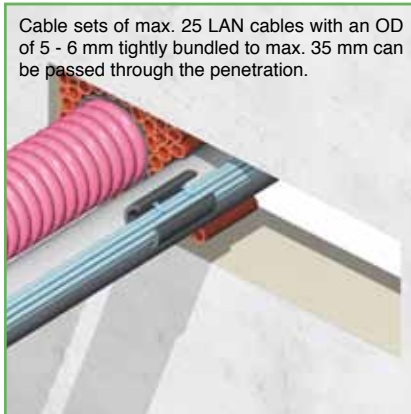


5) Bundled cable sets are allowed in the NOFIRNO® multi-all-mix® sealing system, using only a single RISE® insert sleeve.

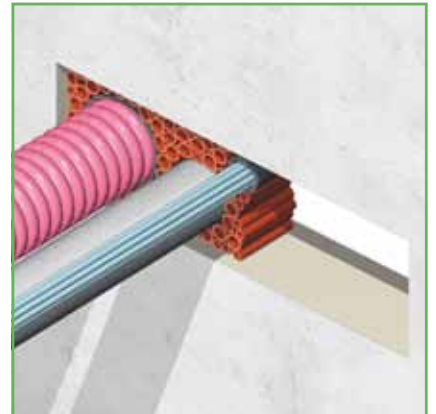


6) Open spaces in the conduit are afterwards filled with NOFIRNO® filler sleeves type 27/19 and 18/12. NOFIRNO® multi-filler sleeves can be used for filling the larger open spaces. The ratio 27/19 to 18/12 is maximum 2:1.

Note: maximum continuous service temperature of the CRUSHERS® not to exceed 70 °C. Consult our technical support department in case of higher temperatures.

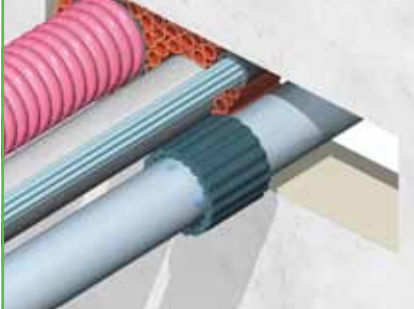

7) Plastic pipes can also be ducted through the multi-all-mix® transit. Place a RISE®/ULTRA crusher around the ducted pipe in front of the penetration. RISE®/ULTRA crushers are split lengthwise.

See also the brochure of the RISE®/ULTRA plastic pipe penetrations for installation procedures of the ducted pipes.

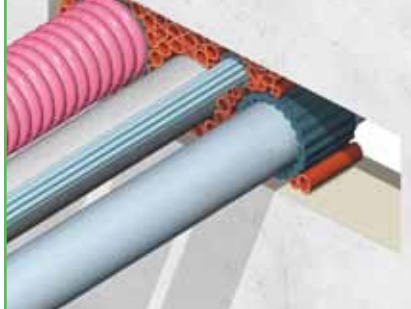

8) Push the insert/filler sleeves and the crusher into the conduit in such a way as to leave about 20 mm free space at both sides of the conduit. This space is needed to apply the NOFIRNO® sealant at a later stage.




9) Copper/CuNi pipes can also be ducted through the multi-all-mix penetration. Separation of the metallic pipes is provided by NOFIRNO® filler sleeves all around the ducted pipe(s).





## NOFIRNO®/MULTI-ALL-MIX® FIRESAFE CABLE/PIPE TRANSIT SEALING SYSTEM

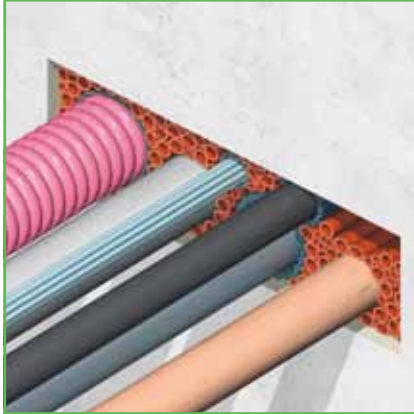

10) The system also allows for insulated chilled water lines (without interrupting the insulation), and multi-beverage lines. A RISE®/ULTRA crusher or wrap is placed around the insulation, and inserted into the penetration.



Before applying the sealant, it is advisable to perform a final check on the packing of insert, filler sleeves and crusher(s).



Note: sealant cannot be applied on hot surfaces. Maximum temperature is 60 °C.



Use our professional sealant guns. Hand fatigue is prevented and optimum flow of the sealant is obtained.



14) To smooth the surface of the NOFIRNO® sealant layer, a cloth is sprayed with water. This prevents the sealant from sticking to the cloth. Note: do not use soap water!



People with sensitive skin should use gloves when working with NOFIRNO®.


13) The conduit should be overfilled with NOFIRNO® sealant, because some sealant will be pushed between and into the empty filler sleeves during further finishing. This will contribute to obtain higher tightness ratings.



People with sensitive skin should use gloves when working with NOFIRNO®.



The bright, contrasting colour of the sealant contributes to ease of inspection.

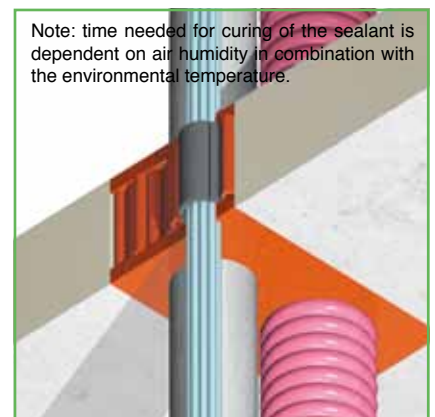

Note: time needed for curing of the sealant is dependent on air humidity in combination with the environmental temperature.

16) The surface can be smoothed by hand. Just wet the hands thoroughly with soap and water. No dirty hands when working with NOFIRNO® and a very neat surface is the result.


17) No insulation or intumescent paint needed in front of the penetration for cables and plastic pipes. Metallic pipes have to be insulated to fulfil the thermal insulation criterion of EN 1366-3:2004.

18) The optimized viscosity and the superb adhesion properties of the NOFIRNO® sealant make applying the sealant overhead an easy matter. NOFIRNO® sealant does not sag and will not drip off.

## ACTIFOAM® FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM


### ACTIFOAM® filler sheets

Note: maximum continuous service temperature of the ACTIFOAM® sheets not to exceed 70 °C.  
Consult our technical support department in case of higher operating temperatures.

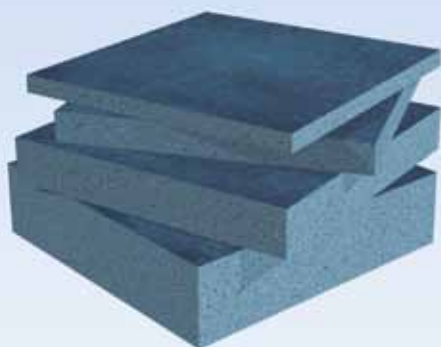

### ACTIFOAM® slit filler sheets

Note: maximum continuous service temperature of the ACTIFOAM® sheets not to exceed 70 °C.  
Consult our technical support department in case of higher operating temperatures.

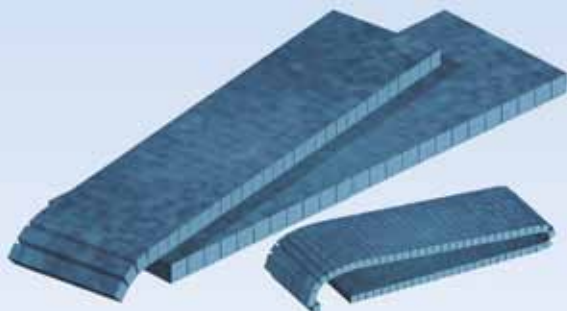

ACTIFOAM® is used to fill any cavities or gaps in constructions. In case of fire, the cavity will be totally filled with the expanding rubber, offering a perfect fire seal for a very long duration.

Oxygen index 40% (>30% is flame retardant).

ACTIFOAM® can also be used for other sealing purposes. An advantage is that ACTIFOAM® does not absorb water. Tested at 2.5 bar water pressure during 24 hours.

Due to the closed cell structure, the rubber has good thermal insulation properties. The K value at 10 °C according to NEN-EN 12667 is 12.3 mk/W. The density of the foam rubber at 23 °C is 0.35 g/cm³ +/- 10% in accordance with ISO 2781. Compression set of the foam rubber is 14% which stands for a good "memory".

Good weathering, UV and ozone resistance. Temperature range from -15 °C to +70 °C.

The 10 mm thick sheets have 30 pre-cut profiles 10x10 mm, the 15 mm thick sheets 20 (40) profiles 15x15 mm, the 20 mm thick sheets 15 (30) profiles 20x20 mm and the 25 mm thick sheets 12 (24) profiles 25x25 mm. The profiles can easily be torn off.

ACTIFOAM® filler sheets	sheet width	article number
-------------------------	-------------	----------------

300x150x10	150	83.0110
300x150x15	150	83.0111
300x150x20	150	83.0112
300x150x25	150	83.0113
300x200x10	200	83.0120
300x200x15	200	83.0121
300x200x20	200	83.0122
300x200x25	200	83.0123
300x250x10	250	83.0130
300x250x15	250	83.0131
300x250x20	250	83.0132
300x250x25	250	83.0133
600x150x10	150	83.0210
600x150x15	150	83.0211
600x150x20	150	83.0212
600x150x25	150	83.0213
600x200x10	200	83.0220
600x200x15	200	83.0221
600x200x20	200	83.0222
600x200x25	200	83.0223
600x250x10	250	83.0230
600x250x15	250	83.0231
600x250x20	250	83.0232
600x250x25	250	83.0233
500x500x10	-	83.0005
500x500x15	-	83.0006
500x500x20	-	83.0007
500x500x25	-	83.0008
1000x500x10	-	83.0010
1000x500x15	-	83.0011
1000x500x20	-	83.0012
1000x500x25	-	83.0013

all dimensions in mm

ACTIFOAM® slit separation sheets	sheet width	article number
----------------------------------	-------------	----------------


300x150x10	150	83.1110
300x150x15	150	83.1111
300x150x20	150	83.1112
300x150x25	150	83.1113
300x200x10	200	83.1120
300x200x15	200	83.1121
300x200x20	200	83.1122
300x200x25	200	83.1123
300x250x10	250	83.1130
300x250x15	250	83.1131
300x250x20	250	83.1132
300x250x25	250	83.1133
600x150x15	150	83.1211
600x150x20	150	83.1212
600x150x25	150	83.1213
600x200x15	200	83.1221
600x200x20	200	83.1222
600x200x25	200	83.1223
600x250x15	250	83.1231
600x250x20	250	83.1232
600x250x25	250	83.1233

all dimensions in mm







## ACTIFOAM® FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM




1) The cables can be ducted through the conduit opening in random order. It is most important that they are not pulled too tight in order not to hamper their separation at a later stage.

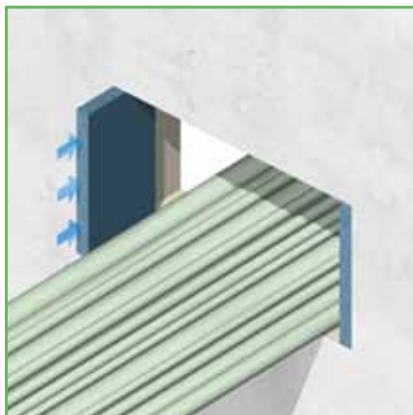


2) ACTIFOAM® rubber sheets are cut into strips fitting to the size of the walls inside the conduit opening. For this purpose, ACTIFOAM® sheets with a thickness of 25 mm are used.

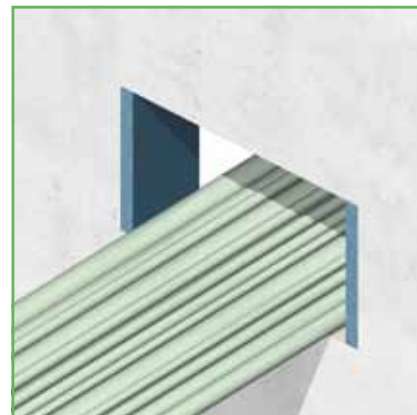

3) The ACTIFOAM® rubber sheets should fit snugly in the conduit opening to ensure a tight fit against the walls. This is important to avoid smoke penetrating between the sheets and the wall.




4) An ACTIFOAM® rubber sheet must also be placed in the conduit opening underneath the layer of cables. A band is placed around the cable bundle to lift the bundle of cables.

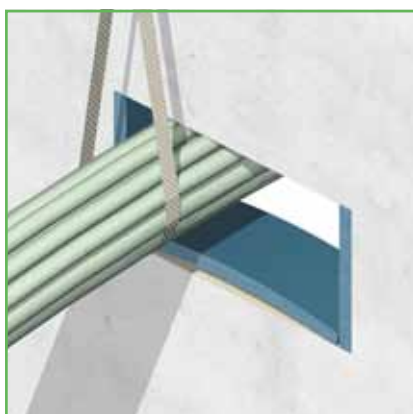

5) A slightly oversized strip of ACTIFOAM® rubber with a thickness of 25 mm is placed inside the conduit opening underneath the cables. The sheet should fit snugly between the sheets against the side walls.



6) One layer of cables is spread out on the ACTIFOAM® rubber sheet at the bottom of the conduit opening. The other cables are lifted to make room for further finishing of the first layer.

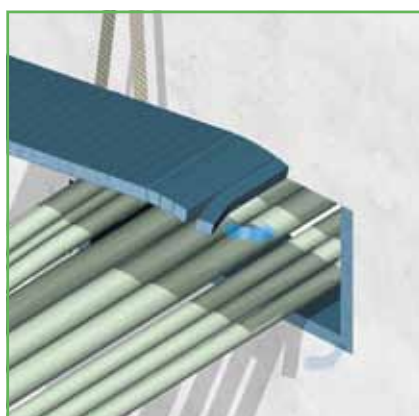

7) For proper cable separation, square profiles are torn off the pre-slit ACTIFOAM® rubber sheets. The sizes of the profiles should be equivalent to the cable diameters.




8) Profiles are slit in sizes of 10x10, 15x15, 20x20 and 25x25 mm. This enables an easy fit for corresponding cable sizes. Cables larger than 25 mm should be separated by a minimum of 25 mm.




9) Adjacent to the first layer of cables and profiles, one or more extra sheets of ACTIFOAM® rubber are fitted to create a level layer for further filling the conduit opening.




## ACTIFOAM® FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM




10) An intermediate ACTIFOAM® rubber sheet is inserted in the conduit opening on top of the levelled first layer. The thickness of the intermediate layer is dependent on the maximum cable diameter.

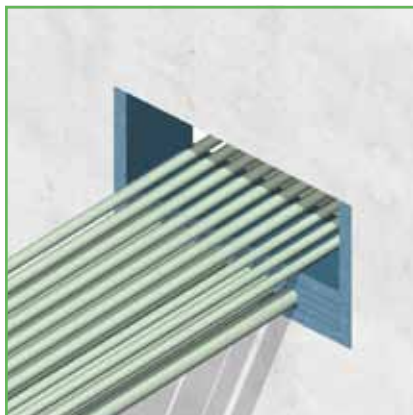


11) The next layer of cables is spread out on the ACTIFOAM® intermediate rubber sheet. As indicated before, the cables should not be pulled too tight to enable this.



12) In the same way as with the first layer of cables, the cables are separated with the ACTIFOAM® pre-slit profiles and levelled with one or more ACTIFOAM® sheets. Take care for a tight fit.




13) The remaining space is filled with one or more ACTIFOAM® sheets. All sheets should fit tightly in the conduit opening to obtain a fair degree of smoke tightness.

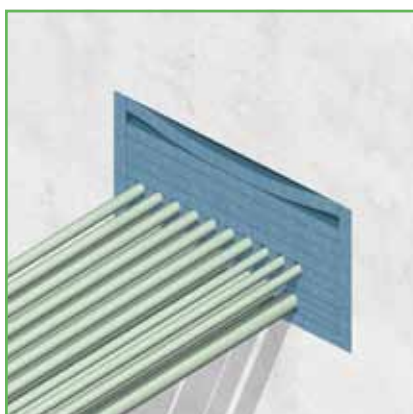


14) Due to better sliding of greased rubber on rubber, for final finishing an ACTIFOAM® sheet must be inserted between the top layers of ACTIFOAM® sheets.




15) Compression of the filling is necessary to obtain stability. For this purpose it is easier to insert a couple of strips instead of sheets. The strips are greased all around with CSD® lubricant.

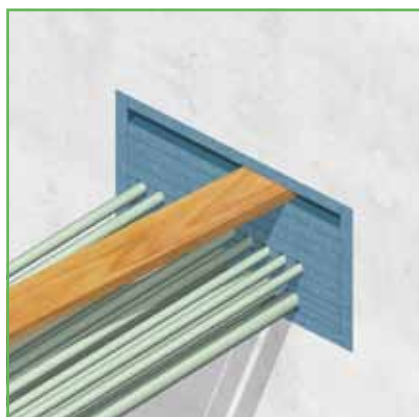

16) The first strip is inserted into the opening between the layers by hand. For a wall thickness of 150 mm it is advisable to cut three strips 50 mm wide to enable easier insertion.

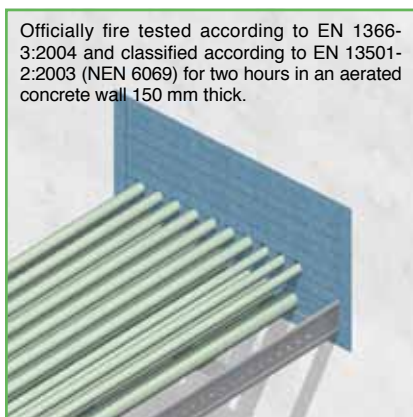

17) It is not necessary to interrupt the cable tray. ACTIFOAM® allows, if required, the tray to be passed through the conduit opening. ACTIFOAM® sheets are placed all around the cable tray.

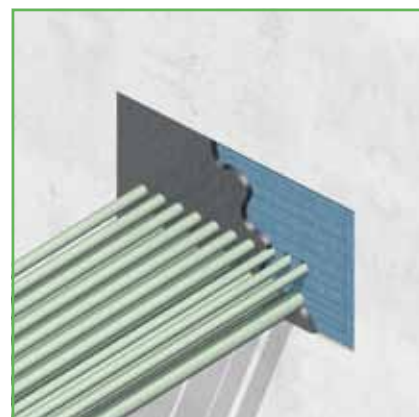


18) In case the penetration has to be not only fire safe but also gas- and water tight, the ACTIFOAM® foam rubber filling can be covered with a layer FIWA® or NOFIRNO® sealant in a thickness of minimum 10 mm.




## FIRSTO<sup>®</sup>/ACTIFOAM<sup>®</sup> FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM

### FIRSTO<sup>®</sup> wall penetrations

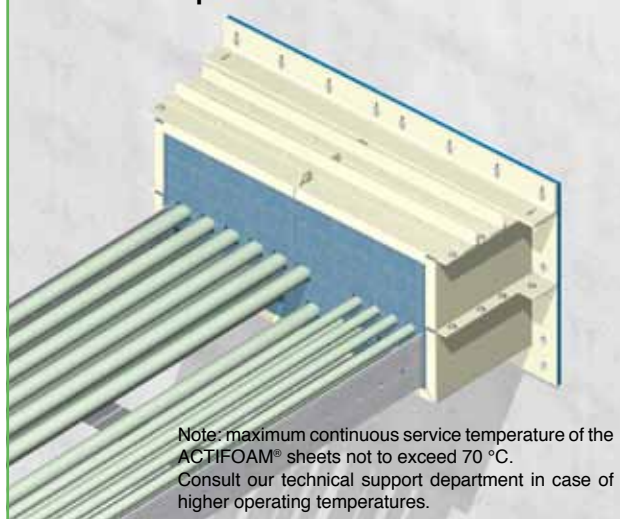

### FIRSTO<sup>®</sup> floor penetrations

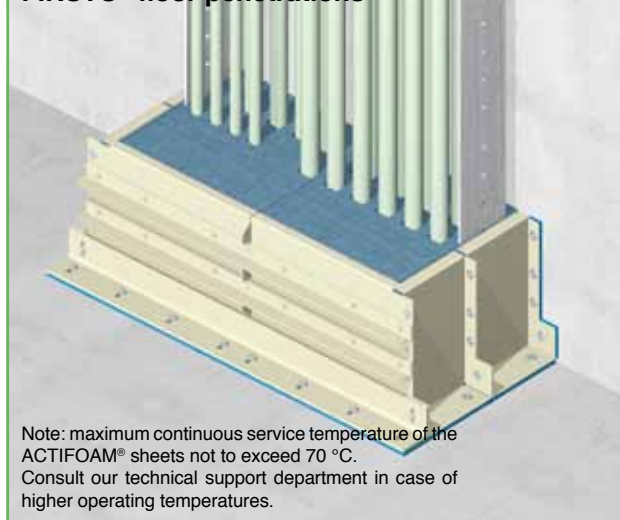

FIRSTO <sup>®</sup> wall casings	conduit opening max.	article number
FSP 300	300 x 100	81.0105
FSP 300/1	300 x 150	81.0106
FSP 300/2	300 x 200	81.0107
FSP 300/3	300 x 250	81.0108
FSP 450	450 x 100	81.0115
FSP 450/1	450 x 150	81.0116
FSP 450/2	450 x 200	81.0117
FSP 450/3	450 x 250	81.0118
FSP 600	600 x 100	81.0125
FSP 600/1	600 x 150	81.0126
FSP 600/2	600 x 200	81.0127
FSP 600/3	600 x 250	81.0128
FSP 750	750 x 100	81.0135
FSP 750/1	750 x 150	81.0136
FSP 750/2	750 x 200	81.0137
FSP 750/3	750 x 250	81.0138
FSP 900	900 x 100	81.0145
FSP 900/1	900 x 150	81.0146
FSP 900/2	900 x 200	81.0147
FSP 900/3	900 x 250	81.0148
FSP 1050	1050 x 100	81.0155
FSP 1050/1	1050 x 150	81.0156
FSP 1050/2	1050 x 200	81.0157
FSP 1050/3	1050 x 250	81.0158
FSP 1200	1200 x 100	81.0165
FSP 1200/1	1200 x 150	81.0166
FSP 1200/2	1200 x 200	81.0167
FSP 1200/3	1200 x 250	81.0168

standard: metal parts steel 37.2, powder-coated  
casings: the casings of the firestops are delivered assembled  
filling: not included in the casings; has to be ordered separately  
gaskets: are supplied as a complete set for the types of firestops; not included in the casings; they have to be ordered separately

all dimensions in mm

FIRSTO <sup>®</sup> floor casings	conduit opening max.	article number
FSP 300-F	300 x 125	81.0205
FSP 300/1-F	300 x 175	81.0206
FSP 300/2-F	300 x 225	81.0207
FSP 300/3-F	300 x 275	81.0208
FSP 450-F	450 x 125	81.0215
FSP 450/1-F	450 x 175	81.0216
FSP 450/2-F	450 x 225	81.0217
FSP 450/3-F	450 x 275	81.0218
FSP 600-F	600 x 125	81.0225
FSP 600/1-F	600 x 175	81.0226
FSP 600/2-F	600 x 225	81.0227
FSP 600/3-F	600 x 275	81.0228
FSP 750-F	750 x 125	81.0235
FSP 750/1-F	750 x 175	81.0236
FSP 750/2-F	750 x 225	81.0237
FSP 750/3-F	750 x 275	81.0238
FSP 900-F	900 x 125	81.0245
FSP 900/1-F	900 x 175	81.0246
FSP 900/2-F	900 x 225	81.0247
FSP 900/3-F	900 x 275	81.0248
FSP 1050-F	1050 x 125	81.0255
FSP 1050/1-F	1050 x 175	81.0256
FSP 1050/2-F	1050 x 225	81.0257
FSP 1050/3-F	1050 x 275	81.0258
FSP 1200-F	1200 x 125	81.0265
FSP 1200/1-F	1200 x 175	81.0266
FSP 1200/2-F	1200 x 225	81.0267
FSP 1200/3-F	1200 x 275	81.0268

all dimensions in mm

### ACTIFOAM<sup>®</sup> filler sheets

### sheet width

### article number

300x250x10	250	83.0130
300x250x15	250	83.0131
300x250x20	250	83.0132
300x250x25	250	83.0133
600x250x10	250	83.0230
600x250x15	250	83.0231
600x250x20	250	83.0232
600x250x25	250	83.0233

### ACTIFOAM<sup>®</sup> slit separation sheets

### sheet width


### article number

300x250x10	250	83.1130
300x250x15	250	83.1131
300x250x20	250	83.1132
300x250x25	250	83.1133
600x250x15	250	83.1231
600x250x20	250	83.1232
600x250x25	250	83.1233




## FIRSTO®/ACTIFOAM® FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM

FIRSTO® firestops are successfully tested at Underwriters Laboratories in USA. Approved for walls and floors for an F- and T-rating of 2 hours for units 750x400 mm.

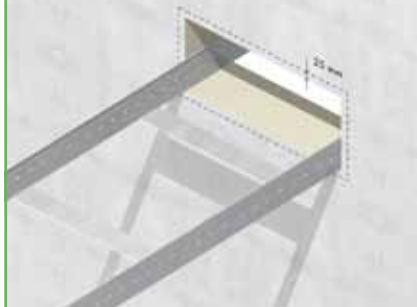


1) The conduit opening has to be 25 mm smaller all around than the inner dimensions of the firestop. This will keep the ACTIFOAM® pads against the walls inside the firestop in place during fire exposure.

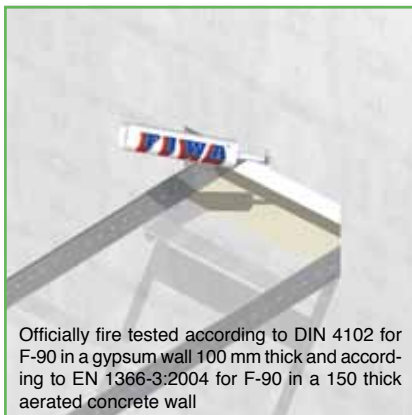


Officially fire tested according to DIN 4102 for F-90 in a gypsum wall 100 mm thick and according to EN 1366-3:2004 for F-90 in a 150 mm thick aerated concrete wall


2) If the wall around the conduit opening exhibits large irregularities, they should be locally smoothed with FIWA® or NOFIRNO® fire safe sealant. This to prevent smoke emission between the firestop and the wall.




3) Remove the attachment bracket and the cover of the firestop. Place ACTIFOAM® rubber pads on the bottom and against the side walls of the casing.

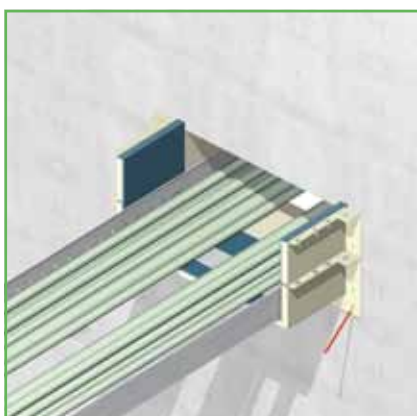


4) The casing is used as a template to mark off the attachment holes. The rubber pads against the inside walls of the firestop are 25 mm thick and should be flush with the conduit opening.

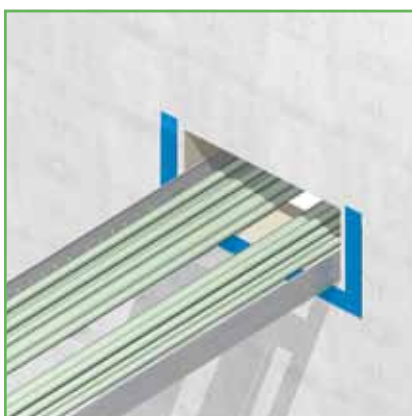


5) Then drill the holes for the anchoring bolts. After the bolts have been positioned, push all parts of the fire resistant FRR/HF gasket over the anchoring bolts and lay them against the wall.

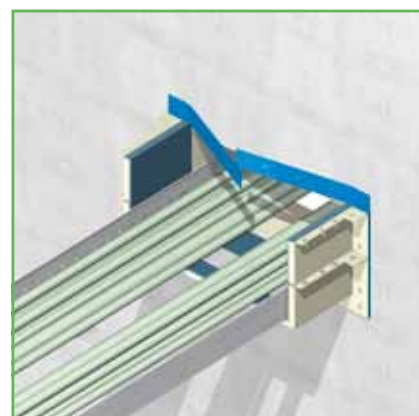


6) The casing containing the bottom layer of ACTIFOAM® rubber pads and the ACTIFOAM® rubber pads against the side walls is pushed over the anchoring bolts against the wall and firmly tightened.

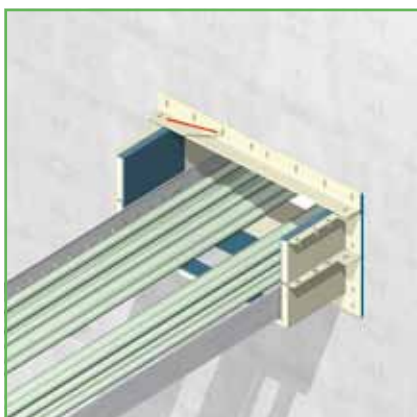

7) Position the attachment bracket on the casing against the wall and mark off the attachment holes. If necessary, the holes in the upper parts of the gasket can also be used for this purpose.

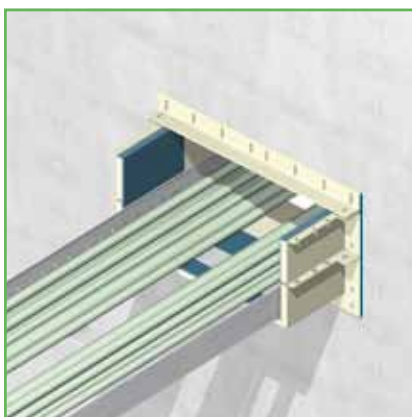

8) After drilling, position the anchoring bolts and the attachment bracket. Do not tighten the bracket firmly, in order to facilitate insertion of the top layer of rubber pads later during installation.

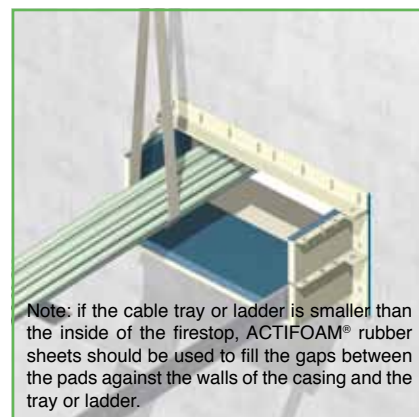


Note: if the cable tray or ladder is smaller than the inside of the firestop, ACTIFOAM® rubber sheets should be used to fill the gaps between the pads against the walls of the casing and the tray or ladder.

9) In case of larger amounts of cables, a band is placed around the cable bundle to lift the bundle of cables. ACTIFOAM® rubber pads are placed in the firestop underneath the layer of cables.







## FIRSTO<sup>®</sup>/ACTIFOAM<sup>®</sup> FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM




10) A layer of cables is spread out. For proper cable separation, square profiles are torn off the pre-slit ACTIFOAM<sup>®</sup> rubber sheets. The sizes of the profiles should be equivalent to the cable diameters.

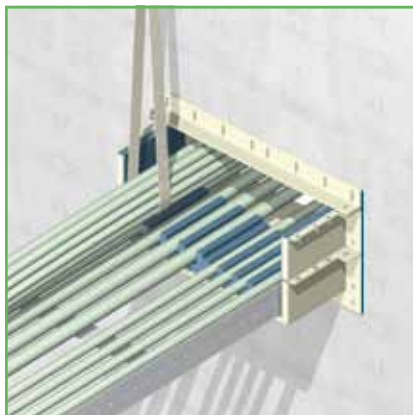


11) Profiles are slit in sizes of 10x10, 15x15, 20x20 and 25x25 mm. This enables an easy fit for corresponding cable sizes. Cables larger than 25 mm should be separated by a minimum of 25 mm.




12) Adjacent to the first layer of cables and profiles, one or more extra sheets of ACTIFOAM<sup>®</sup> rubber are fitted to create a level layer for further filling the firestop.




13) A layer of intermediate ACTIFOAM<sup>®</sup> rubber pads is inserted in the firestop on top of the levelled first layer. The thickness of the intermediate layer is dependent on the maximum cable diameter.

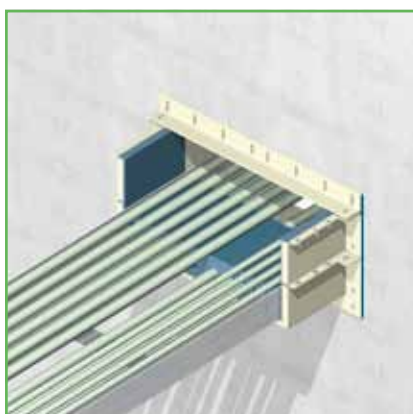


14) The next layer of cables is spread out on the layer of ACTIFOAM<sup>®</sup> intermediate rubber pads. It is most important that the cables are not pulled too tight to enable this.




15) In the same way as with the first layer of cables, the cables are separated with the ACTIFOAM<sup>®</sup> pre-slit profiles and levelled with one or more ACTIFOAM<sup>®</sup> sheets. Take care for a tight fit.



16) The remaining space is filled with layers of ACTIFOAM<sup>®</sup> pads. The filling should be flush with the top side of the firestop casing. For this purpose the pads are available 10, 15, 20 and 25 mm thick.

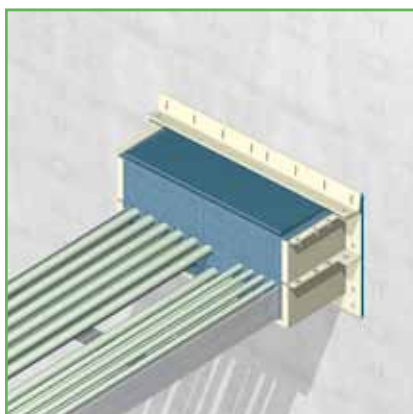


17) On top of the filling, overfill pads of minimum 10 mm should be placed. They are pushed below the attachment bracket. The bracket has not been tightened firmly yet, in order to leave sufficient play.




18) Place the cover on the firestop casing and fit the attachment bolts in the holes. The attachment bolts are long enough to allow easy installation of the nuts, despite the overfill of 10 mm ACTIFOAM<sup>®</sup>.


## FIRSTO®/ACTIFOAM® FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM

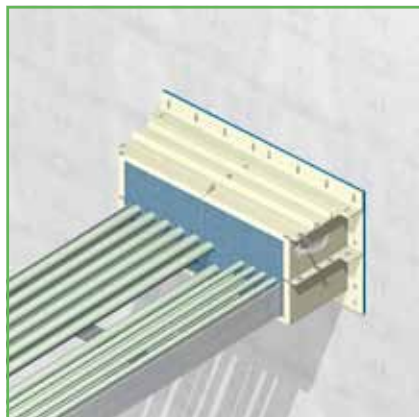

19) Tighten the attachment bolts firmly. With respect to mechanical stability and tightness, it is very important to check if the overfill is sufficient to obtain an optimum compressibility.

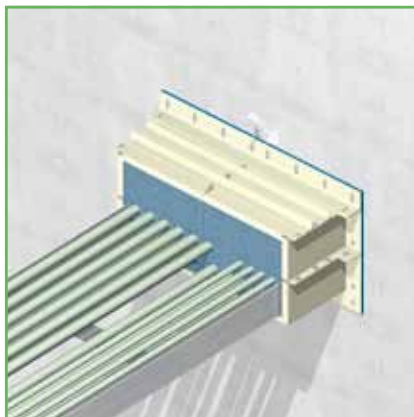


20) Place rings and nuts on all the remaining anchor bolts and tighten the attachment bolts of the attachment bracket firmly.

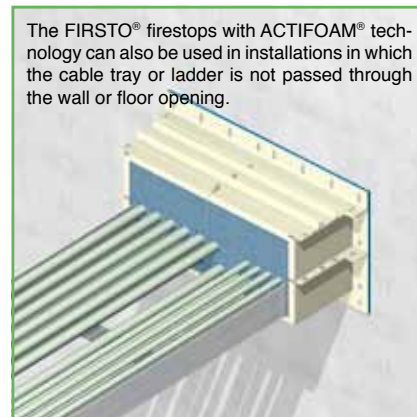


The FIRSTO® firestops with ACTIFOAM® technology can also be used in installations in which the cable tray or ladder is not passed through the wall or floor opening.

21) The installation procedure has now been completed. Firestops based on ACTIFOAM® need only to be placed at one side of the wall.

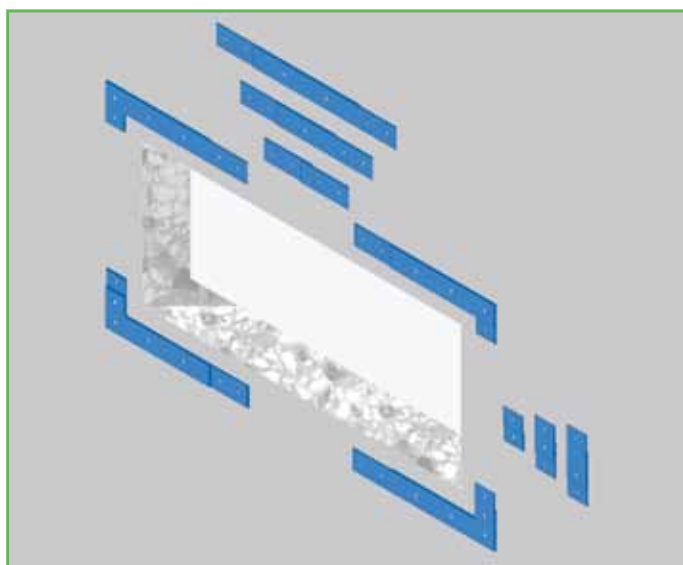

FIRSTO® wall gaskets	article number	FIRSTO® wall gaskets	article number
FSP 300	81.1105	FSP 900	81.1145
FSP 300/1	81.1106	FSP 900/1	81.1146
FSP 300/2	81.1107	FSP 900/2	81.1147
FSP 300/3	81.1108	FSP 900/3	81.1148
FSP 450	81.1115	FSP 1050	81.1155
FSP 450/1	81.1116	FSP 1050/1	81.1156
FSP 450/2	81.1117	FSP 1050/2	81.1157
FSP 450/3	81.1118	FSP 1050/3	81.1158
FSP 600	81.1125	FSP 1200	81.1165
FSP 600/1	81.1126	FSP 1200/1	81.1166
FSP 600/2	81.1127	FSP 1200/2	81.1167
FSP 600/3	81.1128	FSP 1200/2	81.0167
FSP 750	81.1135		
FSP 750/1	81.1136		
FSP 750/2	81.1137		
FSP 750/3	81.1138		

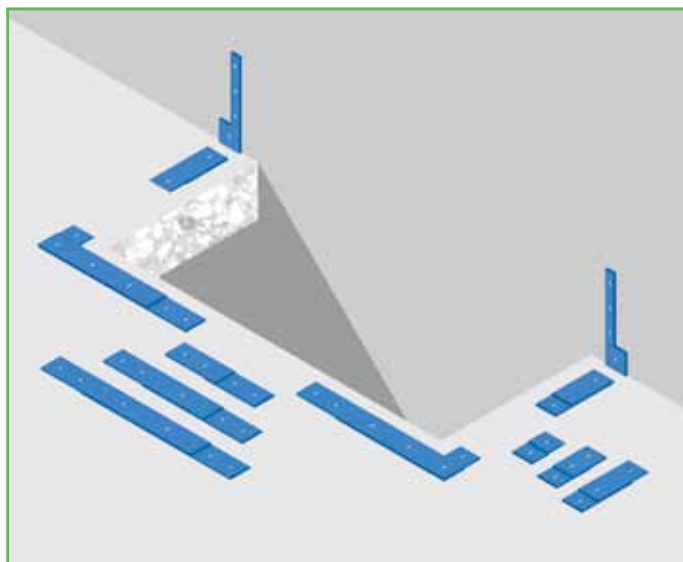

FIRSTO® floor gaskets	article number	FIRSTO® floor gaskets	article number
FSP 300-F	81.1305	FSP 900-F	81.1345
FSP 300/1-F	81.1306	FSP 900/1-F	81.1346
FSP 300/2-F	81.1307	FSP 900/2-F	81.1347
FSP 300/3-F	81.0208	FSP 900/3-F	81.1348
FSP 450-F	81.1315	FSP 1050-F	81.1355
FSP 450/1-F	81.1316	FSP 1050/1-F	81.1356
FSP 450/2-F	81.1317	FSP 1050/2-F	81.1357
FSP 450/3-F	81.1318	FSP 1050/3-F	81.1358
FSP 600-F	81.1325	FSP 1200-F	81.1365
FSP 600/1-F	81.1326	FSP 1200/1-F	81.1366
FSP 600/2-F	81.1327	FSP 1200/2-F	81.1367
FSP 600/3-F	81.1328	FSP 1200/3-F	81.1368
FSP 750-F	81.1335		
FSP 750/1-F	81.1336		
FSP 750/2-F	81.1337		
FSP 750/3-F	81.1338		



## ACTIFOAM<sup>®</sup>/NOFIRNO<sup>®</sup>-BRD FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM

NOFIRNO<sup>®</sup> mineral wool boards are supplied measuring 1000 x 600 mm with a 1.2 - 1.5 mm thick layer of NOFIRNO<sup>®</sup> coating on *one* or *both* sides.


The NOFIRNO<sup>®</sup> mineral wool boards are 60 mm thick (without coating) and have a density of 152 kg/m<sup>3</sup>. The boards can easily cut to size at site.

In case of fire the NOFIRNO<sup>®</sup> coating will form a ceramic protective shield at the exposed side. This shield is also a thermal barrier. Furthermore it prevents moisture from escaping from the inside of the mineral wool board so that no shrinkage will occur during fire exposure.


The NOFIRNO<sup>®</sup> coating is water resistant. To avoid water absorption of the mineral wool at the sides and where cutted, NOFIRNO<sup>®</sup> sealant has to be applied all around against the wall of the penetration. For mechanical stability, it is of the utmost importance that the boards fit snugly in the conduit opening and that the boards are sealed all around with NOFIRNO<sup>®</sup> sealant.

For oversized penetrations, the NOFIRNO<sup>®</sup> mineral wool boards are used to fill the remaining open space in the most economic way. For the fire rated filling around the cables, preferably ACTIFOAM<sup>®</sup> sheets are used. To obtain a fair degree of tightness, the foam filling should be compressed. To achieve sufficient compression, a NOFIRNO<sup>®</sup> fire proof plate is placed between the ACTIFOAM<sup>®</sup> filling and the NOFIRNO<sup>®</sup> mineral wool board(s). In this way also the mechanical stability of the fire safe penetration is improved.

In cases of limited wall thickness, NOFIRNO<sup>®</sup> rubber insert sleeves are applied around each of the cables at both sides of the penetration to obtain the required thermal insulation. In case that ACTIFOAM<sup>®</sup> will not been used, sufficient NOFIRNO<sup>®</sup> sealant has to be applied in between the cables and around the cable set and also in between the parts of the NOFIRNO<sup>®</sup> boards.

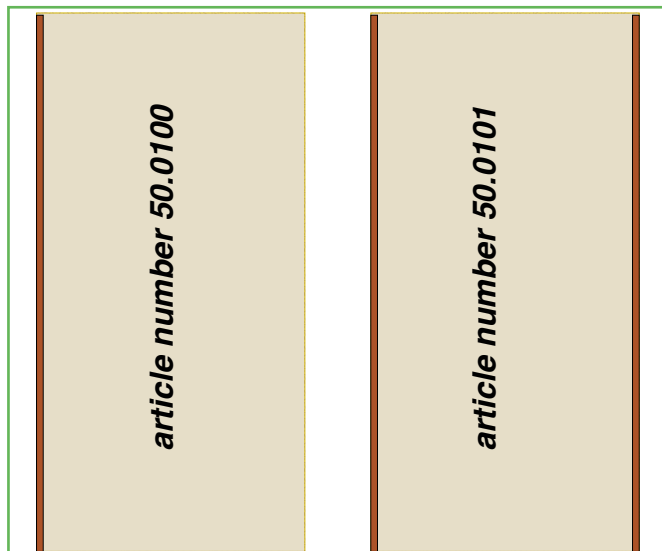

**article number 50.0104**



Fire resistant board 12 mm thick.  
To be cut to size of the conduit opening.  
Supplied in sizes 1000x1000 mm.  
Larger quantities can be supplied to size.

### PRODUCT INFORMATION SEALANT

01) colour	red brown
02) specific gravity	1.40 ± 0.03 g/cm <sup>3</sup>
03) curing of top layer	0.5 - 1 hour depending on temperature and air humidity
04) service temperature	-50 °C up to +180 °C
05) tensile strength	1.5 MPa
06) elongation at break	200%
07) hardness	45 Shore A
08) elastic deformation	approx. 50%
09) resistance	UV, Ozone, arctic conditions
10) ageing	more than 20 years
11) supplied in	310 ml cartridges
12) storage	to be stored cool and dry min/max temperature = +5/+30° C
13) storage life	guaranteed 6 months; when applied later than 6 months after date of manufacturing, curing and adhesive properties have to be checked before application



**article number 50.0102**

NOFIRNO<sup>®</sup> is a paste-like compound which is simple to use. NOFIRNO<sup>®</sup> has a balanced viscosity and can be applied overhead.

After applying the sealant, it can be smoothed by means of a wet cloth or by hand. Because the sealant adheres very tightly, the cloth and hands should be wetted with water before use to prevent sealant from sticking to them.

Shelf life is 12 months when stored properly. Since we have no control on storage, we can only guarantee for 6 months.




## ACTIFOAM®/NOFIRNO®-BRD FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM


If the walls inside the conduit opening exhibit large irregularities, they should be locally smoothed with NOFIRNO® fire safe sealant. Otherwise insufficient smoke tightness will be obtained.




1) The cables can be ducted through the conduit opening in random order. It is most important that they are not pulled too tight in order not to hamper their separation at a later stage.

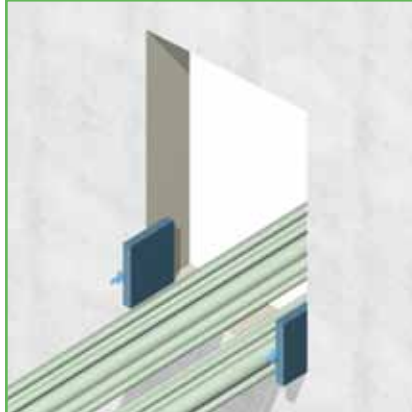


2) ACTIFOAM® rubber sheets are cut into strips fitting to the size of the walls inside the conduit opening and the expected height of the cable set. For this purpose, ACTIFOAM® sheets with a thickness of 25 mm are used.

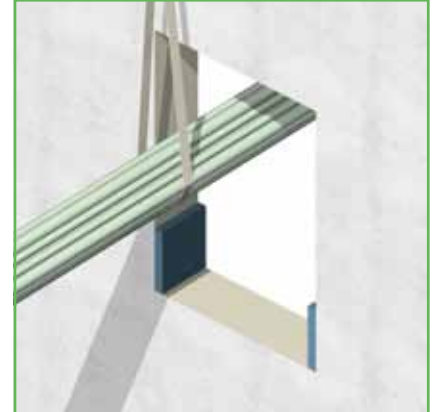


3) An ACTIFOAM® rubber sheet must also be placed in the conduit opening underneath the layer of cables. A band is placed around the cable bundle to lift the bundle of cables.

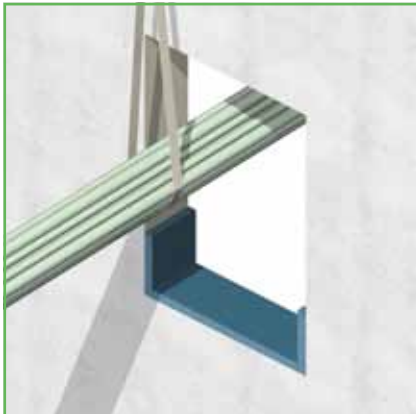


4) A slightly oversized strip of ACTIFOAM® rubber with a thickness of 25 mm is placed inside the conduit opening underneath the cables. The sheet should fit snugly between the sheets against the side walls.

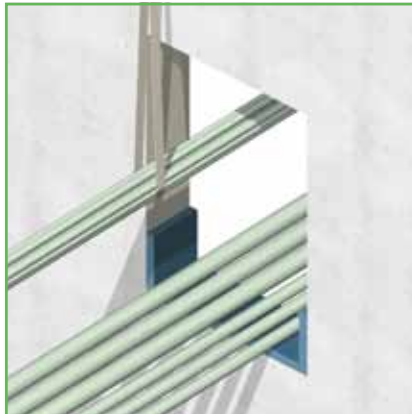


5) One layer of cables is spread out on the ACTIFOAM® rubber sheet at the bottom of the conduit opening. The other cables are lifted to make room for further finishing the first of layer.

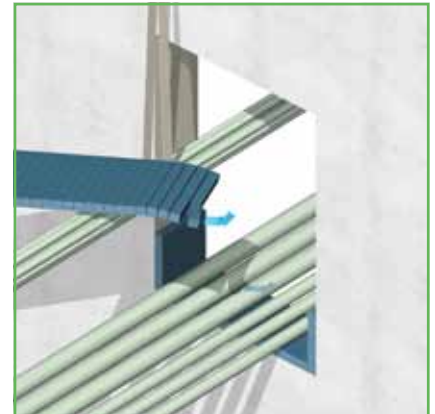


6) For proper cable separation, square profiles are torn off the pre-slit ACTIFOAM® rubber sheets. The sizes of the profiles should be equivalent to the cable diameters.

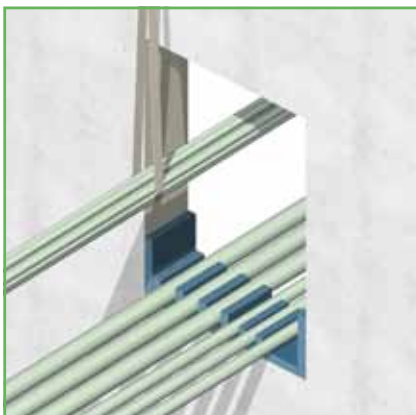

7) Profiles are slit in sizes of 10x10, 15x15, 20x20 and 25x25 mm. This enables an easy fit for corresponding cable sizes. Cables larger than 25 mm should be separated by a minimum of 25 mm.

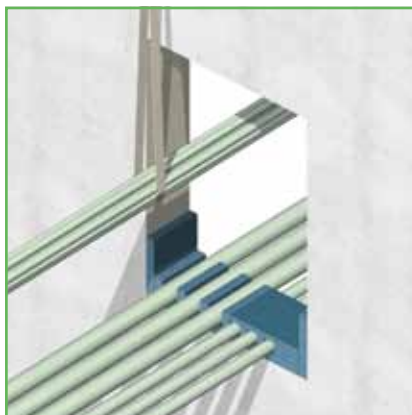


8) Adjacent to the first layer of cables and profiles, one or more extra sheets of ACTIFOAM® rubber are fitted to create a level layer for further filling the conduit opening.

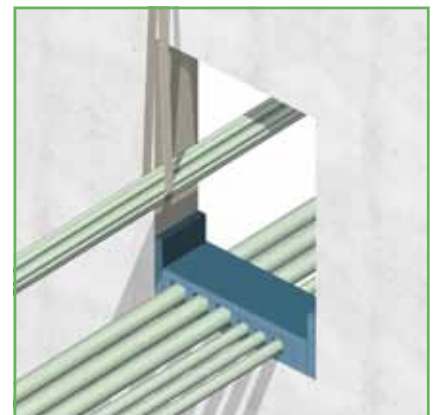


9) An intermediate ACTIFOAM® rubber sheet is inserted in the conduit opening on top of the levelled first layer. The thickness of the intermediate layer is dependent on the maximum cable diameter.




## ACTIFOAM<sup>®</sup>/NOFIRNO<sup>®</sup>-BRD FIRESAFE MULTI-CABLE & CABLE RUN TRANSIT SEALING SYSTEM




10) The next layer of cables is spread out and in the same way as with the first layer of cables, the cables are separated with the ACTIFOAM<sup>®</sup> pre-slit profiles and levelled with one or more ACTIFOAM<sup>®</sup> sheets.

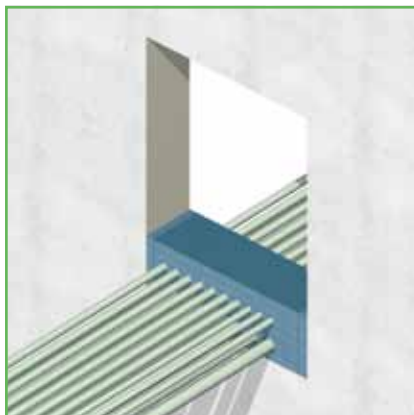


11) The remaining space between the sheets, placed against the walls, is filled with one or more ACTIFOAM<sup>®</sup> sheets. All sheets should fit tightly in the conduit opening to obtain a fair degree of smoke tightness.




12) A fire safe compression plate is placed on top of the ACTIFOAM<sup>®</sup> filling to obtain controlled expansion during fire exposure. The plate is also needed to compress the ACTIFOAM<sup>®</sup> filling in order to improve tightness.

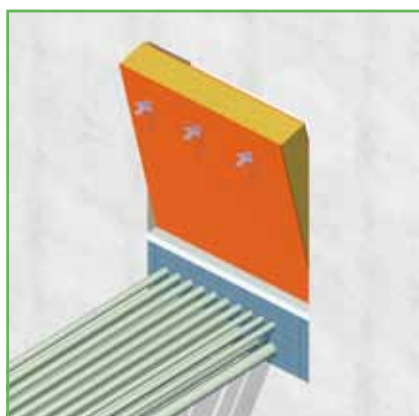

13) A NOFIRNO<sup>®</sup> coated board is cut to size and tightly fitting inserted into the open space of the conduit opening. The NOFIRNO<sup>®</sup> board should be a bit oversized in height with a view to compress the ACTIFOAM<sup>®</sup> filling.

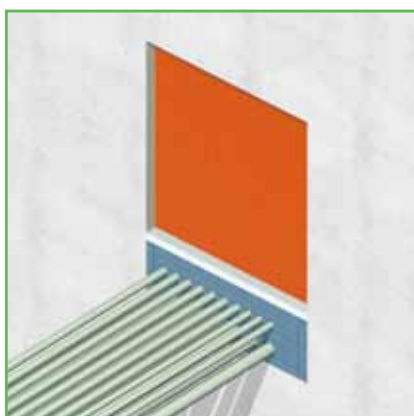


14) Depending on the required fire rating, a single NOFIRNO<sup>®</sup> board coated on both sides can be inserted in the conduit opening. For higher fire ratings two boards coated on one side only can be placed on top of the compression plate.

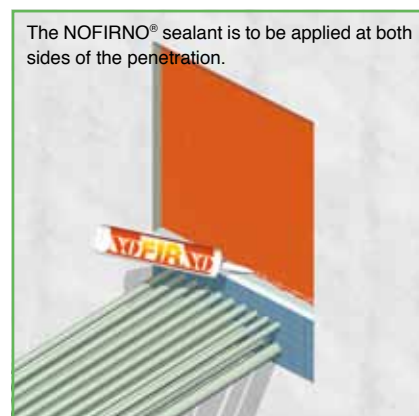


The NOFIRNO<sup>®</sup> sealant is to be applied at both sides of the penetration.

15) The NOFIRNO<sup>®</sup> board is sealed all around with NOFIRNO<sup>®</sup> sealant to obtain optimum tightness and to avoid dehydration of the mineral wool. This will also improve mechanical stability. The sealant can be smoothed by hand.

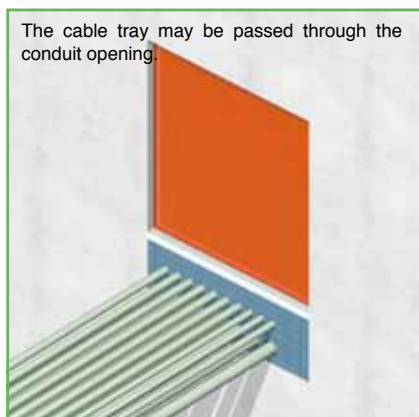


The cable tray may be passed through the conduit opening.

16) The finished NOFIRNO<sup>®</sup> - ACTIFOAM<sup>®</sup> multi-cable penetration. For adding extra cables the NOFIRNO<sup>®</sup> board can be removed and the fire safe compression plate lifted. The ACTIFOAM<sup>®</sup> filling allows easy access for ducting more cables.

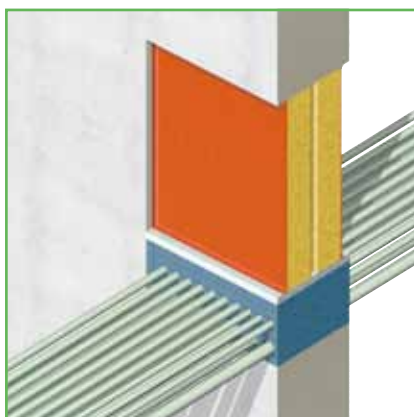


17) The finished NOFIRNO<sup>®</sup> - ACTIFOAM<sup>®</sup> multi-cable penetration with two NOFIRNO<sup>®</sup> boards coated on one side only. Fire rating is dependent on wall thickness and the amount of NOFIRNO<sup>®</sup> boards applied.

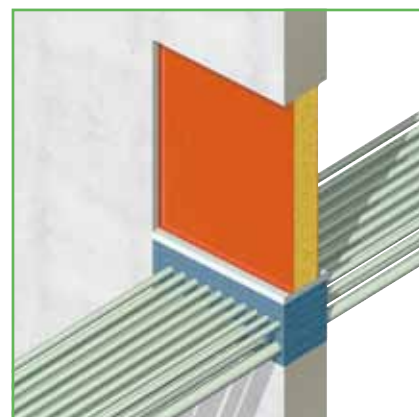

18) The finished NOFIRNO<sup>®</sup> - ACTIFOAM<sup>®</sup> multi-cable penetration with a single NOFIRNO<sup>®</sup> board coated on both sides. For installations where a lower fire rating is applicable a single NOFIRNO<sup>®</sup> board can be applied.

## NOFIRNO®, RIACNOF®, RISE® AND RISE®/ULTRA CABLE/PIPE TRANSIT SEALING SYSTEM

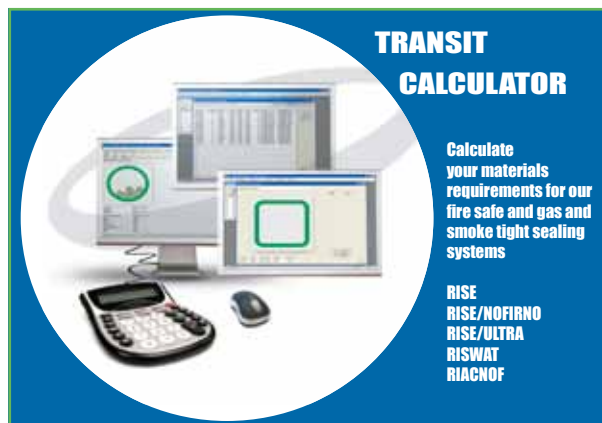

Free material calculation software. Download at our web-site <http://www.beele.com>.

After entering the dimensions of the conduit opening and the amount and outer diameters of the ducted cables or pipes, the software calculates the amount of RISE® or RISWAT® insert sleeves, the RISE®, RISWAT® or NOFIRNO® filler sleeves, the ACTIFOAM® spare filling sheets, the RISE® or RISE®/ULTRA crushers and the DRIFIL®, FIWA® or NOFIRNO® sealant. It is easy to switch between the several systems and also between A-class, H-class, EMC and watertight penetrations. After entering the dimensions and amount and sizes of cables/pipes, a drawing appears on the screen showing also the remaining free space in the conduit opening. Furthermore, the filling rate of the cable penetrations is shown. Warnings appear for deviations of the certified configurations and for overfilling the transits or exceeding filling rates.

For a created project, all calculated transits can be stored in a database. Order/calculation forms can be shown on screen for project totals and single transits. The material lists can be printed and/or exported to MS Word.

The material list of a transit shows the options which can be entered to make a calculation of the materials needed:


- 1) transit dimensions.
- 2) the depth of a transit is automatically selected based on the entered data at class (A, B, H-class or watertight) but can be changed. In this case, a warning appears that this is a deviation of the certification.
- 3) selection of the sealing system (cable, pipe).
- 4) the quantity of duplicate transits in the project.
- 5) the filling rate is calculated on the basis of the entered cable amounts and dimensions
- 6) percentage of spare for later extensions
- 7) where appropriate a selection can be made for EMC rated penetrations
- 8) type of sealant can be selected (FIWA® or NOFIRNO® for fire rated transits and DRIFIL®, FIWA® or NOFIRNO® for watertight transits)

The material list displays the selected system, cable (or pipe) specifications, and the sealing material requirements. All transits in a project can be selected to create a similar list for all materials for the whole project.

**Program-version of Transit-calculator: 3.9.2 (10 Dec 2009)**

*Always use the most recent version when creating a new material-list!*

**Material list for transit 'NOFIRNO multi-cable transit'**

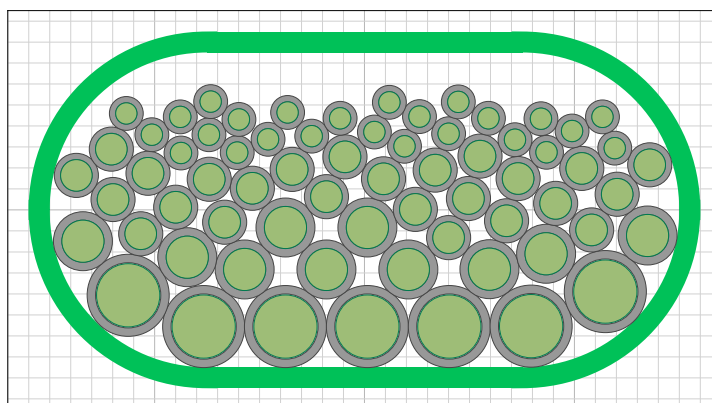

Created on: 20-1-2010 13:55:32  
Created by: Jansen  
Last modified: 24-2-2010 10:40:34  
Modified by: Dickson

### Transit specifications:

(All dimensions in mm)  
Width: 300,00  
Height: 150,00  
Corner radius: 75,00  
Depth: 180,00  
Transit type: Cable  
Transit used in this project: 1 time  
Filling rate: 36%  
Spare on cable set: 0%  
Class: A-class  
EMC: None  
Sealant: 20ml (both sides)

**Check the Type Approval Certificates for limitations in sizes !**

### Material specifications:

Type of filler sleeves: standard  
NOFIRNO sealant: cartridges 310 ml

### Cable specifications:

Cables (OD)	Amount
10,00	25
15,00	25
20,00	10
30,00	7

Total amount of cables: 67

### NOFIRNO materials needed:

Filler sleeves	Amount	Length
18/12	7	140,00 mm
27/19	16	140,00 mm

### NOFIRNO sealant

(incl. overfill) 1354 ml (5 cartridges)

### RISE materials needed:

Insert sleeves	Amount	Length
16/10	25	140,00 mm
20/14	25	140,00 mm
27/19	10	140,00 mm
39/31	7	140,00 mm




# ACTIFOAM®/ULTRA GAP SEAL

ACTIFOAM® foam rubber layered with RISE®/ULTRA rubber extremely high thermal insulation under fire load highest fire ratings with a 20 mm thick layer NOFIRNO® sealant




Escape corridor protected against fire > 3 km ACTIFOAM®/ULTRA installed and smoke with ACTIFOAM®/ULTRA. in the tunnel.

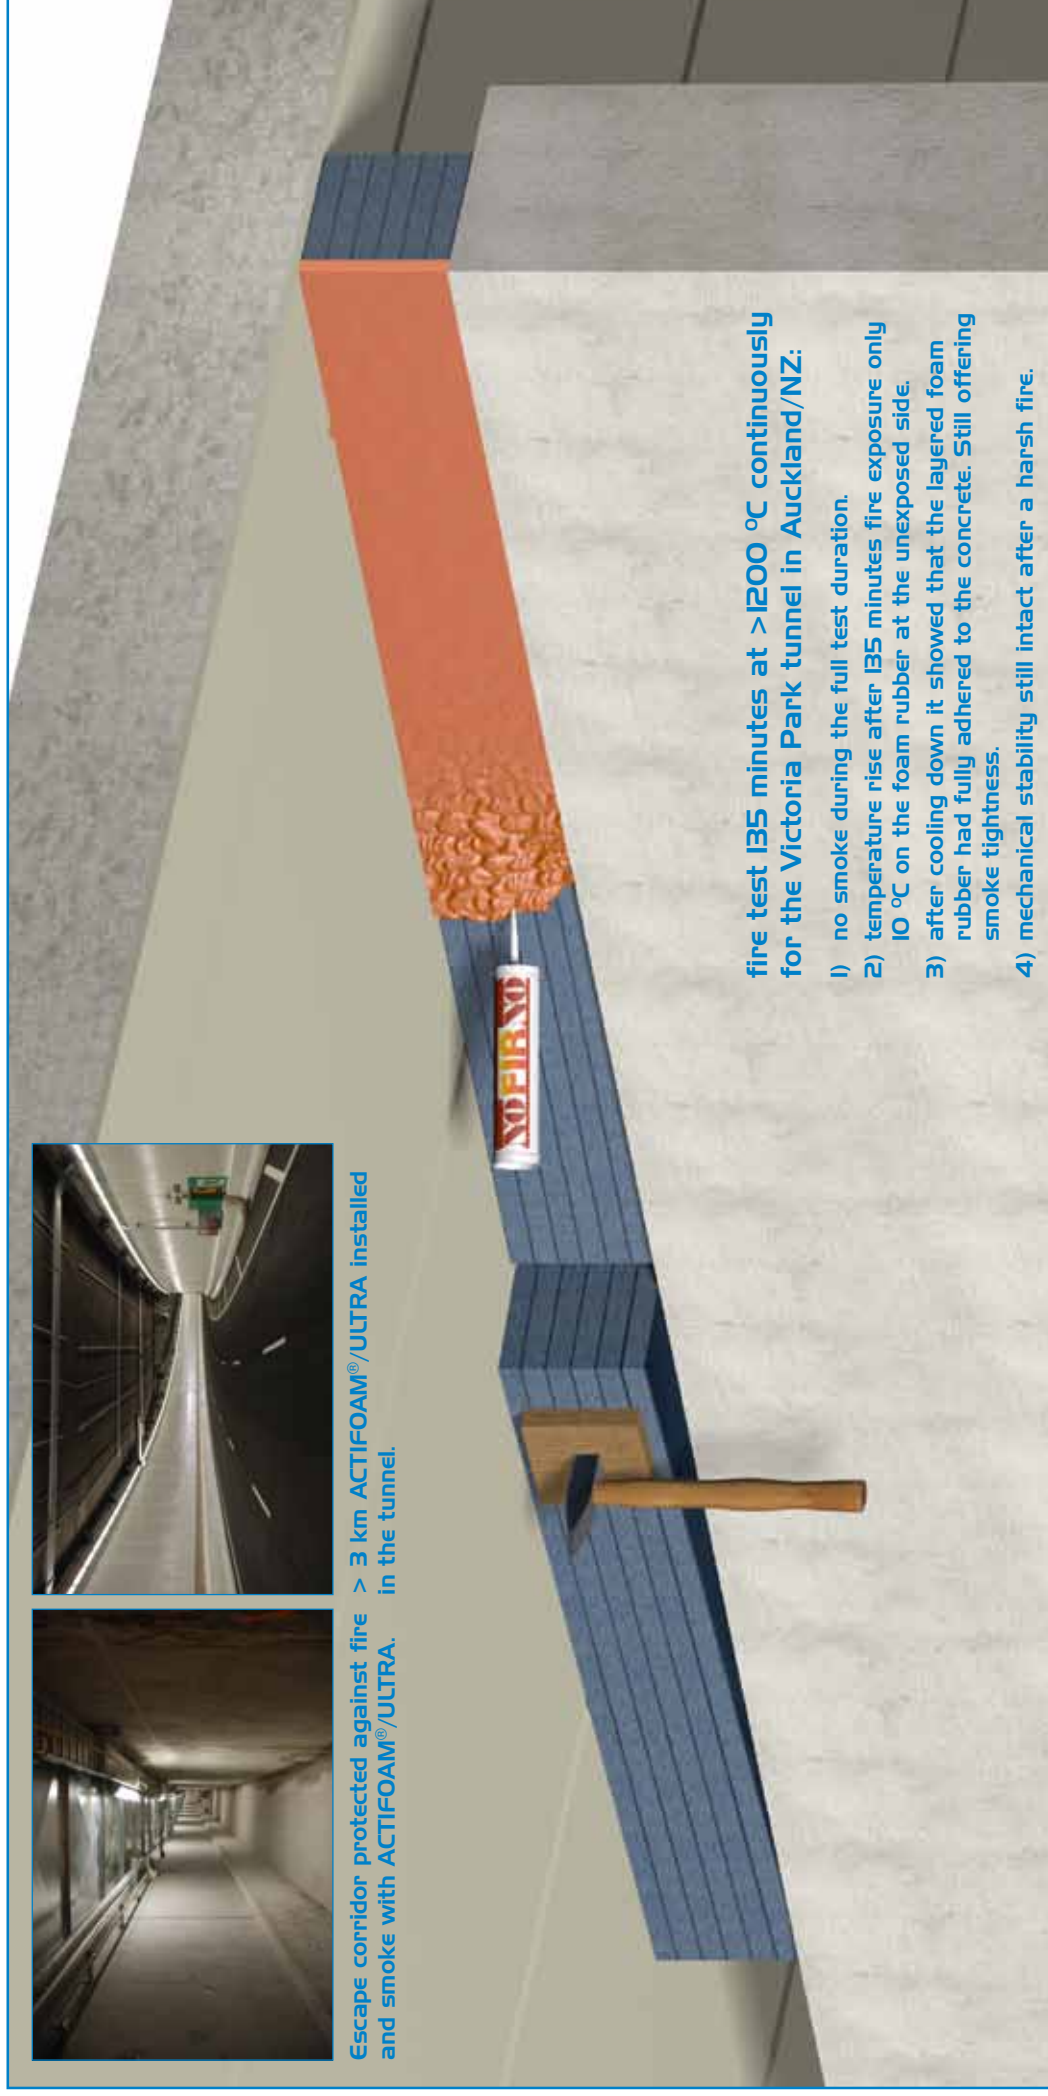

fire test 135 minutes at >1200 °C continuously for the Victoria Park tunnel in Auckland/NZ:

- 1) no smoke during the full test duration.
- 2) temperature rise after 135 minutes fire exposure only 10 °C on the foam rubber at the unexposed side.
- 3) after cooling down it showed that the layered foam rubber had fully adhered to the concrete. Still offering smoke tightness.
- 4) mechanical stability still intact after a harsh fire.

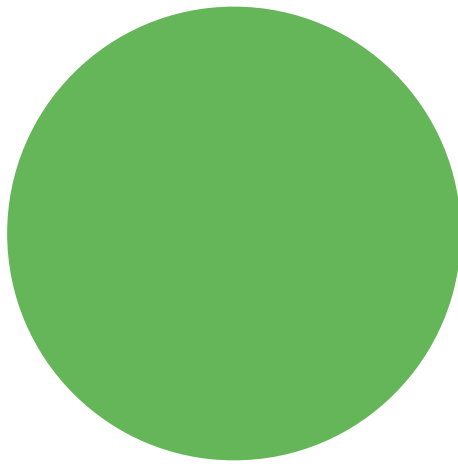

***WE CARE***

**BEELE ENGINEERING:  
A COMPANY DEDICATED TO SAFETY  
FOR OVER 35 YEARS**



**BEELE Engineering bv - CSD International bv**  
**Beunkdijk 11 - 7122 NZ AALTEN - THE NETHERLANDS**  
**Tel. +31 543 461629 - Fax +31 543 461786 - E-mail: [info@beele.com](mailto:info@beele.com)**  
**Websites: <http://www.beele.com> (and/or [www.actifoam.com](http://www.actifoam.com), [www.firsto.com](http://www.firsto.com), [www.nofirno.com](http://www.nofirno.com),  
[www.rise-systems.com](http://www.rise-systems.com), [www.rise-nofirno.com](http://www.rise-nofirno.com), [www.riswat.com](http://www.riswat.com) and [www.slipsil.com](http://www.slipsil.com))**